


T:\2018\19431_Hampton Inn_Ashland City TN\19431 E102 - E104.dwg, 5/31/2018 9:43:43 AM, hamj

Order Plans @

WWW.DIline.com

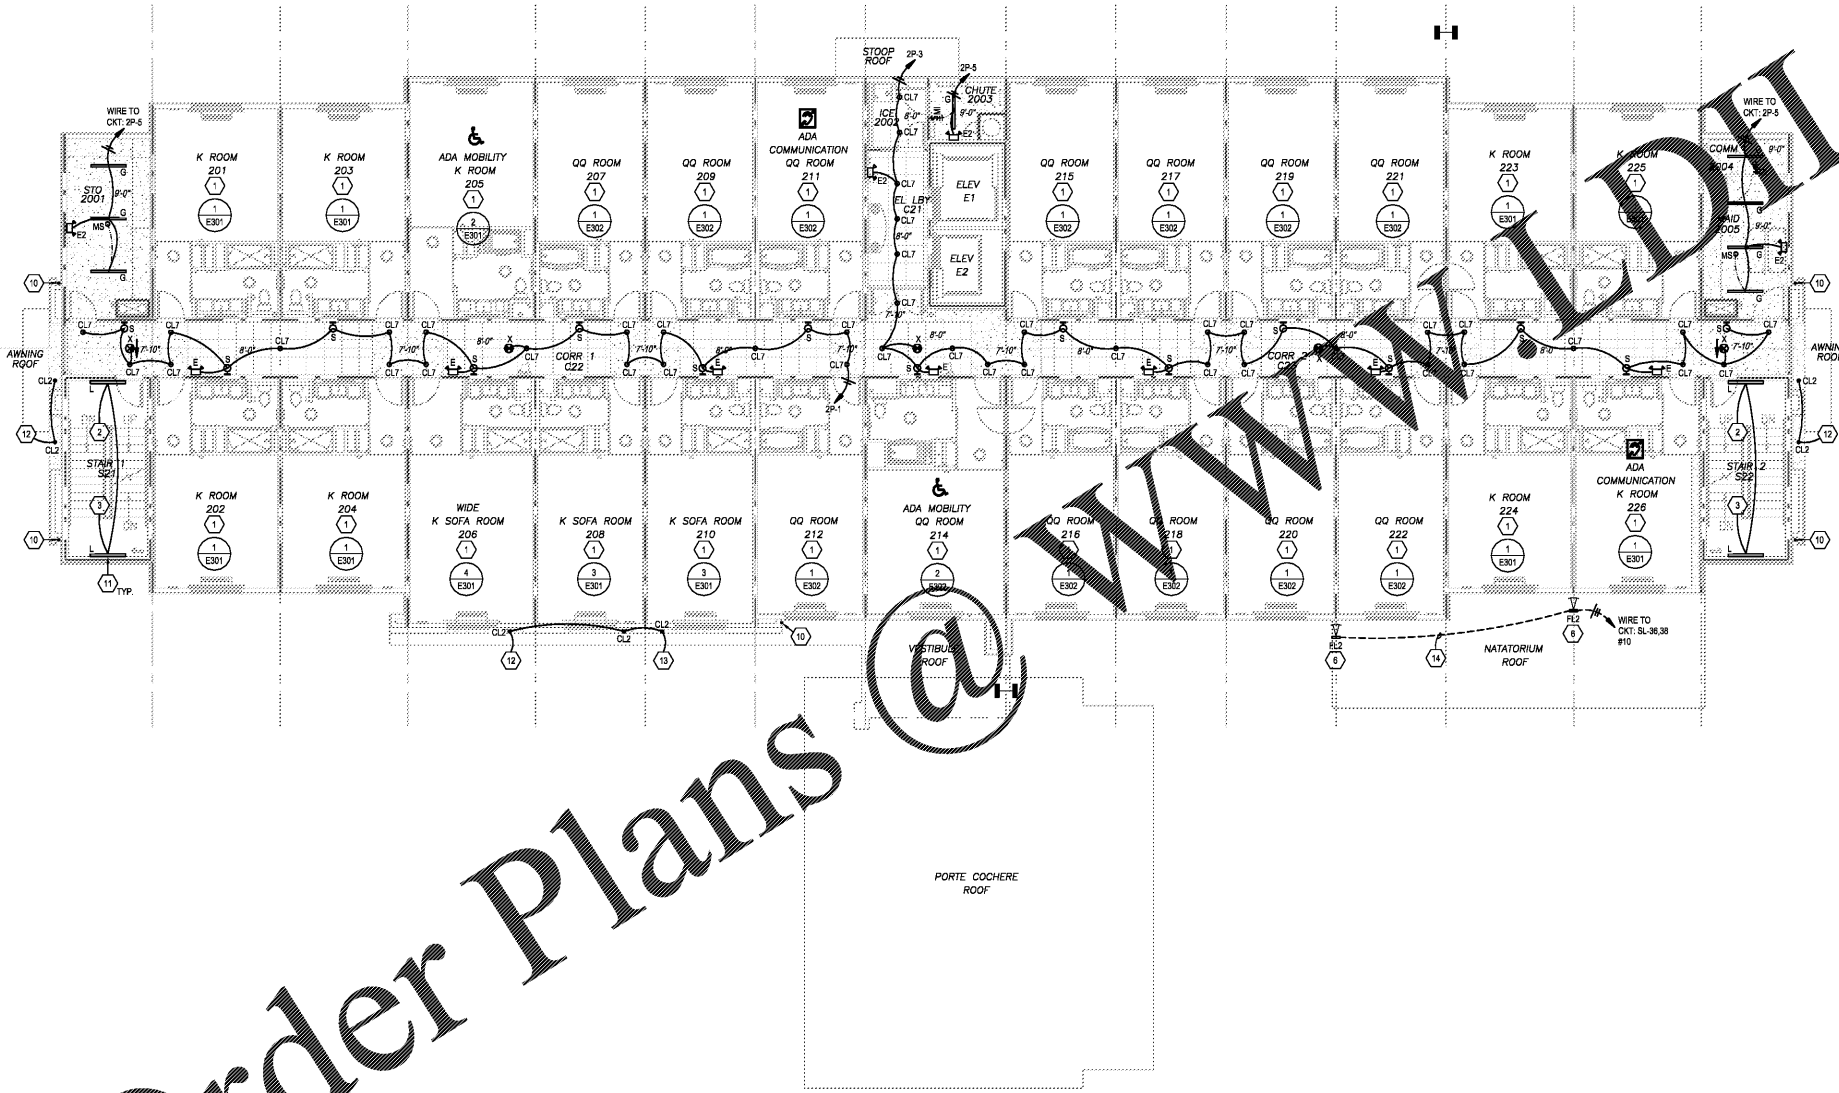

GENERAL PLAN NOTES

1. THE CONTRACTOR IS TO PROVIDE TYPE "EF" EXIT SIGNS AT LOW LEVEL ON WALL AT ALL EXIT LOCATIONS AND PATHS OF EGRESS. FIELD COORDINATE ALL LOCATION WITH FIRE MARSHAL.
2. ALL OCCUPANCY SENSORS LOCATED IN THE PUBLIC RESTROOMS AND IN THE GUEST LAUNDRY ARE TO BE SET WITH A 30A MINUTE TIME DELAY. FIELD VERIFY SETTING OF OTHER OCCUPANCY SENSORS WITH THE OWNER.
3. ALL EXIT SIGNS AND EMERGENCY LIGHTS ARE TO BE WIRED FROM NEAREST LIGHT FIXTURE AHEAD OF ANY CONTROLS ON THAT CIRCUIT. REFER TO DETAIL ON SHEET E101.

ARTWORK & FOCAL WALLS

1. THE CONTRACTOR IS TO FIELD VERIFY THE LOCATION OF ALL ARTWORK & FOCAL WALLS WITH THE ARCHITECT & INTERIOR DESIGNER PRIOR TO MOUNTING ANY EMERGENCY LIGHTS, ELECTRICAL DEVICES AND FIRE ALARM DEVICES. ADJUST LOCATIONS AS REQUIRED.

ELECTRICAL LEVEL NOTES

- (1) REFER TO SHEETS E101 & E103 FOR GUEST ROOM LARGES SIZE ELECTRICAL PLANS.
- (2) CIRCUIT UP FROM LIGHTING FIXTURES ON LEVEL 1. SEE LEVEL 1 LIGHTING PLAN ON SHEET E101.
- (3) CIRCUIT UP FROM LIGHTING FIXTURES ON LEVEL 3. SEE LEVEL 3 LIGHTING PLAN ON SHEET E103.
- (4) CIRCUIT THRU LIGHTING CONTACTOR. CONTACTOR IS TO BE CONTROLLED BY TIMELOCK & PHOTOCELL ASSEMBLY.
- (5) REFER TO ARCHITECTURAL EXTERIOR ELEVATIONS FOR MOUNTING HEIGHT.
- (6) MOUNT FLOODLIGHT ON CANOPY ROOF. AIM TO LIGHT WALL ABOVE. PROVIDE ALL REQUIRED MOUNTING MATERIALS. ALL ROOF PENETRATIONS ARE TO BE SEALED & WEATHERTIGHT.
- (7) THIS FIXTURE IS TO BE WIRED WITH CORRIDOR LIGHT FIXTURE SO IT REMAINS ON 247. THE OTHER TWO FIXTURES IN THIS ROOM ARE TO BE CONTROLLED BY THE CEILING MOUNTED OCCUPANCY SENSOR.
- (8) VERTICAL LED LIGHTING NICHE. PROVIDE "Z37A" AND "Z37C" FIXTURES IN NICHE. SEE ARCHITECTURAL ELEVATIONS FOR LOCATIONS. NICHE RUNS FROM TOP OF VESTIBULE TO TOP OF BUILDING. FIELD VERIFY QUANTITY REQUIRED FOR THE "Z37C" FIXTURES REQUIRED PRIOR TO ORDER. THE FIRST FIXTURE IS TO BE "Z37A".
- (9) RUN CIRCUIT THRU LIGHTING CONTACTOR. CONTACTOR IS TO BE CONTROLLED BY TIMELOCK & PHOTOCELL ASSEMBLY.
- (10) TYPE "TL" LED TAPE LIGHT IN TRACK RUNNING VERTICALLY DOWN FROM THE FOURTH FLOOR TO THE SECOND FLOOR. SEE ARCHITECTURAL EXTERIOR ELEVATIONS. SEE ALSO KEY NOTE 6 ON THIS SHEET.
- (11) MOUNT ALL TYPE "L" FIXTURES LOCATED IN STAIRWELLS AT 7'-0" A.F.F. OF LANDING. TYPICAL.
- (12) CIRCUIT DOWN FROM "CLZ" FIXTURES ON LEVEL 3. SEE LEVEL 3 LIGHTING PLAN ON SHEET E103. RUN #12 WIRE.
- (13) CIRCUIT UP FROM "CLZ" DRIVER ON LEVEL 1. SEE LEVEL 1 LIGHTING PLAN ON SHEET E101 KEY NOTE 28. RUN #12 WIRE.
- (14) RUN CIRCUITRY IN CEILING SPACE BELOW ROOF.


1 HOUR FIRE RATED PARTITION
2 HOUR FIRE RATED PARTITION

March Adams & Associates
370 Doolittle Ave.
Chattanooga, Tennessee 37406
PH: (615) 698-4675
www.marchadams.com

**HAMPTON INN
NEW HOTEL**
ASHLAND CITY, TENNESSEE
WWW.DAVIDRCARTER-NET
DAVID R. CARTER AND ASSOCIATES



ISSUE DATE 05-30-19
REVISION LOG



LEVEL 2 LIGHTING PLAN E102

PROJECT 00755