


02 | LEVEL 4

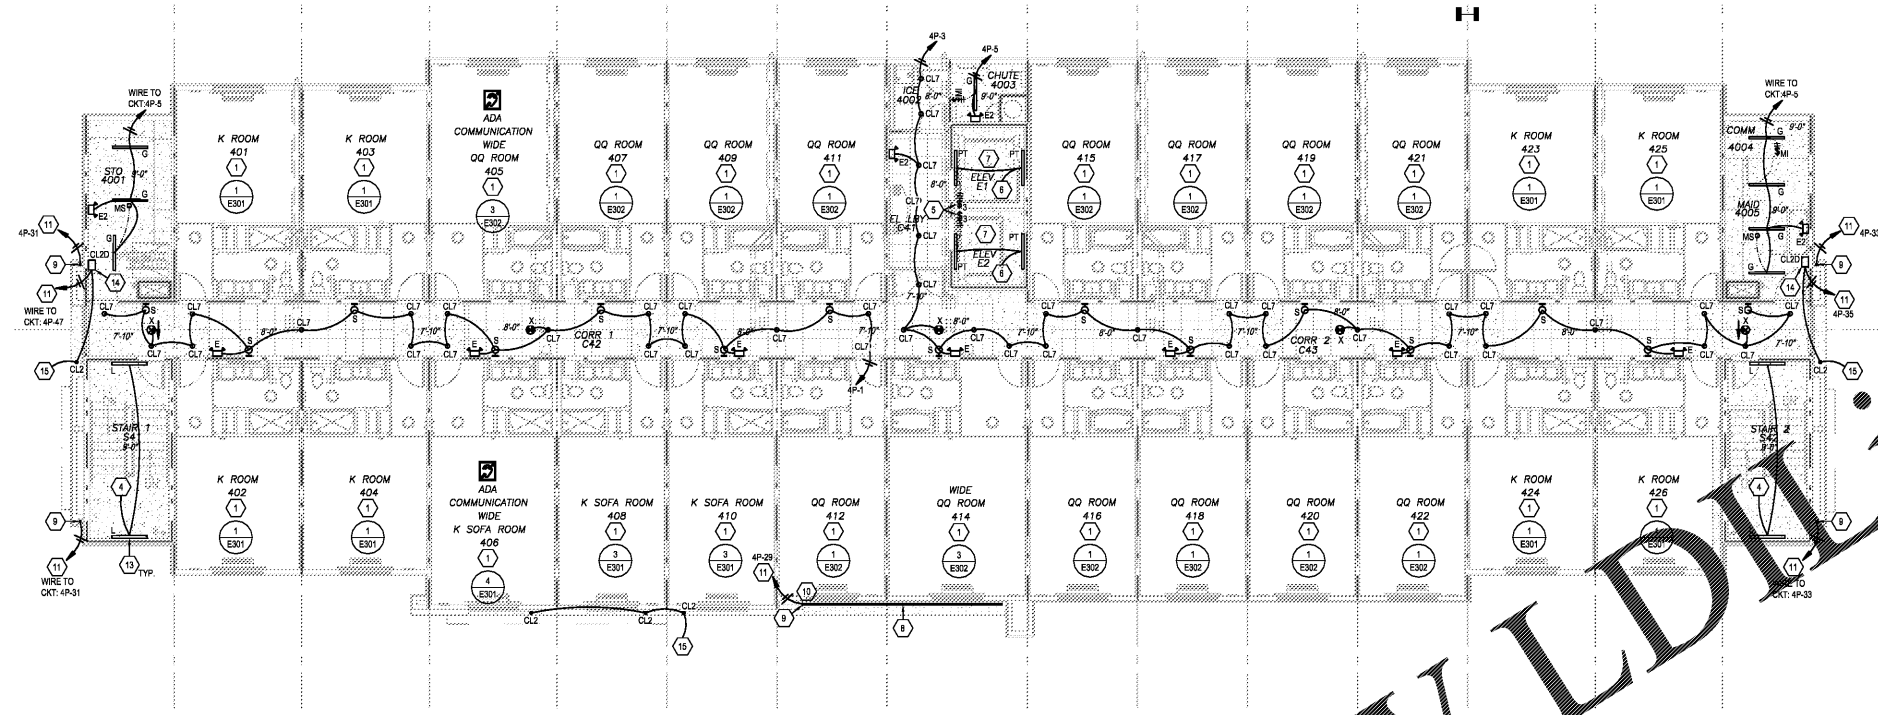

GENERAL PLAN NOTES

1. THE CONTRACTOR IS TO PROVIDE TYPE "E" EXIT SIGNS AT LOW LEVEL ON WALL AT ALL EXIT LOCATIONS AND PATHS OF EGRESS. FIELD COORDINATE ALL LOCATION WITH FIRE MARSHAL.
2. ALL OCCUPANCY SENSORS LOCATED IN THE PUBLIC RESTROOMS AND IN THE GUEST LAUNDRY ARE TO BE SET WITH A 30A MINUTE TIME DELAY. FIELD VERIFY SETTING OF OTHER OCCUPANCY SENSORS WITH THE OWNER.
3. ALL EXIT SIGNS AND EMERGENCY LIGHTS ARE TO BE WIRED FROM NEAREST LIGHT FIXTURE AHEAD OF ANY CONTROLS ON THAT CIRCUIT. REFER TO DETAIL ON SHEET E101.

ARTWORK & FOCAL WALLS

1. THE CONTRACTOR IS TO FIELD VERIFY THE LOCATION OF ALL ARTWORK & FOCAL WALLS WITH THE ARCHITECT & INTERIOR DESIGNER PRIOR TO MOUNTING ANY EMERGENCY LIGHTS, ELECTRICAL DEVICES AND FIRE ALARM DEVICES. ADJUST LOCATIONS AS REQUIRED.

ELECTRICAL LEVEL NOTES


1. REFER TO SHEETS E101 & E102 FOR GUEST ROOM LARGE ELECTRICAL PLANS.
2. CIRCUIT UP FROM LIGHTING FIXTURE ON LEVEL 2 LIGHTING PLAN ON SHEET E102.
3. CIRCUIT UP FROM LIGHTING FIXTURES ON LEVEL 4. SEE LEVEL 4 LIGHTING PLAN ON THIS SHEET.
4. CIRCUIT UP FROM LIGHTING FIXTURES ON LEVEL 3. SEE LEVEL 3 LIGHTING PLAN ON THIS SHEET.
5. LOCATE SWITCH ADJACENT TO SHAFT ACCESS HATCH (FIELD LOCATE). SWITCH IS TO OPERATE WITH 3-WAY IN PIT (SEE E101). ALL LIGHTS IN SHAFT ARE TO TURN ON/OFF TOGETHER.
6. CONNECT TO LIGHTS AT BOTTOM OF SHAFT. SEE SHEET E101.
7. LIGHT FIXTURES AT THE TOP OF THE SHAFT ARE TO BE LOCATED SO AS TO BE MOUNTED ON THE WALL ABOVE THE TOP MOST POINT OF THE ELEVATOR CAR. FIELD COORDINATE WITH ELEVATOR INSTALLER AND ELEVATOR PLANS.
8. TYPE "TL" LED TAPE LIGHT IN TRACK RUNNING HORIZONTALLY ALONG SOFFIT. SEE ARCHITECTURAL EXTERIOR ELEVATIONS.
9. TYPE "TL" LED TAPE LIGHT IN TRACK RUNNING VERTICALLY DOWN TO THE SECOND FLOOR. SEE ARCHITECTURAL EXTERIOR ELEVATIONS.
10. THE NOTES 8 & 9 TYPE "TL" LED TAPE LIGHTS ARE TO BE WIRED ON THE SAME CIRCUIT. SIZE POWER SUPPLY AS REQUIRED TO POWER BOTH SECTIONS OF TAPE. LOCATE POWER SUPPLY ABOVE NEAREST LAY-IN CEILING.
11. RUN CIRCUIT THRU LIGHTING CONTACTOR. CONTACTOR IS TO BE CONTROLLED BY TIMECLOCK & PHOTOCELL ASSEMBLY.
12. TYPE "TL" LED TAPE LIGHT IN TRACK RUNNING VERTICALLY DOWN FROM THE FOURTH FLOOR TO THE SECOND FLOOR. SEE ARCHITECTURAL EXTERIOR ELEVATIONS. SEE ALSO KEY NOTE 9 ON THIS SHEET.
13. MOUNT ALL TYPE "L" FIXTURES LOCATED IN STAIRWELLS AT 7'-0" A.F.F. OF LANDING. TYPICAL.
14. LOCATION FOR THE REMOTE DRIVER FOR THE TEN TYPE "OL2" CAN LIGHTS. MOUNT DRIVER HIGH ON WALL AND RUN WIRING DOWN INSIDE OF EXTERIOR WALL TO FIXTURES. SEE SHEET E102 FOR ADDITIONAL FIXTURE LOCATIONS. RAISE #12 TO EACH FIXTURE. FIXTURES ARE WIRED IN SERIES. FEED FROM DRIVER TO LAST FIXTURE NOT TO EXCEED 200'.
15. CIRCUIT DOWN TO "OL2" FIXTURES ON LEVEL 3. SEE LEVEL 3 LIGHTING PLAN ON THIS SHEET. RUN #12 WIRE.
16. CIRCUIT DOWN FROM "OL2" FIXTURES ON LEVEL 4. SEE LEVEL 4 LIGHTING PLAN ON THIS SHEET. RUN #12 WIRE.
17. CIRCUIT DOWN TO "OL2" FIXTURES ON LEVEL 2. SEE LEVEL 2 LIGHTING PLAN ON SHEET E102. RUN #12 WIRE.

1 HOUR FIRE RATED PARTITION
2 HOUR FIRE RATED PARTITION

March Adams & Associates
370 Dabbs Ave.
Chattanooga, Tennessee 37404
P: (423) 969-4675
F: (423) 969-4675

WWW.LDLINE.COM


01 | LEVEL 3

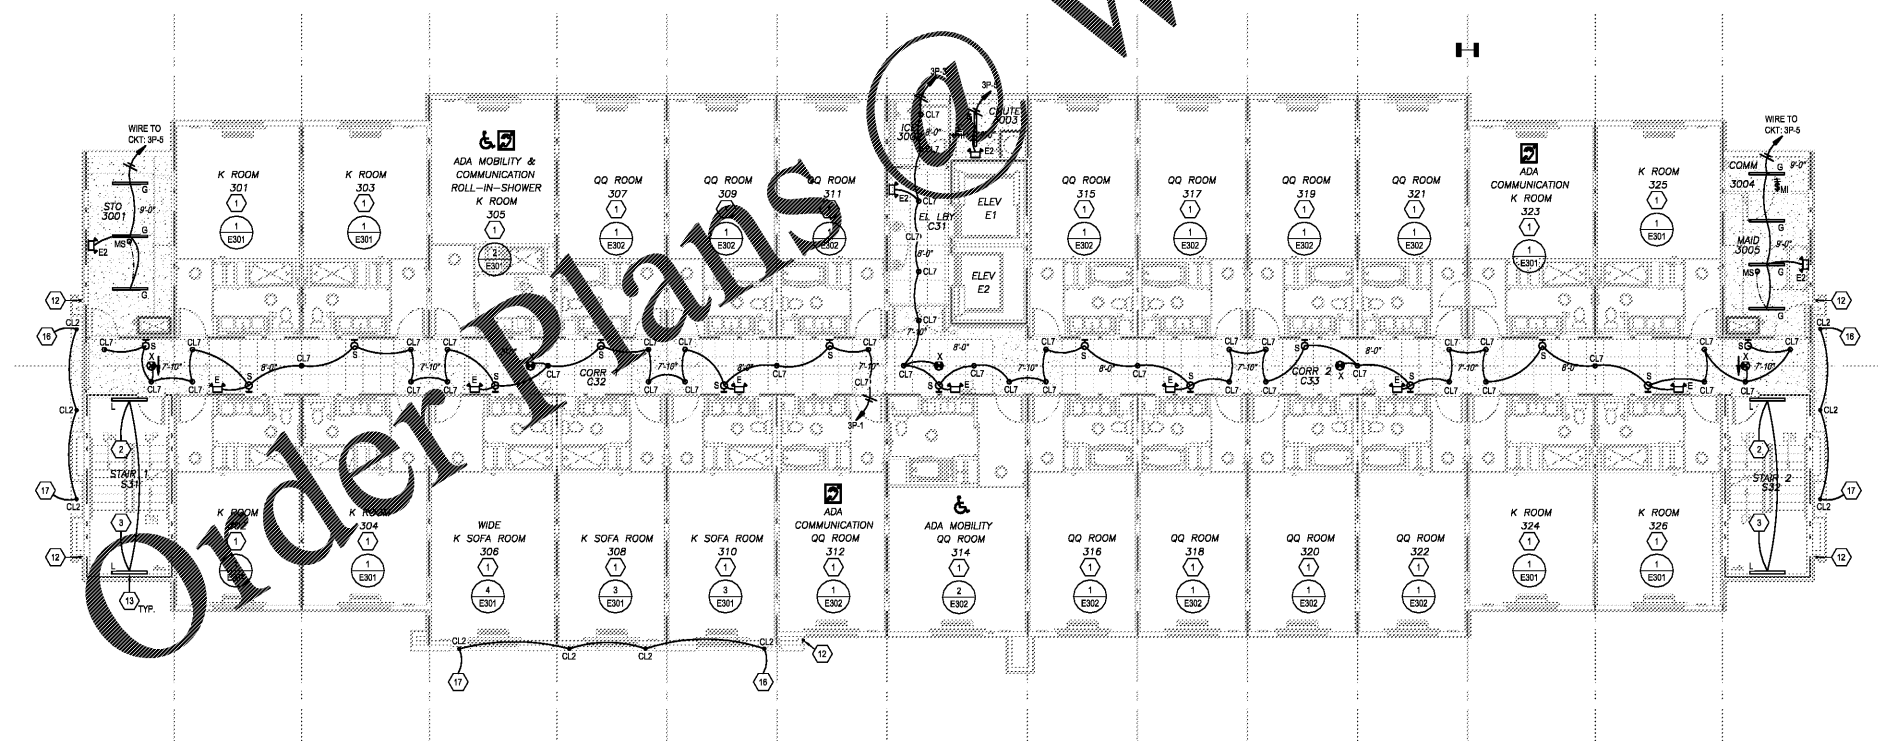

HAMPTON INN
NEW HOTEL
ASHLAND CITY, TENNESSEE
WWW.DAVIDRCARTER-NET
DAVID R. CARTER AND ASSOCIATES

STEVEN BOYD SARGENT
GOVERNOR
STATE OF TENNESSEE

ISSUE DATE 05-30-19
REVISION LOG



LEVELS 3 & 4 LIGHTING PLANS E103