

02 DUMPSTER SCREEN / STORAGE

**FIRE/SMOKE DAMPERS**

1. THE CONTRACTOR IS TO FIELD COORDINATE THE LOCATION OF ALL FIRE/SMOKE DAMPERS WITH THE MECHANICAL CONTRACTOR PRIOR TO DOING ANY WORK. PROVIDE A 120V POWER CONNECTION & FIRE ALARM CONNECTION AT EACH DAMPER. WIRE ON CIRCUITS AS FOLLOWS:

1ST FLOOR: P-7 - APPROX. 21 DAMPERS  
 2ND FLOOR: 2P-10 - APPROX. 16 DAMPERS  
 3RD FLOOR: 3P-11 - APPROX. 16 DAMPERS  
 4TH FLOOR: 4P-10 - APPROX. 18 DAMPERS

**WIRELESS ACCESS POINTS**

1. THE CONTRACTOR IS TO FIELD COORDINATE THE LOCATION OF ALL WIRELESS ACCESS POINTS WITH THE OWNER PRIOR TO DOING ANY WORK. PROVIDE A 120V POWER CONNECTION & DATA CONNECTION AT EACH LOCATION. WIRE ON CIRCUITS AS FOLLOWS:

1ST FLOOR: P-8  
 2ND FLOOR: 2P-12  
 3RD FLOOR: 3P-12  
 4TH FLOOR: 4P-12

**GENERAL PLAN NOTES**


1. NO OBSTACLES SHALL BE INSTALLED WITHIN 6' OF POOL EDGE.  
 2. ALL APPLIANCES TO HAVE TO HAVE LOCK-OFF DEVICE AT PANEL.

**ELECTRICAL KEYED NOTES**

① PROVIDE TAMPER AND FLOW SWITCHES AT FLOOR SHUT OFF VALVES AT SPRINKLER STAND PIPE. FIELD VERIFY LOCATION OF VALVES WITH SPRINKLER CONTRACTOR.  
 ② RUN CIRCUIT UP TO RECEPTACLE AT SECOND FLOOR LEVEL.

1 HOUR FIRE RATED PARTITION  
 2 HOUR FIRE RATED PARTITION

**March Adams & Associates**  
 370 Danks Ave.  
 Chattanooga, Tennessee 37404  
 P: (423) 968-4675  
 F: (423) 968-4675

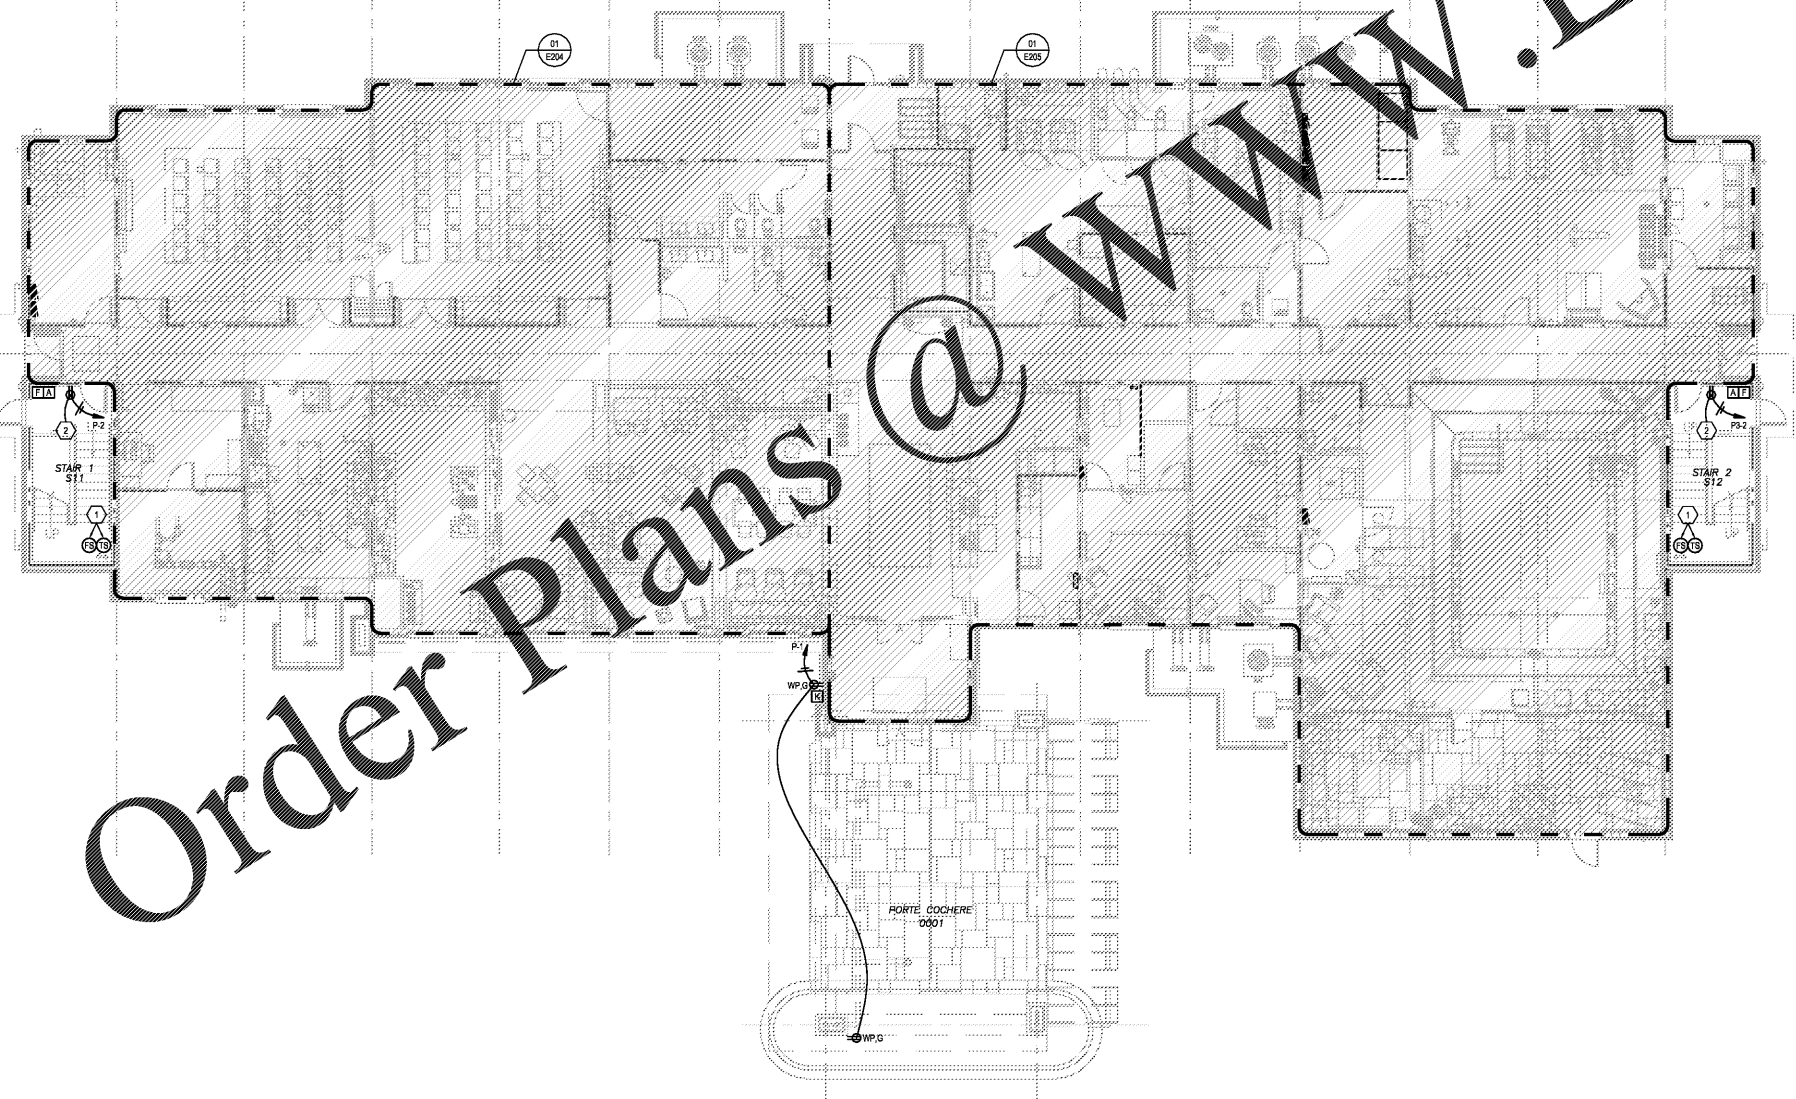


Order Plans @ [WWW.LDILine.com](http://WWW.LDILine.com)

**HAMPTON INN  
 NEW HOTEL**  
 ASHLAND CITY, TENNESSEE  
 WWW.DAVIDRCARTER.NET  
**DAVID R. CARTER AND ASSOCIATES**



ISSUE DATE 05-30-19  
 ▲ REVISION LOG



PROJECT 00755

**LEVEL 1 POWER PLAN E201**

T:\2019\19431\_Hampton Inn\_Ashland City TN\19431 E201 - E208.dwg, 5/31/2019 9:43:05 AM, hrcjll