


02 | LEVEL 4

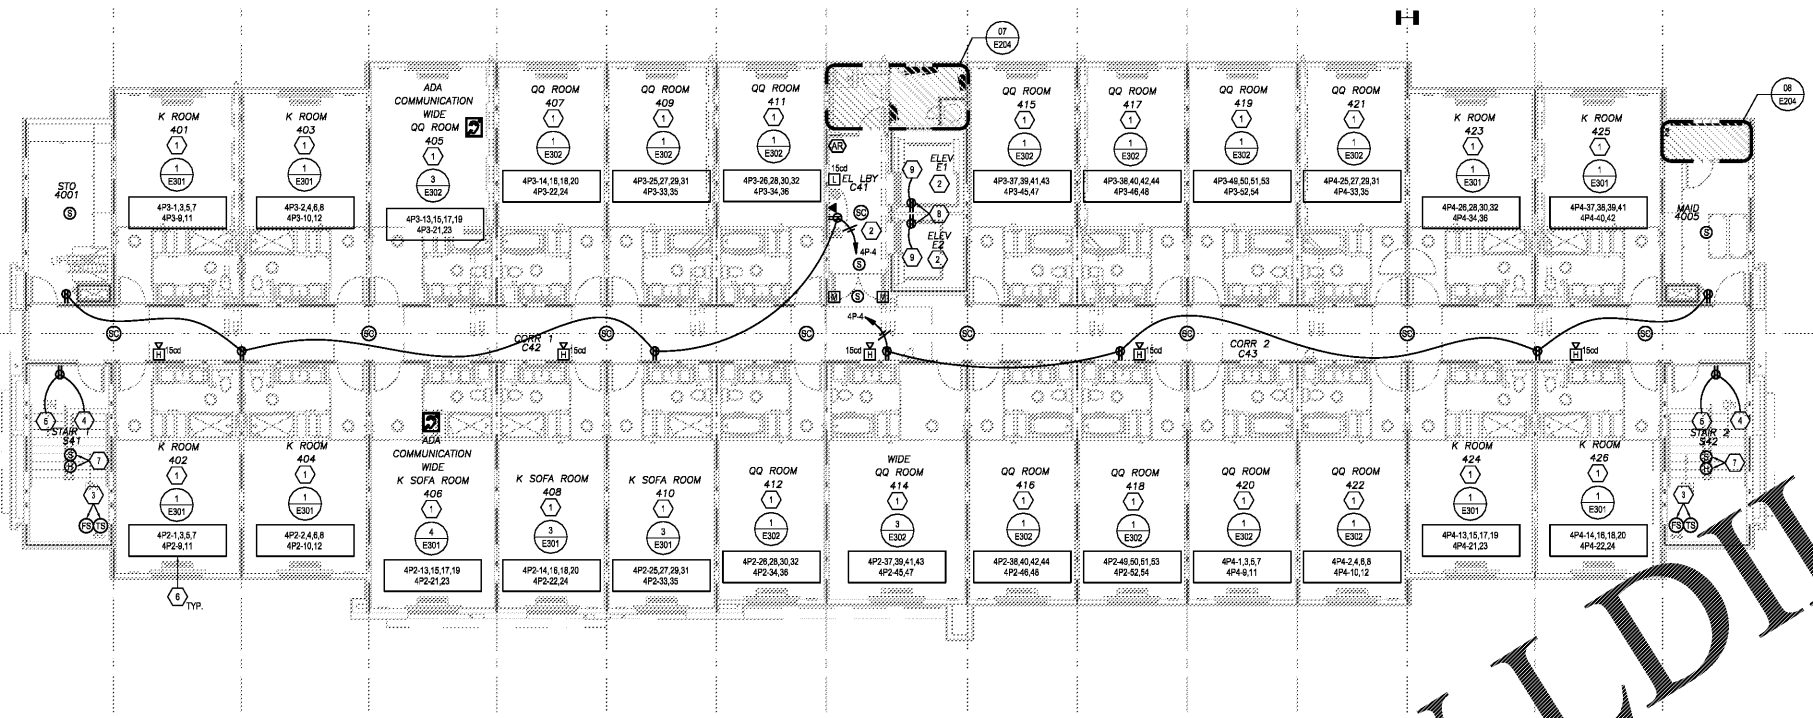

FIRE/SMOKE DAMPERS

1. THE CONTRACTOR IS TO FIELD COORDINATE THE LOCATION OF ALL FIRE/SMOKE DAMPERS WITH THE MECHANICAL CONTRACTOR PRIOR TO DOING ANY WORK. PROVIDE A 120V POWER CONNECTION & FIRE ALARM CONNECTION AT EACH DAMPER. WIRE ON CIRCUITS AS FOLLOWS:

1ST FLOOR: P-7 - APPROX. 21 DAMPERS
 2ND FLOOR: 2P-10 - APPROX. 16 DAMPERS
 3RD FLOOR: 3P-15 - APPROX. 16 DAMPERS
 4TH FLOOR: 4P-10 - APPROX. 18 DAMPERS

WIRELESS ACCESS POINTS

1. THE CONTRACTOR IS TO FIELD COORDINATE THE LOCATION OF ALL WIRELESS ACCESS POINTS WITH THE OWNER PRIOR TO DOING ANY WORK. PROVIDE A 120V POWER CONNECTION & DATA CONNECTION AT EACH LOCATION. WIRE ON CIRCUITS AS FOLLOWS:

1ST FLOOR: P-9
 2ND FLOOR: 2P-12
 3RD FLOOR: 3P-12
 4TH FLOOR: 4P-12

GENERAL PLAN NOTES

1. ALL CHANGES TO HAVE TO BE CHECK-OFF DEVICE AT PANEL.
 2. ANY EXPOSED CONDUIT FOR POWER & LIGHTING SHALL RUN TIGHT TO CORNERS AND HUG STRUCTURE AS TO BE VISUALLY MINIMIZED.

ELECTRICAL KEYED NOTES


1 REFER TO SHEETS E301 & E302 FOR GUESTROOM LARGE SCALE ELECTRICAL PLANS.
 2 SEE ELEVATOR FIRE ALARM RISER ON E302 FOR DEVICES REQUIRED IN THIS AREA.
 3 PROVIDE TAMPER AND FLOW SWITCHES AT FLOOR SHUT OFF VALVES AT SPRINKLER STAND PIPE. FIELD VERIFY LOCATION OF VALVES WITH SPRINKLER CONTRACTOR.
 4 RUN CIRCUIT UP FROM RECEPTACLE AT FIRST FLOOR LEVEL. SEE SHEET E201.
 5 RUN CIRCUIT UP TO RECEPTACLE AT THIRD FLOOR LEVEL. SEE SHEET E203.
 6 THIS BOX REPRESENTS CIRCUITS TO BE USED FOR EACH GUESTROOM. SEE LARGE SCALE PLANS ON SHEETS E301 & E302.
 7 MOUNT DEVICES IN TOP OF STAIRWELL.
 8 OUTLET AT TOP OF SHAFT NEXT TO SHAFT ACCESS HATCH (FIELD LOCATE).
 9 CIRCUIT FROM OUTLET IN PIT (SEE E205).

1 HOUR FIRE RATED PARTITION
 2 HOUR FIRE RATED PARTITION

March Adams & Associates
 370 Dobbins Ave.
 Chattanooga, Tennessee 37404
 (423) 698-4675
 www.marchadams.com

WWW.LDILine.com


01 | LEVEL 3

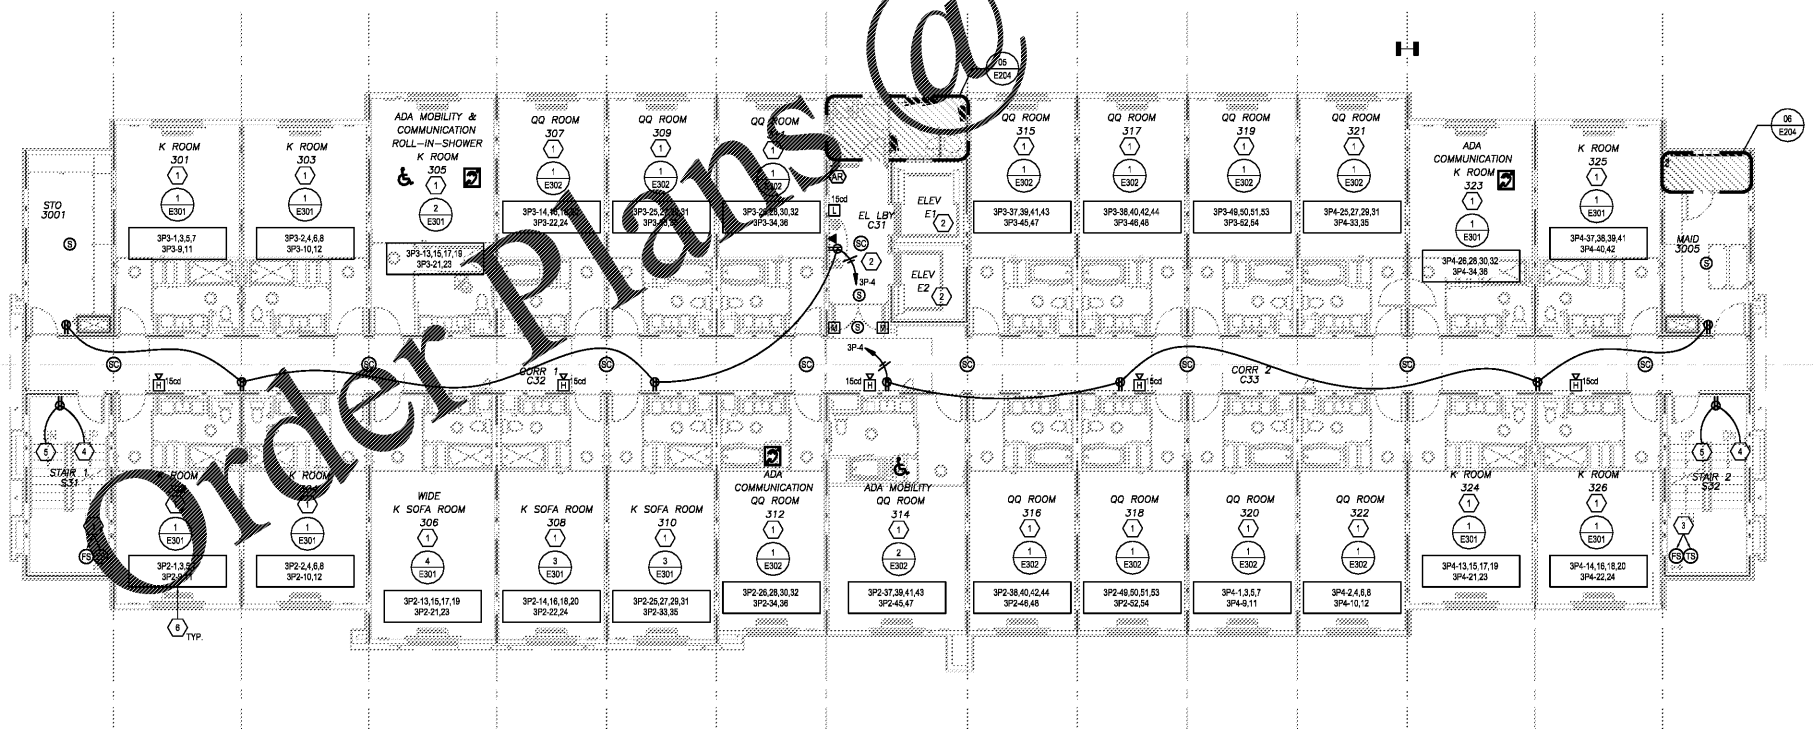

HAMPTON INN
 NEW HOTEL
 ASHLAND CITY, TENNESSEE
 WWW.DAVIDRCARTER.NET
 DAVID R. CARTER AND ASSOCIATES

STEVEN BOYD SARGENT
 ARCHITECT
 CITY OF TENNESSEE

ISSUE DATE 05-30-19
 REVISION LOG



LEVELS 3 & 4 POWER PLANS E203

T:\2019\19431_Hampton Inn_Ashland City_TN\19431-E201-E208.dwg, 5/31/2019 9:42:29 AM, hcartl