


T:\2019\19431_Hampton Inn_Ashland City TN\19431 E201 - E208.dwg, 5/31/2019 9:41:28 AM, harrj

Order Plans @

www.EDiLine.com

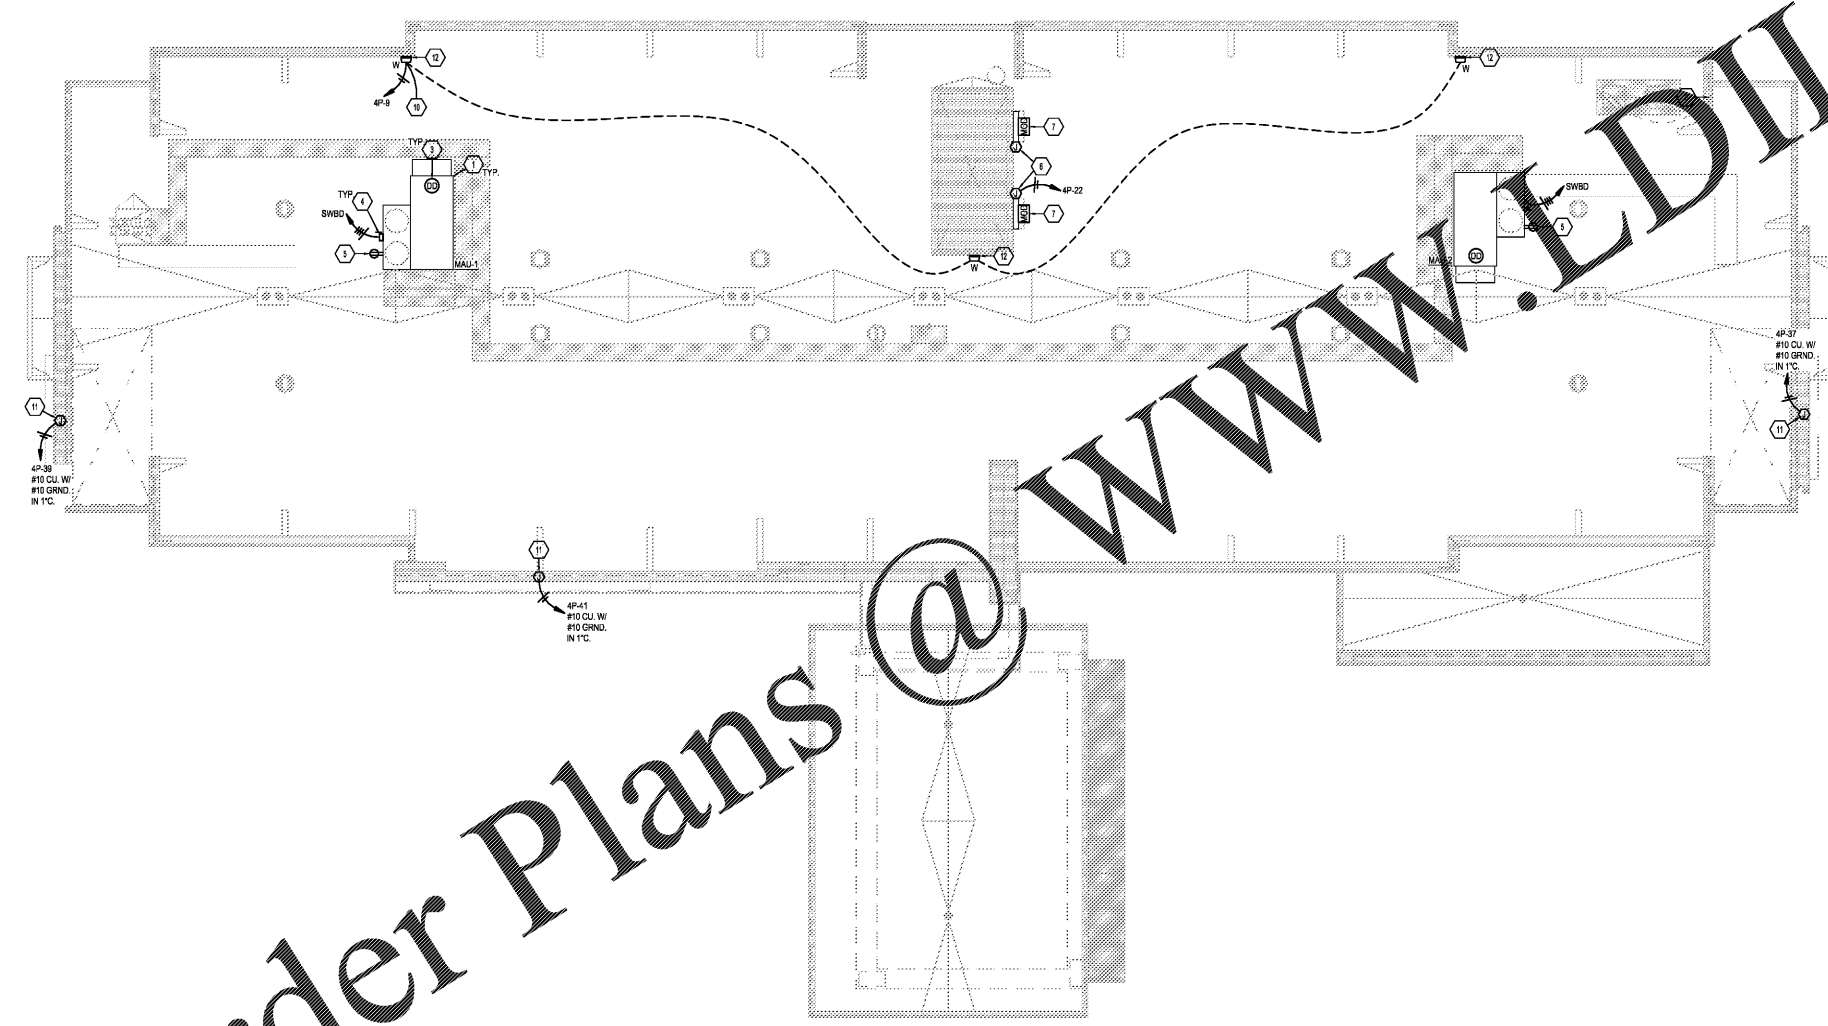

GENERAL PLAN NOTES

- 1. THE CONTRACTOR SHALL VERIFY THE LOCATION OF ALL DISCONNECT SWITCHES REQUIRED BY THE PROJECT, PRIOR TO THEIR INSTALLATION...
2. ELECTRICAL CONTRACTOR IS TO PROVIDE SHUTDOWN MEANS AND CONNECTION TO THE FIRE ALARM CONTROL PANEL FOR EACH HVAC UNIT...
3. ELECTRICAL CONTRACTOR IS TO PROVIDE SINGLE GANG BOXES STUBBED OUT ABOVE CEILING IN AT ALL THERMOSTAT LOCATIONS...
4. LOCATIONS SHOWN FOR MECHANICAL UNITS ARE ONLY APPROXIMATE...
5. REFER TO SHEET E206 FOR HVAC UNIT INFORMATION.
6. ALL APPLIANCES TO HAVE THEIR OWN GROUNDING OFF LINE AT PANEL.

ELECTRICAL KEYED NOTES


- 1. LOCATIONS SHOWN FOR MECHANICAL UNITS ARE ONLY APPROXIMATE...
2. THERMOPROOF GFCI RECEPTACLE MOUNT ON SIDE OF UNIT...
3. DUCT DETECTOR PROVIDED AND INSTALLED BY ELECTRICAL CONTRACTOR...
4. MOUNT DISCONNECT SWITCH AT UNIT AS DESCRIBED IN GENERAL NOTE 1...
5. FACTORY MOUNTED & WIRED CONVENIENCE OUTLET...
6. PROVIDE 120V CONNECTION TO MOTORIZED DAMPER...
7. PROVIDE FIRE ALARM SYSTEM MONITOR MODULE...
8. TWO EACH 1/2" STUBBED OUT OF ROOF WITH MASTHEAD...
9. FAN TO BE CONTROLLED BY MALLS...
10. TO SWITCH INSIDE STAIRWELL...
11. PROVIDE 120V ELECTRICAL CONNECTION TO BUILDING SIGN...
12. MOUNT FIXTURE ON BACK SIDE OF PARAPET...

1 HOUR FIRE RATED PARTITION
2 HOUR FIRE RATED PARTITION
March Adams & Associates

HAMPTON INN
NEW HOTEL
ASHLAND CITY, TENNESSEE
WWW.DAVIDRCARTER.NET
DAVID R. CARTER AND ASSOCIATES



ISSUE DATE 05-30-19
REVISION LOG



ROOF LEVEL POWER PLAN E207
PROJECT 00755