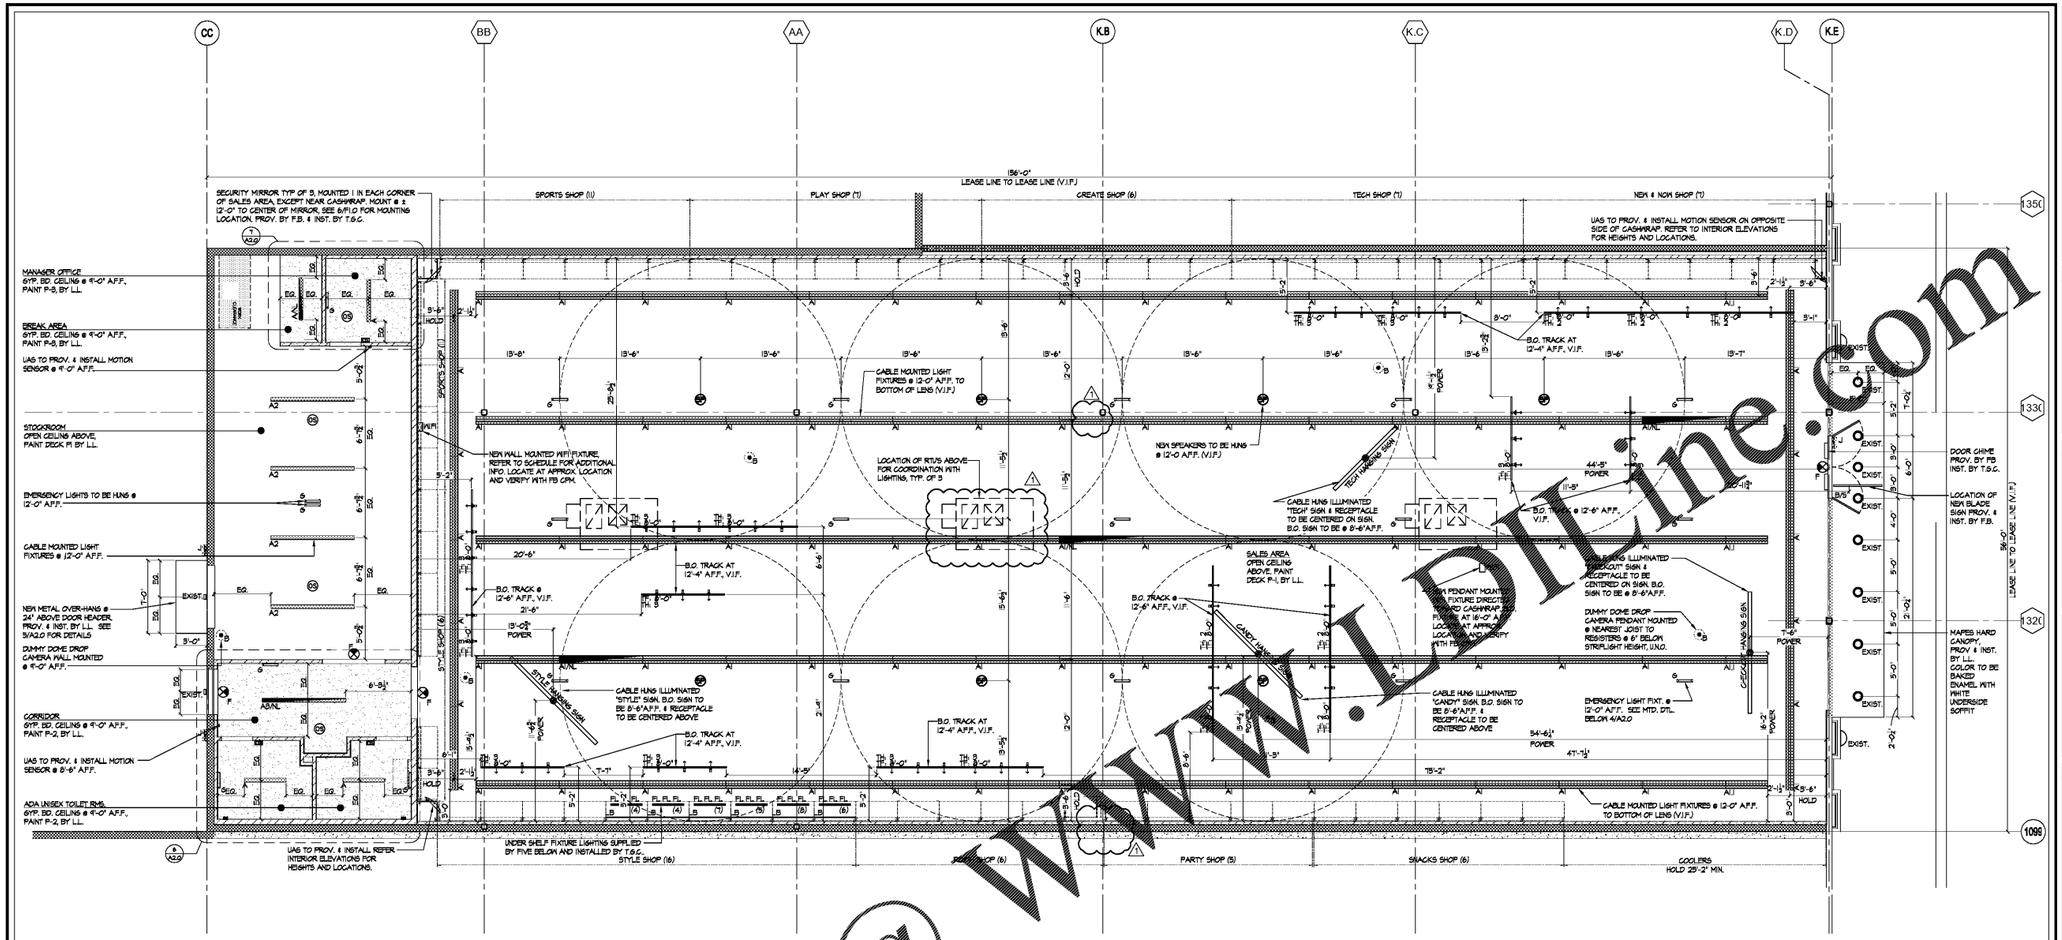

NOTE:
HORNS & STROBES TO BE HUNG SUSPENDED FROM CEILING IN STOCKROOM AREA SO AS TO NOT IMPEDE W/ FIXTURES.

L.L. TO VERIFY SPRINKLER LINES / MAINS ARE ABOVE 12'-6" A.F.F. RAISE EXISTING SPRINKLER LINES / MAINS TO ABOVE 12'-6" A.F.F., IF REQUIRED.

1 REFLECTED CEILING PLAN

SCALE: 3/16" = 1'-0"

2 LIGHTING FIXTURE SCHEDULE

TYPE	SYMBOL	MANUFACT./CAT. #	DESCRIPTION	MOUNTING TYPE	LAMP(S)	VOLTS	WATTS	REMARKS
A		DAY-BRITE LIGHTING T-2-32-UNV	4' 2- LAMP STRIP SINGLE END WIRED	CEILING MOUNTED	LED T8	277	54	PROVIDED & INSTALLED BY L.L.
AI		DAY-BRITE LIGHTING TIK-6-8-32-UNV/ (2) IK-BF	8' INDUSTRIAL WITH CROSS BAFFLE	CABLE MOUNTED	LED T8	277	102	PROVIDED & INSTALLED BY L.L. AUX. DIM. - SEE ELEC. PLANS FOR WIRING
AIJ		DAY-BRITE TIK-6-8-32-UNV/ (1) IK-BF	4' INDUSTRIAL WITH CROSS BAFFLE	CABLE MOUNTED	LED T8	277	51	PROVIDED & INSTALLED BY L.L. AUX. DIM. - SEE ELEC. PLANS FOR WIRING
A2		DAY-BRITE LIGHTING T1-2-32-UNV	8' 2-LAMP STRIP SINGLE END WIRED	CABLE MOUNTED	LED T8	277	68	PROVIDED & INSTALLED BY L.L. AUX. DIM. - SEE ELEC. PLANS FOR WIRING
A3		DAY-BRITE LIGHTING TT-2-32-UNV	8' 2-LAMP STRIP SINGLE END WIRED	CEILING MOUNTED	LED T8	277	68	PROVIDED & INSTALLED BY L.L. AUX. DIM. - SEE ELEC. PLANS FOR WIRING
B		SENNCO SOLUTION 4-0850-1000-02-00	DUMMY DOME DROP CAMERA	PENDANT MOUNTED	-	-	-	PROVIDED & INSTALLED BY F.B. & INSTALLED BY T.B.C. T.B.C. TO PROVIDE & INSTALL BATTERIES
E	SP		SPEAKER		-	-	-	PROVIDED & INSTALLED BY F.B.
F		EXITRONIX APX1R	UNIVERSAL EXIT LED RED	SURFACE MOUNTED	LED	277	2	PROVIDED & INSTALLED BY L.L.
FL		LOZIER QUICK CONNECT LIGHTS LQLC-3-LED4000	3' OR 4' UNDER SHELF LIGHTING REFER TO PLAN	SURFACE MOUNTED	LED		24	3/FT PROVIDED BY FB & INSTALLED BY T.B.C.
G		SURE-LITE APEL	DUAL HEAD EMERGENCY W/ BATTERY PACK	CEILING MOUNTED (ONE) SEE DETAIL	LED	277	7.8	PROVIDED & INSTALLED BY L.L. SEE DTL. 4/A2.0 FOR MOUNTING
I		GON-TECH LIGHTING RL38-GTR3802-CLR	6" INCANDESCENT RECESSED LIGHT W/REGULATOR & TRIM. CLEAR	RECESSED FIXTURE	ITM PAR 38 LED	120	25	PROVIDED & INSTALLED BY L.L.
J		EXITRONIX LLI2-34-0-W T12I2M	DUAL HEAD REMOTE W/ BATTERY	SURFACE MOUNTED	-	12	12	PROVIDED & INSTALLED BY L.L.
L		COOPER XTOR2R-M	2' FLOOR WALL WASH	SURFACE MOUNTED	LED	277	18	PROVIDED & INSTALLED BY L.L.
LB		MDI WORLDWIDE X-6184BRK-SLM-W	4' FIXTURE LIGHTING SOURCE SECTION	CLIP MOUNTED	LED	120	--	PROVIDED BY F.B. & INSTALLED BY T.B.C.
TT-5		HOUSING: JUNO [illegible]	[illegible] TRACK	THREADED ROD PAINTED P-1	-	-	-	PROVIDED & INSTALLED BY L.L. B.O. TRACK @ 12'-4" A.F.F. U.N.O.
M		EELP XPDH-9-46L-GT	EXTERIOR SCONCE	SURFACE MOUNTED	LED	277	46	PROVIDED & INSTALLED BY L.L.
N		COOPER PR26-30-D010-MW-[illegible]-MD-MW	UNDER CANOPY LIGHT	SURFACE MOUNTED	LED	277	28.5	PROVIDED & INSTALLED BY L.L.
WIFI		CISCO SYSTEMS MR42-HW, MERAKI MR34	WIRELESS NETWORK HARDWARE	WALL MOUNTED, U.N.O. VERTEV -ITH-MW-C-CVR	-	12	-	PROVIDED & INSTALLED BY F.B. B.O. FIXTURE @ 18'-0" A.F.F. U.N.O.
TH		LAMP PHILLIPS TPAR38XS40/40/RS84WH	TRACK HEAD	MOUNTED TO TRACK	LED	120	17	PROVIDED & INSTALLED BY L.L.

NOTE:
LIGHT FIXTURES WILL BE PROCURED THROUGH A NATIONAL LIGHTING PROGRAM WITH VILLA LIGHTING. VILLA-LIGHTING CORPORATE HAS NEGOTIATED DISCOUNTED, BULK PRICING FOR BENEFIT OF ITSM. LANDLORD BUILT PROJECTS NATIONWIDE. PRODUCT WILL BE STOCKED AT VILLA LIGHTING'S DISTRIBUTION CENTER IN ST. LOUIS, MO, AND CAN SHIP WITHIN 48 HOURS OF RELEASE. PLEASE ALLOW A MAXIMUM OF 4-5 DAYS OF TRAVEL AFTER RELEASE. CONTACT MELISSA HABAN AT (314) 638-0424 OR MELISSA.HABAN@VILLALIGHTING.COM

3 SHEET NOTES

1. THE ELECTRICAL DRAWINGS ARE A DIAGRAMMATIC REPRESENTATION OF THE WORK TO BE ACCOMPLISHED AND AS SUCH SHOULD NOT BE INTERPRETED TO INDICATE ANY WORK, EQUIPMENT OR MATERIAL THAT IS CONTRARY TO THE N.E.C., OR ANY OTHER GOVERNING CODES OR ORDINANCES.
2. MAIN METERING AND DISTRIBUTION GEAR SHALL COMPLY WITH SERVING UTILITY COMPANY, N.E.C., U.L. AND ALL LOCAL GOVERNING AGENCIES PRIOR TO INSTALLATION OF SAID EQUIPMENT.
3. ELECTRICAL WORK SHALL COMPLY WITH ALL N.E.C., U.L. AND ALL OTHER LOCAL GOVERNING ORDINANCES AND CODES HAVING LEGAL JURISDICTION.
4. THE ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR OBTAINING AND PAYING FOR ANY REQUIRED PERMITS, ETC.
5. THE ELECTRICAL CONTRACTOR SHALL VERIFY THE EXACT LOCATIONS OF SERVICING POINTS WITH THE SERVING VOLTAGE REQUIREMENTS AND NOTIFY ALL TRADES OF SERVING VOLTAGE.
6. ALL SYSTEMS AND EQUIPMENT GROUNDS SHALL BE INSTALLED IN STRICT ACCORDANCE WITH ALL CODE REQUIREMENTS.
7. THE ELECTRICAL CONTRACTOR SHALL VERIFY THE EXACT LOCATIONS OF ALL H.V.A.C. EQUIPMENT AND SHALL FURNISH AND INSTALL ALL CONDUCTORS AND CONDUIT TO ALL EQUIPMENT AND CONTROLS. CONTRACTOR SHALL MAKE ALL NECESSARY CONNECTIONS AS REQUIRED FOR A COMPLETE WORKING SYSTEM. CONTRACTOR SHALL VERIFY ALL SIZES AND ELECTRICAL REQUIREMENTS PRIOR TO INSTALLATION.
8. THE ELECTRICAL CONTRACTOR SHALL SUBMIT (3) COPIES OF THE SHOP DRAWINGS AND MATERIAL LISTS TO THE ELECTRICAL DESIGNER PRIOR TO INSTALLATION.
9. CONTRACTOR SHALL VERIFY INTERRUPTING CAPACITIES WITH SERVING UTILITY COMPANY AND PROVIDE ALL SWITCH GEAR AS REQUIRED FOR THEIR DRAWINGS.
10. CONTRACTOR SHALL VERIFY AND INCLUDE IN BID ALL SERVICE COSTS THAT MAY BE REQUIRED BY SERVING UTILITY COMPANY.
11. CONTRACTOR SHALL VERIFY THE EXACT LOCATION OF ALL MECHANICAL EQUIPMENT AND CONTROL WIRING WITH MECHANICAL CONTRACTOR.
12. CONTRACTOR SHALL VERIFY THE SIZE, AMOUNT, AND LOCATION OF ALL PRIMARY AND SECONDARY CONDUIT WITH THE LOCAL SERVICING UTILITY.
13. CONTRACTOR SHALL VERIFY WITH THE SERVING UTILITY THE LOCATION, SIZE, AND MINIMUM CLEARANCE REQUIREMENTS FOR ALL TRANSFORMERS OR SIMILAR EQUIPMENT.
14. THE CONTRACTOR SHALL PROVIDE AND INSTALL STARTER AND/OR DISCONNECTS ON ALL EQUIPMENT WITHOUT FACTORY MOUNTED SAFETY DEVICES AND SHALL BE RESPONSIBLE IN ACCORDANCE WITH MANUFACTURERS INSTRUCTIONS. THIS EQUIPMENT INCLUDES BUT FOR FLEX CONNECTIONS TO ALL EQUIPMENT FROM J-BOXES AS INDICATED ON PLANS IS NOT LIMITED TO ALL MOTORS, CONTROLLERS, AND PILOT DEVICES AS SUPPLIED BY OTHERS.
15. ALL WIRE #10 AND LARGER SHALL BE COPPER THN RATED 75#
16. ALL WIRE SMALLER THAN #10 SHALL BE COPPER THN RATED 60#
17. FUSES AND CIRCUIT BREAKERS SHALL COMPLY WITH SERVING UTILITY COMPANY INTERRUPTING CAPACITY REQUIREMENTS.
18. TELEPHONE SYSTEM IS SCHEMATIC ONLY AND SHALL BE INSTALLED PER OWNERS REQUIREMENTS.
19. MOUNT ALL SWITCHES AT 48" A.F.F. UNLESS OTHERWISE NOTED.
20. MOUNT ALL WALL OUTLETS AT 15" A.F.F. UNLESS OTHERWISE NOTED.
21. BREAKERS IN ALL SUB-PANELS SHALL BE U.L. RATED FOR A MINIMUM OF 10,000 AMPS ICA OR PER SERVING UTILITY COMPANY.
22. PLASTIC PIPE APPROVED FOR UNDERGROUND USE MAY BE USED WHERE ALLOWED BY GOVERNING BUILDING AUTHORITY.
23. SEE 'E' SHEETS FOR ADDITIONAL INFORMATION AND SPECIFICATIONS APPLICABLE TO THE ELECTRICAL WORK.
24. G.C. TO KEEP ONE (1) SEALED CASE & REMINDER OF LAST OPEN CASE OF LAMPS TO BE LEFT IN STOCKROOM.

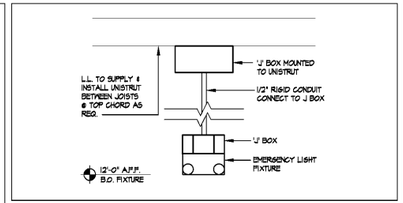

4 EMERGENCY LIGHT DTL.

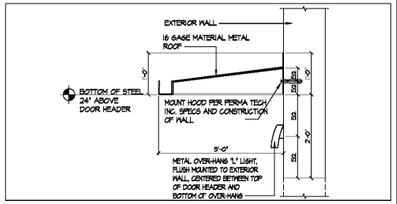

5 REAR HOOD

3/4"=1'0"

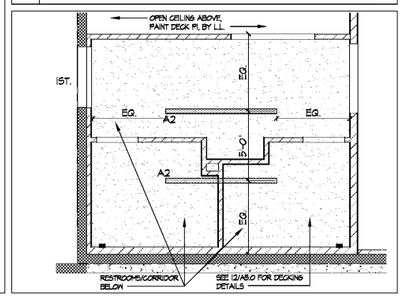

6 DECKING LIGHT DTL.

SCALE: 1/4"=1'0"

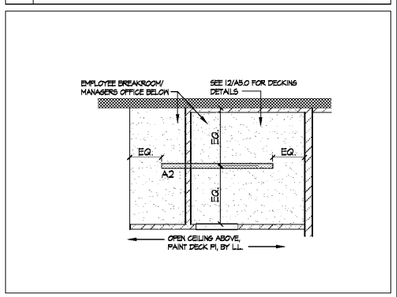

7 DECKING LIGHT DTL @ MGR

SCALE: 1/4"=1'0"

Click Plans @ www.LDLine.com

FREDERICK J. GOGLIA
ARCHITECT NCARB, RDI
1850 CRAIG ROAD, SUITE 200 ST. LOUIS, MO 63146
PH: (314) 485-2400 FAX (314) 485-2300 www.arcx.com

ENGINEER

ARCHITECTURAL SEAL

DATE ISSUE

DATE	REVISION	NAM
05/24/19	LANDLORD COMMENTS	
05/17/19	PERMIT / OWNER	

PROJECT NAME / LOCATION

five BELOW

THE PROMENADE
3942 PROMENADE PARKWAY
D'IBERVILLE, MS 39540

PROJECT INFORMATION

DATE: APRIL 26, 2019
PROJECT NO. 190219
DELIVERY TYPE: V-BOX

DRAWN: BLH
CHECKED: TMG

SHEET TITLE / NUMBER

REFLECTED CEILING PLAN

A2.0