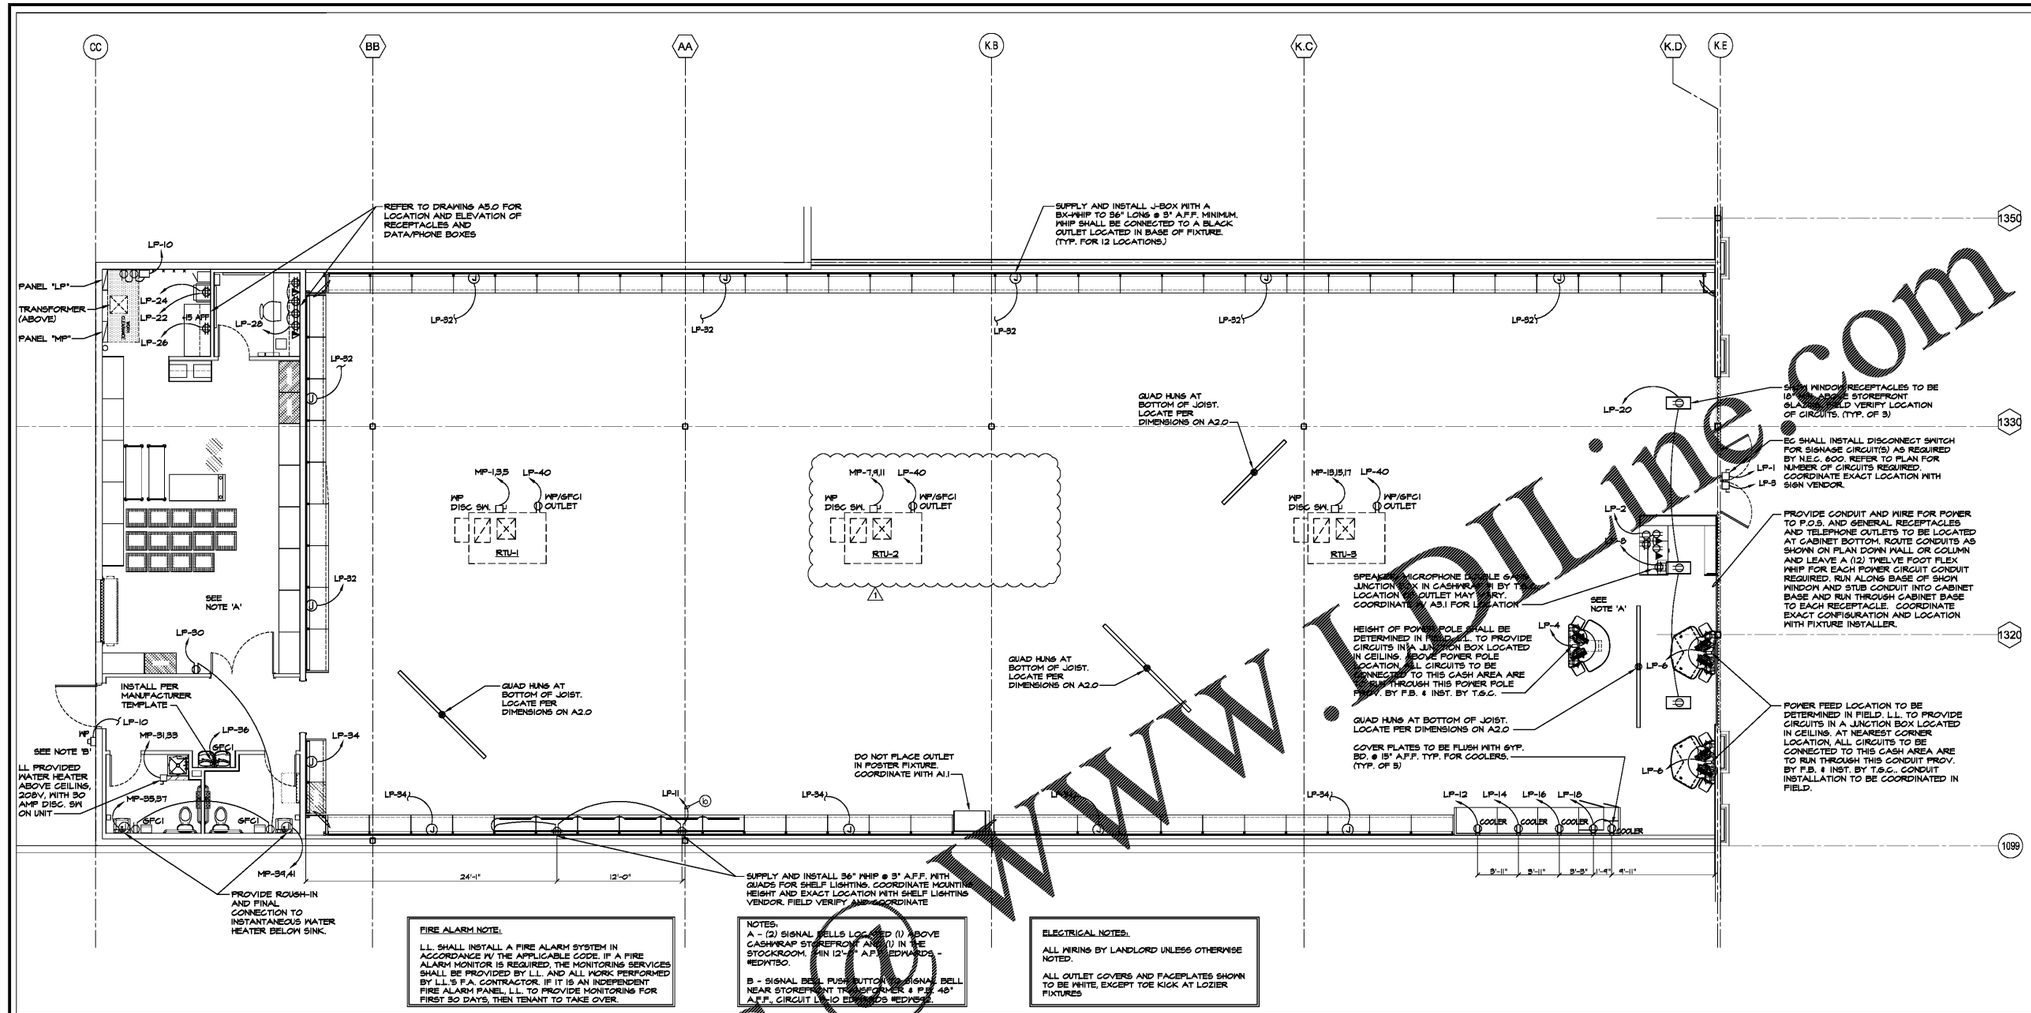

FIRE ALARM NOTE:

LL. SHALL INSTALL A FIRE ALARM SYSTEM IN ACCORDANCE W/ THE APPLICABLE CODE. IF A FIRE ALARM MONITOR IS REQUIRED, THE MONITORING SERVICES SHALL BE PROVIDED BY L.L. AND ALL WORK PERFORMED BY L.L.'S F.A. CONTRACTOR. IF IT IS AN INDEPENDENT FIRE ALARM PANEL, L.L. TO PROVIDE MONITORING FOR FIRST 30 DAYS, THEN TENANT TO TAKE OVER.

NOTES:

A - (2) SIGNAL BELLS LOCATED (1) ABOVE CASHWRAP STOREFRONT AND (1) IN THE STOCKROOM. SIM 12"x6" A.F.F. EDWARDS - #EDW730.

B - SIGNAL BELL PUSH BUTTON (SIGNAL BELL NEAR STOREFRONT TRANSFORMER 4 P.D. 48" A.F.F., CIRCUIT LOOP EDWARDS #EDW938.

ELECTRICAL NOTES:

ALL WIRING BY LANDLORD UNLESS OTHERWISE NOTED.

ALL OUTLET COVERS AND FACEPLATES SHOWN TO BE WHITE, EXCEPT TOE KICK AT LOZIER FIXTURES

1 ELECTRICAL POWER PLAN

SCALE: 3/16" = 1'-0"

A ELECTRICAL LEGEND

- CONDUIT RUN CONCEALED IN CEILING OR WALLS OR RUN EXPOSED IN NON CEILING AREAS
- RIGID CONDUIT RUN UNDER OR IN FLOOR SLAB
- 12 VOLT DC EMERGENCY WIRING, 2 #10 AWG
- A–1 HOME RUN TO PANELBOARD, "A" INDICATES PANEL & "1" INDICATES CIR. NO. (2 #12 PLUS EQUIPMENT GROUNDING CONDUCTOR)
- DUPLEX RECEPTACLE, 20A-125 VOLT, HUBBELL #5362, 15" AFF UNLESS NOTED
- GFCI DUPLEX OUTLET WITH GROUND FAULT INTERRUPTER
- DOUBLE DUPLEX RECEPTACLE @ NEMA 5-15R
- SINGLE POLE WALL SWITCH
- SHOW WINDOW RECEPTACLE TO BE RECESSED ON WALL. RECEPTACLE TO BE MOUNTED WITHIN 18" OF THE TOP OF A SHOW WINDOW
- J JUNCTION BOX
- DISCONNECT SWITCH, NON FUSED UNLESS OTHERWISE NOTED
- PANELBOARD
- PUSHBUTTON
- TELEPHONE OUTLET, PROVIDE CONDUIT AND FULL WIRE TO BACKBOARD
- DATA OUTLET
- TELEPHONE DATA OUTLET
- SDT SMOKE DETECTOR TEST
- T T THERMOSTAT. REFER TO MECHANICAL DRAWINGS FOR MORE INFO.
- (E) EXISTING TO REMAIN
- (E/R) (R) EXISTING RELOCATED

B SEC. @ PERIMETER SHELVING

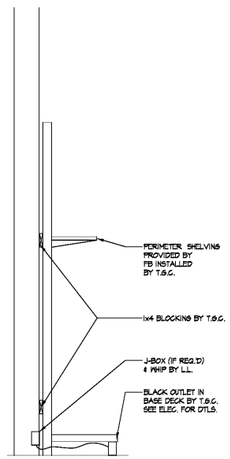

Order Plans @ www.IDLine.com

FREDERICK J. GOGLIA
ARCHITECT, NCARB, RDI
3850 CHAO ROAD, SUITE 300
PH: (314) 416-5600
ST. LOUIS, MO 63146
FAX (314) 416-2000
www.fjgarch.com

ENGINEER

ARCHITECTURAL SEAL

DATE ISSUE

	DATE	REVISION	NAME
1	05/24/19	LANDLORD COMMENTS	CW
	05/17/19	PERMIT / OWNER	

PROJECT NAME / LOCATION

five BELOW

THE PROMENADE
3942 PROMENADE PARKWAY
D'IBERVILLE, MS 39540

PROJECT INFORMATION

DATE: APRIL 26, 2019
PROJECT NO. 190219
DELIVERY TYPE: V-BOX

DRAWN: PB
CHECKED: TJ

SHEET TITLE / NUMBER

POWER PLAN

E1.0