

TRAVEL DISTANCE SCHEDULE		
PATH ID	PER TABLE 1017.2 DISTANCE (FT) < 250'	
T1	132	
T2	140	
T3	151	
T4	163	

ROOM MATRIX - 1ST FLOOR		
Name	Count	
QUEST ROOM - ADA		
KING STUDIO ADA (RIS)	1	
KING SUITE ADA (RIS)	1	
7		
QUEST ROOM - KING STUDIO		
KING STUDIO	9	
KING STUDIO COVN	1	
10		
QUEST ROOM - KING SUITE		
KING SUITE END UNIT	2	
2		
14		

ROOM MATRIX - TOTAL		
Name	Count	
QUEST ROOM - ADA		
DBL QUEEN STUDIO ADA (TUB)	2	
KING STUDIO ADA (RIS)	1	
KING STUDIO ADA (TUB)	1	
KING SUITE ADA (RIS)	1	
KING SUITE ADA (TUB)	2	
7		
QUEST ROOM - DBL QUEEN STUDIO		
DBL QUEEN STUDIO	9	
DBL QUEEN STUDIO COVN	3	
DBL QUEEN STUDIO LG	3	
DBL QUEEN STUDIO LG COVN	1	
16		
QUEST ROOM - KING STUDIO		
KING STUDIO	63	
KING STUDIO COVN	10	
KING STUDIO WIDE	2	
75		
QUEST ROOM - KING SUITE		
KING SUITE	1	
KING SUITE END UNIT	8	
9		
107		

ADA ROOM SCHEDULE		
INDICATES ADA ACCESSIBLE GUESTROOMS	LEVEL 1 = 2	LEVEL 2 = 3
	LEVEL 3 = 2	LEVEL 4 = 0*
PER 2015 IBC TABLE 1107.6.1:		
(1) TOTAL = 7 (1) REQUIRED, (7) PROVIDED		
(2) ROLL-IN SHOWERS REQUIRED, (2) PROVIDED		
INDICATES COMMUNICATION FEATURES	LEVEL 1 = 2	LEVEL 2 = 5
	LEVEL 3 = 5	LEVEL 4 = 0*
PER ADA 2010 TABLE 224.4:		
TOTAL = 11 (2) REQUIRED, (12) PROVIDED		
*PER 1009.2.1, IN BUILDINGS WHERE A REQUIRED ACCESSIBLE FLOOR IS FOUR OR MORE STORES ABOVE OR BELOW A LEVEL OF EXIT DISCHARGE, NOT LESS THAN ONE REQUIRED ACCESSIBLE MEANS OF EGRESS SHALL BE AN ELEVATOR COMPLYING WITH SECTION 1009.4. ADA ROOMS ARE DISTRIBUTED ON FLOORS 1-3 ONLY; THEREFORE, SECTION 1009.2.1 AND 1009.4 IS NOT REQUIRED.		


- LIFE SAFETY LEGEND:**
- SMOKE PARTITION, NO HOURLY RATING REQUIRED, OPENINGS REQUIRE PROTECTION: DOORS PER TABLE 716.5 AND WINDOWS PER TABLE 716.6.
 - 1/2 HR RATED FIRE PARTITION REQUIRED, 1-HR PROVIDED, OPENINGS REQUIRE PROTECTION: DOORS PER TABLE 716.5 AND WINDOWS PER TABLE 716.6.
 - 1-HR RATED FIRE BARRIER OPENINGS REQUIRE PROTECTION: DOORS PER TABLE 716.5 AND WINDOWS PER TABLE 716.6.
 - 1-HR RATED FIRE RATED STRUCTURE ONLY, OPENINGS DO NOT REQUIRE PROTECTION PER TABLE 705.8 AT EXTERIOR WALLS AND 502.1 WHICH STATES, "THE PROTECTION OF OPENINGS, DUCTS, AND AIR TRANSFER OPENINGS IN BUILDING ELEMENTS SHALL NOT BE REQUIRED UNLESS REQUIRED BY OTHER PROVISIONS OF THE CODE." OPENINGS IN BEARING WALLS SHALL BE PROTECTED IF THE BEARING WALL IS ALSO SERVING ANOTHER PURPOSE AS A FIRE PARTITION, FIRE BARRIER, OR FIRE WALL.
 - 2-HR RATED FIRE BARRIER OPENINGS REQUIRE PROTECTION: DOORS PER TABLE 716.5 AND WINDOWS PER TABLE 716.6.
 - NOTE: STENCIL THE FOLLOWING NOTE AT THE PLENUM SPACE ON BOTH SIDES OF THE RATED FIRE PARTITIONS, FIRE BARRIERS, AND FIRE WALLS WITH PERMANENT PAINT, "1-HR PROTECT ALL OPENINGS BOTH SIDES OF WALL." NOTES SHALL BE PLACED AS NECESSARY FOR CLEAR VISIBILITY AND WITHIN 15 FEET OF EACH WALL AND AT INTERVALS NOT EXCEEDING 30 FEET MEASURED PERPENDICULARLY ALONG WALL OR PARTITION WITH 3-INCH HIGH LETTERS AND EACH WALL STRONG BLANK WITH 1/2, 1, OR 2 AS INDICATED BY LIFE SAFETY TAGS.
 - TRAVEL DISTANCE, SEE SCHEDULE FOR TOTAL DISTANCES.
 - DIRECTION OF EGRESS.
 - NUMBER OF OCCUPANTS, "P" SCHEDULE INDICATES "PANIC HARDWARE" REQUIRED PER SCHEDULE.
 - MINIMUM NUMBER OF OCCUPANTS PER EGRESS.
 - SPRINKLERED BUILDINGS: 1/2 INCH PER WIDTH OF DOOR EGRESS COMPONENT OR 1/4 INCH PER WIDTH OF STAIR COMPONENT.
 - NON-SPRINKLERED AREAS: 3/4 INCH PER WIDTH OF DOOR EGRESS COMPONENT OR 1/2 INCH PER WIDTH AT STAIR COMPONENT.
 - SPECIAL CONDITION DOORS REQUIRING "PANIC HARDWARE".
 - EXIT SIGN, SHADED AREA INDICATES VIEWABLE DIRECTION AND ARROW. IF SHOWN, INDICATES ADDITIONAL DIRECTIONAL SIGNAGE REQUIREMENT. FOR EACH EXIT SIGN REQUIRED, PROVIDE ONE SIGN AT THE CEILING OR MOUNTED HIGH ON THE WALL 8' A.F.F. MIN. AND ONE SIGN DOWN LOW BETWEEN 1' AND 12' A.F.F. FLUSH MOUNTED AND WITHIN 4' OF LATCH SIDE OF DOOR.
 - EX-100: EXISTING CLOSET, SEMI-RECESSED 1/2-HR, 1-HR PROVIDED RATED CABINET, PROVIDE SIGN TYP. S-F-F.
 - INDICATES ELEVATOR CAR TO ACCOMMODATE AMBULANCE STRETCHER, THE ELEVATOR CAR SHALL BE OF SUFFICIENT ARRANGEMENT TO ACCOMMODATE AN AMBULANCE STRETCHER 24-INCHES BY 84-INCHES WITH NO LESS THAN 5-INCH RADIUS CORNERS, IN THE HORIZONTAL OPEN POSITION AND SHALL BE IDENTIFIED BY THE INTERNATIONAL SYMBOL FOR EMERGENCY MEDICAL SERVICES (STAR OF LIFE). THE SYMBOL SHALL NOT BE LESS THAN 3-INCHES HIGH AND SHALL BE PLACED INSIDE ON BOTH SIDES OF THE HOISTWAY DOOR FRAME.
 - BUILDING TUBE STEEL COLUMNS: GYPSUM WALL BOARD FIRE RATED WRAP DESIGNATION TAG AS INDICATED.
 - XXX: TOTAL GYPSUM WALL BOARD THICKNESS PER UL X528 HOURLY RATING.




Ragona Architecture & Design, PLLC
145A Scalespark Road, Charlotte, NC 28209
T: 704.372.0116 www.rad-arch.com



HOME 2 SUITES BELMONT
HAWLEY AVE
BELMONT, NC 28012



Revisions		
#	Date	Description

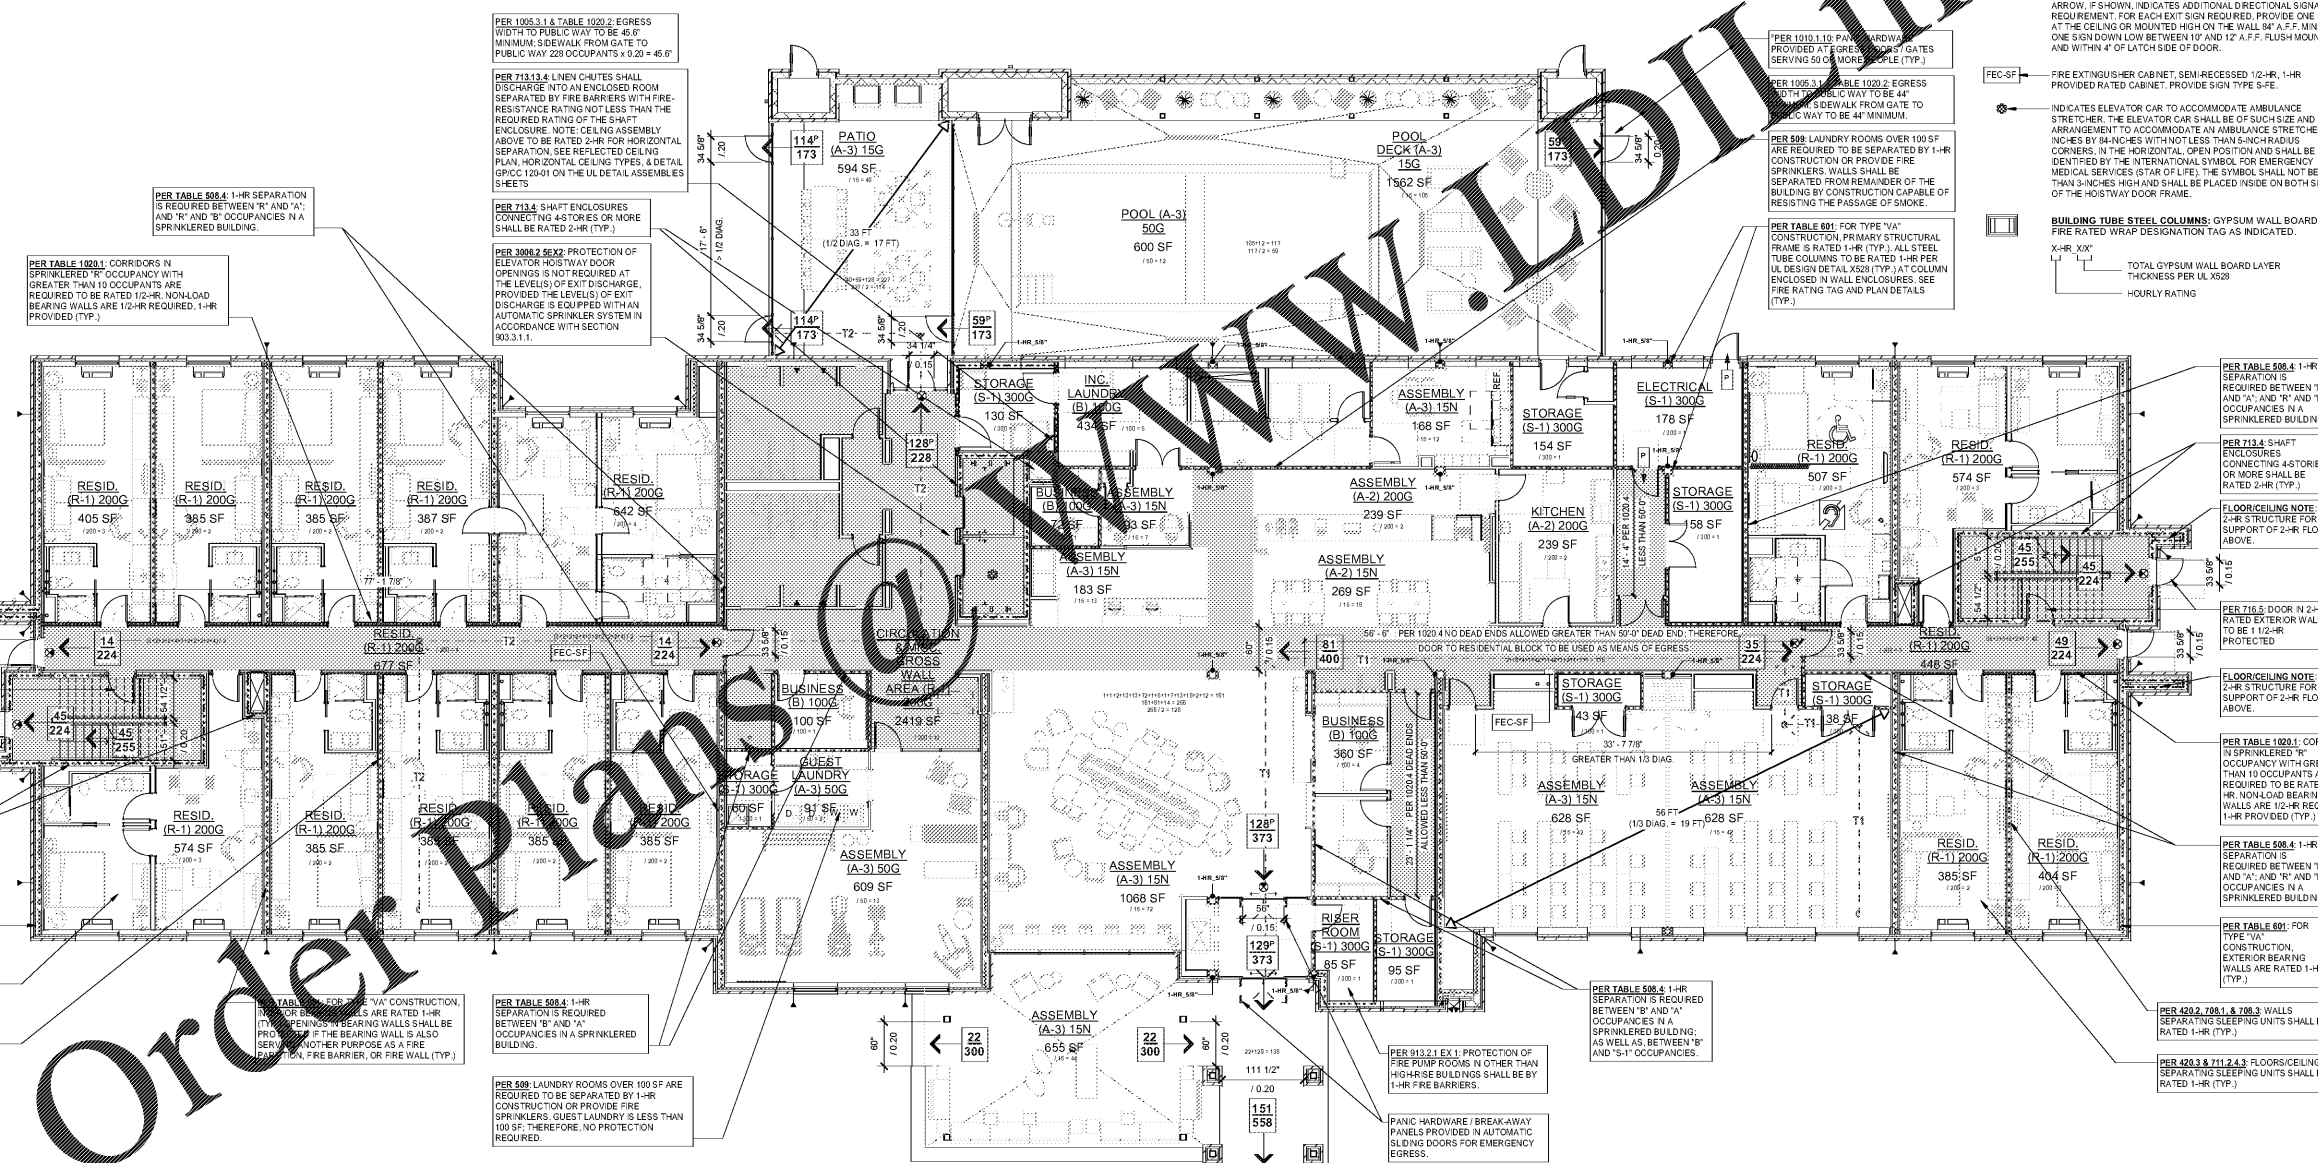

1 FIRST FLOOR LIFE SAFETY PLAN
SCALE: 1/8" = 1'-0"

KNOWBOX NOTE: GENERAL CONTRACTOR SHALL COORDINATE WITH THE FIRE CODE OFFICIAL FOR KEY BOX TO BE INSTALLED IN AN APPROVED LOCATION. THE KEY BOX SHALL BE OF AN APPROVED TYPE LISTED IN ACCORDANCE WITH UL 1037, AND SHALL CONTAIN KEYS TO GAIN NECESSARY ACCESS AS REQUIRED BY THE FIRE CODE OFFICIAL. GENERAL CONTRACTOR SHALL CONTACT THE FIRE CODE OFFICIAL FOR INFORMATION REGARDING THE REQUIRED KEY BOX.