



1 ENLARGED PUBLIC AREA POWER PLAN
E-304 SCALE: 1/4" = 1'-0"

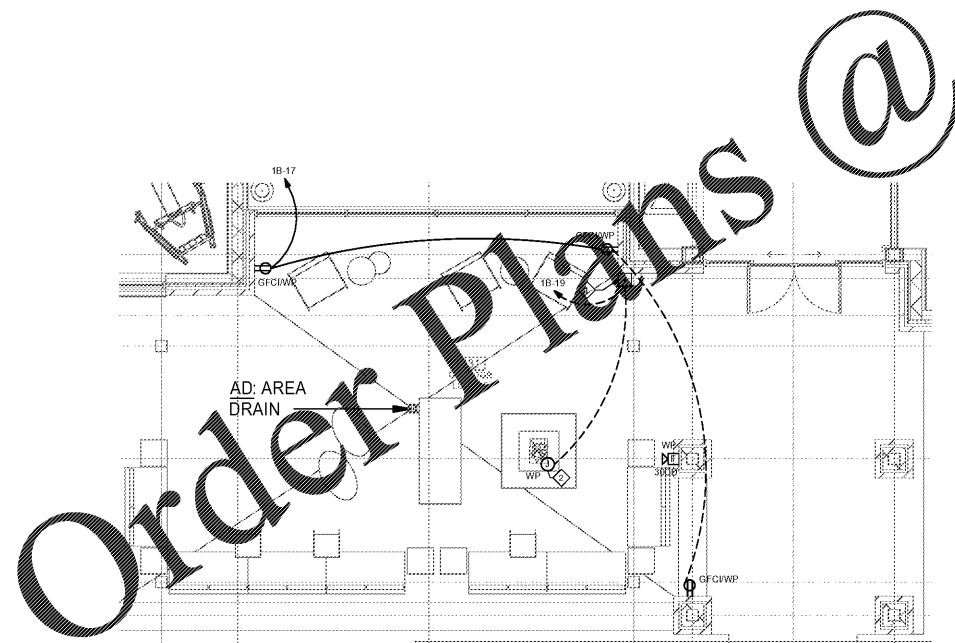

2 ENLARGED PUBLIC AREA POWER PLAN
E-304 SCALE: 1/4" = 1'-0"

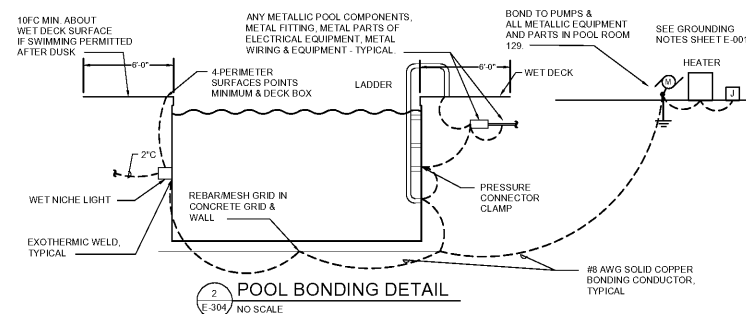

2 POOL BONDING DETAIL
E-304 NO SCALE

KEYED NOTES THIS SHEET

- CONTRACTOR TO PROVIDE AND INSTALL GAS SHUT-OFF SWITCH WITH WEATHERPROOF ENCLOSURE. PROVIDE PHENOLIC LABEL INDICATING GAS SHUT-OFF. COORDINATE LOCATION WITH AHJ AND PLUMBING CONTRACTOR PRIOR TO ROUGH-IN WORK. PROVIDE AND CONNECT SOLENOID VALVE AND WIRE TO SHUNT TRIP BREAKER AS REQUIRED FOR OPERATION.
- COORDINATE WITH GRILL/FIRE PLACE CONNECTION. PROVIDE HEAT DETECTOR IF USED FOR CHEMICAL STORAGE.
- COORDINATE WET NICHE LOCATION WITH POOL SHOP DRAWINGS. PROVIDE 2" CONDUIT FOR EACH NICHE LOCATION.
- PROVIDE #8AWG CU GROUNDING GRID TO ALL METALLIC COMPONENTS. SEE POOL NOTES AND DETAIL FOR REQUIREMENTS.
- EMERGENCY POOL SHUT-OFF. NEMA-3R RATED. EC TO PROVIDE AND INSTALL AT 48" AFF. SHUNT TO POOL PUMP. COORDINATE LOCATION WITH AHJ HOUSE/EMERGENCY PHONE. VERIFY LOCATION WITH AHJ AND POOL DRAWINGS. 48" AFF.
- COORDINATE WITH POOL EQUIPMENT DRAWINGS PRIOR TO ANY ROUGH-IN WORK. CIRCUITS FOR ALLOCATION PURPOSES ONLY.