


THIS SHEET PLOTS ON 22" x 34" ANSID 0 1/2" = 1" 3/4" 2" 3"

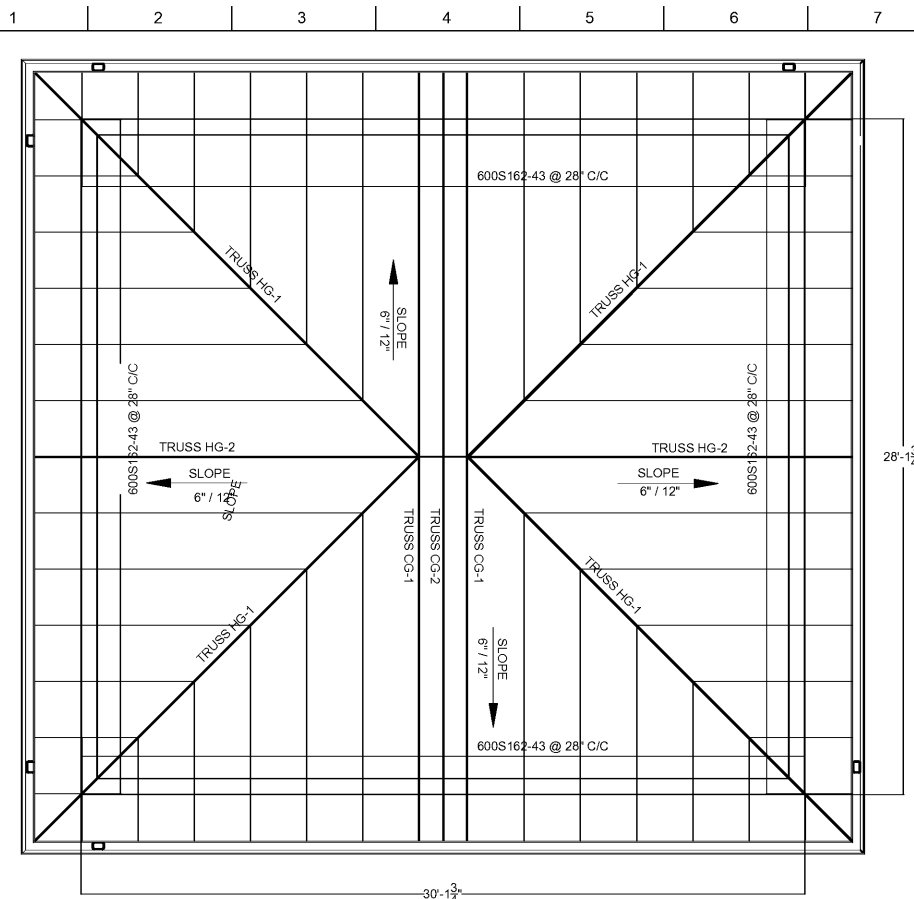


Light Steel Framing

ABBREVIATED TERMS
 CMU = CONCRETE MASONRY UNIT
 EA = EACH
 EIFS = EXTERIOR INTERROGATED FINISH SYSTEM
 W= WITH
 @ = AT
 Lg = LONG
 P.A.F. = POWDER ACTUATED FASTENERS
 V.I.F. = VERIFY IN FIELD
 dia = DIAMETER
 DIM = DIMENSION
 B.O. = BY OTHER
 WF = WIDE FLANGE
 F.H.S. = FULL HEIGHT STUD
 REF = REFERENCE
 ARCH = ARCHITECT
 T.O.D. = TOP OF DECK
 T.O.S. = TOP OF STEEL
 T.O.F.F. = TOP OF FINISH FLOOR SPECIFICATION FOR LIGHT WEIGHT STEEL FRAMING

- ASTM STANDARDS**
- 1) STANDARD SPECIFICATION FOR STEEL SHEET, ZINC-COATED (GALVANIZED) BY THE HOT-DIP PROCESS, STRUCTURAL (PHYSICAL) QUALITY
 - 2) STANDARD SPECIFICATION FOR THE APPLICATION AND FINISHING OF GYPSUM BOARD
 - 3) STANDARD SPECIFICATION FOR THE INSTALLATION OF INTERIOR LATHING, FURRING
 - 4) STANDARD SPECIFICATION FOR THE APPLICATION OF INTERIOR GYPSUM PLASTER
 - 5) STANDARD SPECIFICATION FOR THE APPLICATION OF PORTLAND CEMENT BASED PLASTER
 - 6) STANDARD SPECIFICATION FOR STEEL DRILL SCREWS FOR THE APPLICATION OF GYPSUM BOARD OR METAL PLASTER BASES TO STEEL STUDS FROM 0.033 IN. TO 0.112 IN. THICKNESS
 - 7) STANDARD SPECIFICATIONS FOR LOAD BEARING (TRANSVERSE AND AXIAL) STEEL STUDS, RUNNERS (TRACK) AND BRACING OR BRIDGING FOR SCREW APPLICATION OF GYPSUM BOARD AND METAL PLASTER BASES
 - 8) STANDARD SPECIFICATION FOR THE INSTALLATION OF LOAD BEARING (TRANSVERSE AND AXIAL) STEEL STUDS AND RELATED ACCESSORIES
- REFERENCES:**
- 9) AMERICAN IRON AND STEEL INSTITUTE (AISI) COLD-FORMED STEEL DESIGN MANUAL, LATEST EDITION, 1989 ADDENDUM
 - 10) AMERICAN WELDING SOCIETY (AWS) STRUCTURAL WELDING CODE (D1.1) SPECIFICATION FOR WELDING SHEET STEEL IN STRUCTURES (E1.3)
 - 11) MILITARY SPECIFICATION (MIL SPEC) M-LP-21035 PAINT, HIGH ZINC DUST CONTENT, GALVANIZING REPAIR
 - 12) FEDERAL SPECIFICATIONS (FED SPEC) FF-P-305, PIN, DRIVE, GUIDED AND PIN DRIVE, POWER ACTUATED (FASTENERS FOR POWER ACTUATED AND HAND ACTUATED FASTENING TOOLS) FF-S-325, SHELD, EXPANSION, NAIL, EXPANSION, AND NAIL, DRIVE SCREW (DEVICES, ANCHORING MASONRY)

- MATERIALS:**
- 13) ALL STUDS AND ACCESSORIES SHALL BE OF THE TYPE, SIZE, STEEL THICKNESS AND SPACING SHOWN ON THE PLANS. STUDS, RUNNERS (TRACK), BRACING AND BRIDGING SHALL BE MANUFACTURED PER THE SPECIFICATION C-655
 - 14) ALL GALVANIZED STUDS AND ACCESSORIES, (156" HIGH) 18GA. OR HEAVIER, SHALL BE FORMED FROM STEEL THAT CONFORMS TO THE REQUIREMENTS OF ASTM A-653 WITH A YIELD OF 50 KSI AND A TENSILE OF 60 KSI. THE AISI "SPECIFICATION FOR THE DESIGN OF COLD-FORMED STEEL STRUCTURAL MEMBERS", LATEST EDITION (1989 ADDENDUM)
 - 15) ALL GALVANIZED STUDS AND ACCESSORIES, (204" HIGH) 18GA., 20 OR LESS, SHALL BE FORMED FROM STEEL THAT CONFORMS TO THE REQUIREMENTS OF ASTM A-653 OR EQUIV. WITH A YIELD OF 33 KSI AND A TENSILE OF 45 KSI. THE AISI "SPECIFICATION FOR THE DESIGN OF COLD-FORMED STEEL STRUCTURAL MEMBERS", LATEST EDITION (1989 ADDENDUM)
 - 16) ALL GALVANIZED STUDS AND ACCESSORIES, 20GA., SHALL BE FORMED FROM STEEL THAT CONFORMS TO THE REQUIREMENTS OF ASTM A-653, WITH A YIELD OF 33 KSI AND A TENSILE OF 45 KSI. THE AISI "SPECIFICATION FOR THE DESIGN OF COLD-FORMED STEEL STRUCTURAL MEMBERS", LATEST EDITION (1989 ADDENDUM)
 - 17) ALL GALVANIZED STUDS AND ACCESSORIES SHALL HAVE A MINIMUM G-60 COATING
 - 18) PHYSICAL PROPERTIES AND ALLOWABLE LOAD CAPABILITIES OF MEMBERS SHALL BE DEVELOPED IN ACCORDANCE WITH AISI "SPECIFICATION FOR THE DESIGN OF COLD-FORMED STEEL STRUCTURAL MEMBERS", LATEST EDITION (1989 ADDENDUM)
 - 19) IN ACCORDANCE WITH AISI RIGID COLLATERAL FACING MATERIAL ATTACHED TO NON BEARING WALLS MAY BE CONSIDERED AS ADOPTIVE MEANS AGAINST ROTATION
 - 20) PERFORATIONS WILL BE ALLOWED IN WEB OF STUDS ONLY, AT A MINIMUM EDGE DISTANCE OF 2'-0", A MINIMUM OF 4'-0" ON CENTER. STRICTLY ACCORDANCE WITH THE AISI "COLD-FORMED STEEL DESIGN MANUAL", 1989 ADDENDUM

- EXECUTION**
- 21) PRODUCTS SHALL BE PROTECTED FROM CONDITIONS THAT MAY CAUSE ANY PHYSICAL DAMAGE
 - 22) MATERIALS SHALL BE STORED ON A FLAT PLANE
 - 23) IT SHALL BE THE RESPONSIBILITY OF THE PROJECT ARCHITECT OR ENGINEER OR THE QUALIFIED PERSONNEL TO EXAMINE WHAT IS DAMAGE (E.G. RUSTED, DENTED, BENT OR TWISTED). ANY DAMAGED MATERIALS SHALL BE REMOVED FROM THE JOB SITE IMMEDIATELY
- INSTALLATION - GENERAL**
- 24) METHODS OF CONSTRUCTION MAY BE EITHER PIECE (STICK-BUILT) OR FABRICATION INTO PANELS (PRE-FABRICATED) OR OFF SITE
 - 25) CONNECTIONS SHALL BE ACCOMPLISHED WITH SELF-DRILLING SCREWS OR WELDS PER FLANGE TO THE TRACKS
 - 26) TRANSVERSELY LOADED STUDS NEED NOT BE SQUARELY INSTALLED TO TRACKS UNLESS SPECIFICALLY NOTED OTHERWISE
 - 27) AXIALLY LOADED STUDS SHALL BE INSTALLED SQUARELY WITHIN THE TRACKS. TRACKS SHALL REST ON A CONTINUOUS, UNIFORM BEARING SURFACE
 - 28) CUTTING OF STEEL FRAMING MEMBERS MAY BE ACCOMPLISHED WITH ANY TYPE OF TORCH CUTTING OF LOAD BEARING MEMBERS IS NOT PERMITTED. CUTTING OF LOADED MEMBERS IS NOT PERMITTED UNLESS UNDER SUPERVISION OF THE PROJECT ENGINEER
 - 29) UTILIZE TEMPORARY BRACING AS REQUIRED AND KEEP IN PLACE UNTIL PERMANENT BRACING IS PERMANENTLY STABILIZED
 - 30) BRIDGING SHALL BE OF SIZE AND TYPE SHOWN ON THE ATTACHED SCHEDULES
 - 31) DIAPHRAGM RATED SHEATHING MATERIAL MAY BE SUBSTITUTED FOR BRIDGING AT NON BEARING WALLS ONLY, HOWEVER, IT SHALL BE INSTALLED PRIOR TO LOADING THE WALL
 - 32) INSTALL HEADERS IN ALL AXIALLY LOADED WALLS THAT ARE LARGER THAN THE STUD SPACING IN THAT WALL. FORM HEADERS AS SHOWN ON THE DRAWINGS
 - 33) INSULATION EQUAL TO JOB REQUIREMENTS SHALL BE INSTALLED INTO ALL JAMBS, HEADERS, AND POST TYPE CONDITIONS THAT WILL BE INACCESSIBLE AFTER THEIR INSTALLATION INTO THE WALL
 - 34) PROVIDE JACK STUDS SUPPORT UNDER HEADERS. THESE STUDS SHALL BE CONNECTED TO THE HEADER AND MUST SEAT SQUARELY IN THE LOWER TRACK OF THE WALL, AND BE PROPERLY ATTACHED TO IT
 - 35) IF BY DESIGN HEADERS ARE ALLOWED TO BE SMALLER THAN FULL-HEIGHT STUDS (CRPPLES) THAT OCCUR OVER THE HEADER SHALL BE DESIGNED TO CARRY ALL IMPOSED LOADS
 - 36) WALL TRACKS SHALL NOT BE USED TO SUPPORT VERTICAL LOADS UNLESS SPECIFICALLY DESIGNED FOR THAT PURPOSE
 - 37) ALL AXIALLY LOADED MEMBERS SHALL BE ALIGNED VERTICALLY ALONG THE WEB AND FLANGES. TO ALLOW FOR FULL TRANSFER OF THE LOADS DOWN TO THE FOUNDATION. VERTICAL ALIGNMENT SHALL BE MAINTAINED AT ALL LEVELS. IF SPECIFICATION INCLUDES FINISHES FOR CLIPS, ACCESSORIES, ETC., DELETE OR VERIFY THAT SPECIFIED FINISHES DO NOT CONFLICT WITH GALVANIZED COATING SPECIFIED ABOVE
 - 38) REINFORCEMENT SHALL BE WITHIN LIMITATIONS OF THE PRODUCT AND ITS DESIGN. PROVIDE REINFORCEMENT WHERE HOLES ARE CUT THROUGH LOAD BEARING MEMBERS IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS AND APPROVED BY PROJECT ARCHITECT OR ENGINEER
 - 39) TOUCH UP ALL STEEL BARED BY WELDING USING ZINC RICH PAINT
 - 40) STUDS SHALL BE SPACED TO SUIT THE DESIGN REQUIREMENTS AND LIMITATIONS OF COLLATERAL FACING MATERIAL
 - 41) GYPSUM BOARD SHALL BE ATTACHED TO STEEL STUDS IN ACCORDANCE WITH ASTM SPECIFICATIONS C-840, EXCEPT THAT THE STEEL DRILL SCREWS USED (SPECIFICATION ASTM C-864) SHALL BE SPACED NOT MORE THAN 8" ON CENTER AT THE EDGES AND ENDS, AND NOT MORE THAN 12" ON CENTER, IN THE FIELD OF THE BOARD
 - 42) METAL PLASTER BASES SHALL BE ATTACHED IN ACCORDANCE WITH ASTM SPECIFICATION C-841 EXCEPT SCREW HEADS SHALL BE OF SIZES AND TYPES SUITABLE FOR POSITIVE (NO MOVEMENT) ATTACHMENT
 - 43) CARE SHOULD BE TAKEN TO ALLOW FOR ADDITIONAL STUDS AT INTERSECTIONS, CORNERS, DOORS, WINDOWS, CONTROL JOINTS, ETC., AND AS CALLED FOR IN THE DRAWING
 - 44) PROVISIONS FOR STRUCTURE MOVEMENT (EXPANSION) SHALL BE ALLOWED WHERE INDICATED AND NECESSARY BY DESIGN OR CODE REQUIREMENTS
 - 45) SPLICING OF AXIALLY LOADED MEMBERS SHALL NOT BE PERMITTED
 - 46) WIRE TYING OF MEMBERS IS NOT PERMITTED
- INSTALLATION - PANELIZED CONSTRUCTION**
- 47) PANELS SHALL BE DESIGNED TO RESIST CONSTRUCTION AND HANDLING LOADS AS WELL AS LOADS REQUIRED BY CODE
 - 48) HANDLING AND LIFTING OF PRE-FABRICATED PANELS SHALL NOT CAUSE PERMANENT DISTORTION IN ANY MEMBER OF COLLATERAL MATERIAL AND IS THE RESPONSIBILITY OF THE PANEL CONTRACTOR
 - 49) ATTACHMENT OF THE PANEL TO THE STRUCTURE SHALL BE AS SHOWN ON THE DRAWINGS
 - 50) WHERE SPLICING OF TRACKS IS NECESSARY BETWEEN STUD SPACING, A PIECE OF STUD SHALL BE PLACED IN THE TRACK FASTENED WITH TWO SCREWS OR WELDS PER FLANGE TO EACH PIECE OF TRACK
 - 51) ALIGN ALL PANEL TO PROVIDE CONTINUITY OF ANY WALL/FLOOR SURFACE
 - 52) MAKE ALL STUD TO TRACK CONNECTIONS PRIOR TO HOISTING OF PANEL
 - 53) INSTALLATION - NON-PANELIZED (STICK-BUILT) CONSTRUCTION
 - 54) COMPLETE BEARING SHALL BE MAINTAINED UNDER TRACKS TO PROVIDE FOR LOAD TRANSFER IN AXIALLY LOADED ASSEMBLIES. IF THE ERECTING CONTRACTOR
 - 55) ALIGN TRACK ACCURATELY AT SUPPORTING STRUCTURE AND FASTEN TO STRUCTURE AS SHOWN ON THE DRAWINGS
 - 56) TRACK INTERSECTIONS SHALL BUTT EVENLY
 - 57) STUDS SHALL BE PLUMBED, ALIGNED, AND SECURELY ATTACHED TO FLANGES OR WEBS OF UPPER AND LOWER TRACKS. AXIALLY LOADED STUDS SHALL BE SEATED SQUARELY IN BOTH TOP AND BOTTOM TRACKS
 - 58) WHERE SPLICING OF TRACK IS NECESSARY BETWEEN STUD SPACING, A PIECE OF STUD SHALL BE PLACED IN THE TRACK FASTENED WITH TWO SCREWS OR WELDS PER FLANGE TO EACH PIECE OF TRACK
 - 59) COMPLETE BEARINGS SHALL BE MAINTAINED UNDER TRACKS TO PROVIDE FOR LOAD TRANSFER IN AXIALLY LOADED ASSEMBLIES. IF THE ERECTING CONTRACTOR IS BEARING ON WORK SET BY ANOTHER TRADE, IT IS HIS RESPONSIBILITY TO INSURE THAT BEARING CRITERIA ARE MET. ANY DISCREPANCY SHALL BE BROUGHT TO THE ATTENTION OF THE PROJECT ARCHITECT OR ENGINEER PRIOR TO THE COMMENCEMENT OF THE WORK, FASTENINGS AND ATTACHMENTS
 - 60) ANCHORAGE OF THE TRACKS TO THE STRUCTURE SHALL BE WITH METHODS DESIGNED FOR THAT SPECIFIC APPLICATION. SIZE, PENETRATION, TYPE, AND SPACING SHALL BE DETERMINED BY DESIGN
 - 61) WELDS SHALL CONFORM TO THE REQUIREMENTS OF AWS D1.1, AWS D1.3, AND AISI MANUAL SECTION 4.2 WELDS MAY BE BUTT, FILLET, SPOT, OR GROOVE TYPE. THE APPROPRIATENESS OF WHICH SHALL BE DETERMINED BY AND WITHIN THE DESIGN CALCULATIONS. ALL WELDS SHALL BE TOUCHED UP USING ZINC RICH PAINT
 - 62) STEEL DRILL SCREWS SHALL BE OF THE MINIMUM DIAMETER INDICATED BY THE DESIGN OF THAT PARTICULAR ATTACHMENT DETAIL. PENETRATION THROUGH JOINED MATERIALS SHALL NOT BE LESS THAN 3 EXPOSED THREADS
 - 63) SCREWS SHALL HAVE A PROTECTIVE COATING AT LEAST EQUIVALENT TO CADMIUM PLATING (ASTM A-165 TYPE NS) FOR USE IN EXTERIOR ASSEMBLIES
 - 64) TOLERANCES
 - 65) VERTICAL ALIGNMENT (PLUMB) OF STUDS SHALL BE WITHIN 1/800TH (1/8" IN 10'-0") OF THE SPAN
 - 66) HORIZONTAL ALIGNMENT (LEVEL) OF WALL SHALL BE WITHIN 1/800TH (1/8" IN 10'-0") OF THEIR RESPECTIVE LENGTHS
 - 67) SPACING OF STUDS SHALL NOT BE MORE THAN + OR - 1/8" FROM THE DESIGNED SPACING PROVIDING THAT THE CUMULATIVE ERROR DOES NOT EXCEED THE REQUIREMENTS OF THE FINISHING MATERIALS
 - 68) PREFABRICATED PANELS SHALL NOT BE MORE THAN 1/8" OUT OF SQUARE WITHIN THE LENGTH OF THAT PANEL
 - 69) INSPECTIONS
 - 70) ALL MEMBERS SHALL BE CHECKED FOR BEARING, COMPLETENESS OF ATTACHMENTS, REINFORCEMENT, ETC.
 - 71) ALL ATTACHMENTS SHALL BE CHECKED FOR CONFORMANCE WITH THE STRUCTURAL DRAWINGS. ALL WELDS SHALL BE TOUCHED UP AS SPECIFIED ABOVE
 - 72) GENERAL INSPECTION OF STRUCTURE SHALL BE COMPLETED PRIOR TO APPLYING LOADS TO THOSE MEMBERS
 - 73) INSPECTIONS WHERE AND AS REQUIRED BY LOCAL CODES SHALL BE CONTROLLED INSPECTIONS

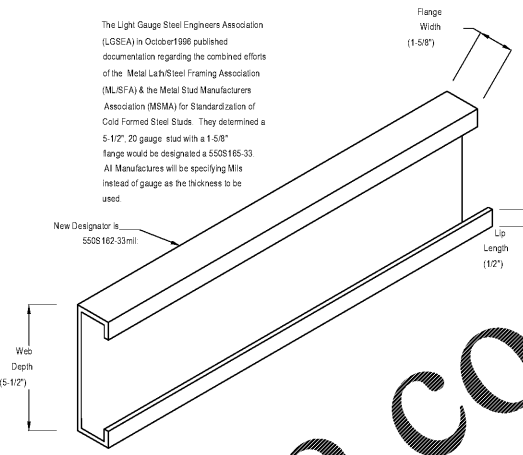

SECTION 05400 - COLD-FORMED METAL FRAMING
 Or
 SECTION 05110 - NON-LOAD BEARING WALL FRAMING

GENERAL
 REFER TO Article (if used)

VERIFY THAT ARTICLE INCLUDES: AISI-AMERICAN IRON AND STEEL INSTITUTE SPECIFICATION FOR THE DESIGN OF COLD-FORMED STEEL STRUCTURAL MEMBERS AND ASTM A 653A 653M STANDARD SPECIFICATION FOR STEEL SHEET, ZINC-COATED (GALVANIZED) OR ZINC-IRON ALLOY COATED (GALVANNEALED) BY THE HOT-DIP PROCESS

QUALITY ASSURANCE Article: INCLUDE THE FOLLOWING STATEMENT:
 Design non-axial-load-bearing framing to accommodate minimum 1/2 inch (13 mm) vertical deflection

SUBMITTALS Article:
 Product Data: VERIFY THAT PRODUCT DATA FOR "ACCESSORIES" IS INCLUDED

Shop Drawings: INCLUDE THE FOLLOWING STATEMENT:
 Provide wall sections coordinated with Drawings showing anchorage and connection details for cold formed metal framing and accessories

Structural Calculations:
 VERIFY THAT SUBMITTALS INCLUDE "STRUCTURAL CALCULATIONS"

QUALITY ASSURANCE Article: INCLUDE THE FOLLOWING STATEMENTS:
 Structural Properties: Calculate structural properties of cold-formed metal framing and accessories in accordance with AISI "Specification for the Design of Cold-Formed Steel Structural Members"

QUALIFICATIONS Paragraph:
 Provide structural design calculations sealed by a Professional Structural Engineer licensed in the state of Georgia

PART 2 - PRODUCTS
MANUFACTURERS Article: INCLUDE THE FOLLOWING IN THE LIST OF MANUFACTURERS/PRODUCTS
 Contact The Steel Network, Inc. (888) 474-4TSM (4976); Product: [VeriClip™ deflection clips] [and] [BridgeClip™ bridging clips]

ACCESSORIES Article: INCLUDE THE FOLLOWING STATEMENTS: VERIFY THAT CLIPS ARE IDENTIFIED ON DRAWINGS IF STRUCTURAL DESIGN IS PERFORMED BY THE STRUCTURAL ENGINEER OF RECORD

Deflection and Bridging Clips

1. Steel: ASTM A 653A 653M, SS Grade 50 (340), Class 1, 50 ksi (340 MPa) minimum yield strength, 65 ksi (450 MPa) minimum tensile strength, G-60 (Z180) hot dipped galvanized coating
2. Material Thickness of VeriClip SL, SLB and SLS Series: 0.088 inches (1.73 mm) minimum
3. Material Thickness of VeriClip SLD Series: 0.036 inches (0.91 mm) minimum
4. Material Thickness of BridgeClip: 0.036 inches (0.91 mm) minimum
5. Design clips for positive attachment to structure and stud web using step-bushing technology to provide frictionless vertical movement
6. Provide clips with attached bushing and screw of the series, size and configuration as (shown on Drawings) (required by the structural design calculations)

FINISHES Article:
 IF SPECIFICATION INCLUDES FINISHES FOR CLIPS, ACCESSORIES, ETC., DELETE OR VERIFY THAT SPECIFIED FINISHES DO NOT CONFLICT WITH GALVANIZED COATING SPECIFIED ABOVE

END OF SPECIFICATIONS

SECTION 05800 - GYPSUM BOARD ASSEMBLIES
 THESE SPECIFICATIONS ARE INTENDED TO ASSIST DESIGN PROFESSIONALS IN MODIFYING CONSTRUCTION SPECIFICATION INSTITUTE (CSI) FORMATTED 3-PART SPECIFICATIONS TO INCLUDE THE STEEL NETWORK'S FRAMING ACCESSORIES IN SECTION 05800
 WHILE SOME ARTICLE/PART/ASSEMBLY TITLES MAY VARY DEPENDING ON THE PARTICULAR GUIDE SPECIFICATION BEING USED, THESE SPECIFICATIONS FOLLOW CSI'S SECTION FORMAT AND THEREFORE MAY BE USED WITH MOST MASTER SPECIFICATION SYSTEMS WITH MINOR EDITING
 NOTES TO THE SPECIFIER ARE CONTAINED IN BOXES/DELETE FROM FINAL COPY
 OPTIONAL ITEMS REQUIRING SELECTION BY THE SPECIFIER ARE ENCLOSED WITHIN BRACKETS ([])

PART 1 - GENERAL
REFERENCES Article (if used)
 VERIFY THAT ARTICLE INCLUDES: AISI-AMERICAN IRON AND STEEL INSTITUTE SPECIFICATION FOR THE DESIGN OF COLD-FORMED STEEL STRUCTURAL MEMBERS AND ASTM A 653A 653M STANDARD SPECIFICATION FOR STEEL SHEET, ZINC-COATED (GALVANIZED) OR ZINC-IRON ALLOY COATED (GALVANNEALED) BY THE HOT-DIP PROCESS

SUBMITTALS Article:
 Product Data: VERIFY THAT PRODUCT DATA FOR "ACCESSORIES" IS INCLUDED
 Shop Drawings: INCLUDE THE FOLLOWING STATEMENT:
 Provide wall sections coordinated with Drawings showing anchorage and connection details for cold formed metal framing and accessories

QUALITY ASSURANCE Article: INCLUDE THE FOLLOWING STATEMENTS:
 Structural Properties: Calculate structural properties of cold-formed metal framing and accessories in accordance with AISI "Specification for the Design of Cold-Formed Steel Structural Members"

PART 2 - PRODUCTS
MANUFACTURERS Article:
 INCLUDE THE FOLLOWING IN THE LIST OF MANUFACTURERS/PRODUCTS
 Contact The Steel Network, Inc. (888) 474-4TSM (4976); Product: [VeriClip™ deflection clips] [and] [BridgeClip™ bridging clips]

FRAMING MATERIALS Article: FURRING, FRAMING AND ACCESSORIES Paragraph
 INCLUDE THE FOLLOWING STATEMENT: VERIFY CLIPS ARE IDENTIFIED ON DRAWINGS

Deflection and Bridging Clips

1. Steel: ASTM A 653A 653M, SS Grade 50 (340), Class 1, 50 ksi (340 MPa) minimum yield strength, 65 ksi (450 MPa) minimum tensile strength, G-60 (Z180) hot dipped galvanized coating
2. Material Thickness of VeriClip SL, SLB and SLS Series: 0.088 inches (1.73 mm) minimum
3. Material Thickness of VeriClip SLD Series: 0.036 inches (0.91 mm) minimum
4. Material Thickness of BridgeClip: 0.036 inches (0.91 mm) minimum
5. Design clips for positive attachment to structure and stud web using step-bushing technology to provide frictionless vertical movement
6. Provide clips with attached bushing and screw of the series, size and configuration as shown on Drawings

END OF SPECIFICATIONS



Croft & Associates
 3400 Blue Springs Road, Suite 200
 Kennesaw, Georgia 30144
 770.529.7714 (p) 770.529.7716 (f)
 www.croftandassociates.com



OWNER
CITY OF ACWORTH
 4415 SENATOR RUSSELL AVENUE
 ACWORTH, GEORGIA 30101



DURR FIELD
 4757 - 4805 SCHOOL STREET
 ACWORTH, GEORGIA 30101

No.	Date	Description
0	2018-03-12	ISSUED FOR CONSTRUCTION
B	3-4-2018	IN-HOUSE REVIEW
ISSUANCE		

PROJECT NUMBER
16139

DRAWN: SD
CHECKED: AWI

SHEET TITLE
ROOF FRAMING PLAN
 SHEET NO.
S-201