

- CIVIL**
Breadlove Land Planning
15 Simpson St NW, Atlanta, GA 30308
- STRUCTURAL**
Uzun+Case
1230 Peachtree St NE, Suite 2500, Atlanta, GA 30309
- MEP**
Matheson Ball & Associates
11285 Ekins Rd., Suite F3, Roswell, GA 30076
- LANDSCAPING**
Perkins+Will
1315 Peachtree St NE, Atlanta, GA 30309
- Contractor**
Camacho
3103 Medlock Bridge Road, Norcross, GA 30071

OWNER
KIPP Metro Atlanta Schools
504 Fair St SW Suite 300

FACILITY

CONTRACTOR


PROJECT

RELEASED FOR CONSTRUCTION 06/07/2019

**KIPP ATLANTA
COLLEGIATE - Addition
and Renovations**
98 Anderson Ave NW
Atlanta GA 30314



KEYPLAN




ISSUE CHART

NO.	ISSUE	DATE

**FLOOR PLAN - FIRST
FLOOR - PART A -**

SHEET NUMBER

E1.1A

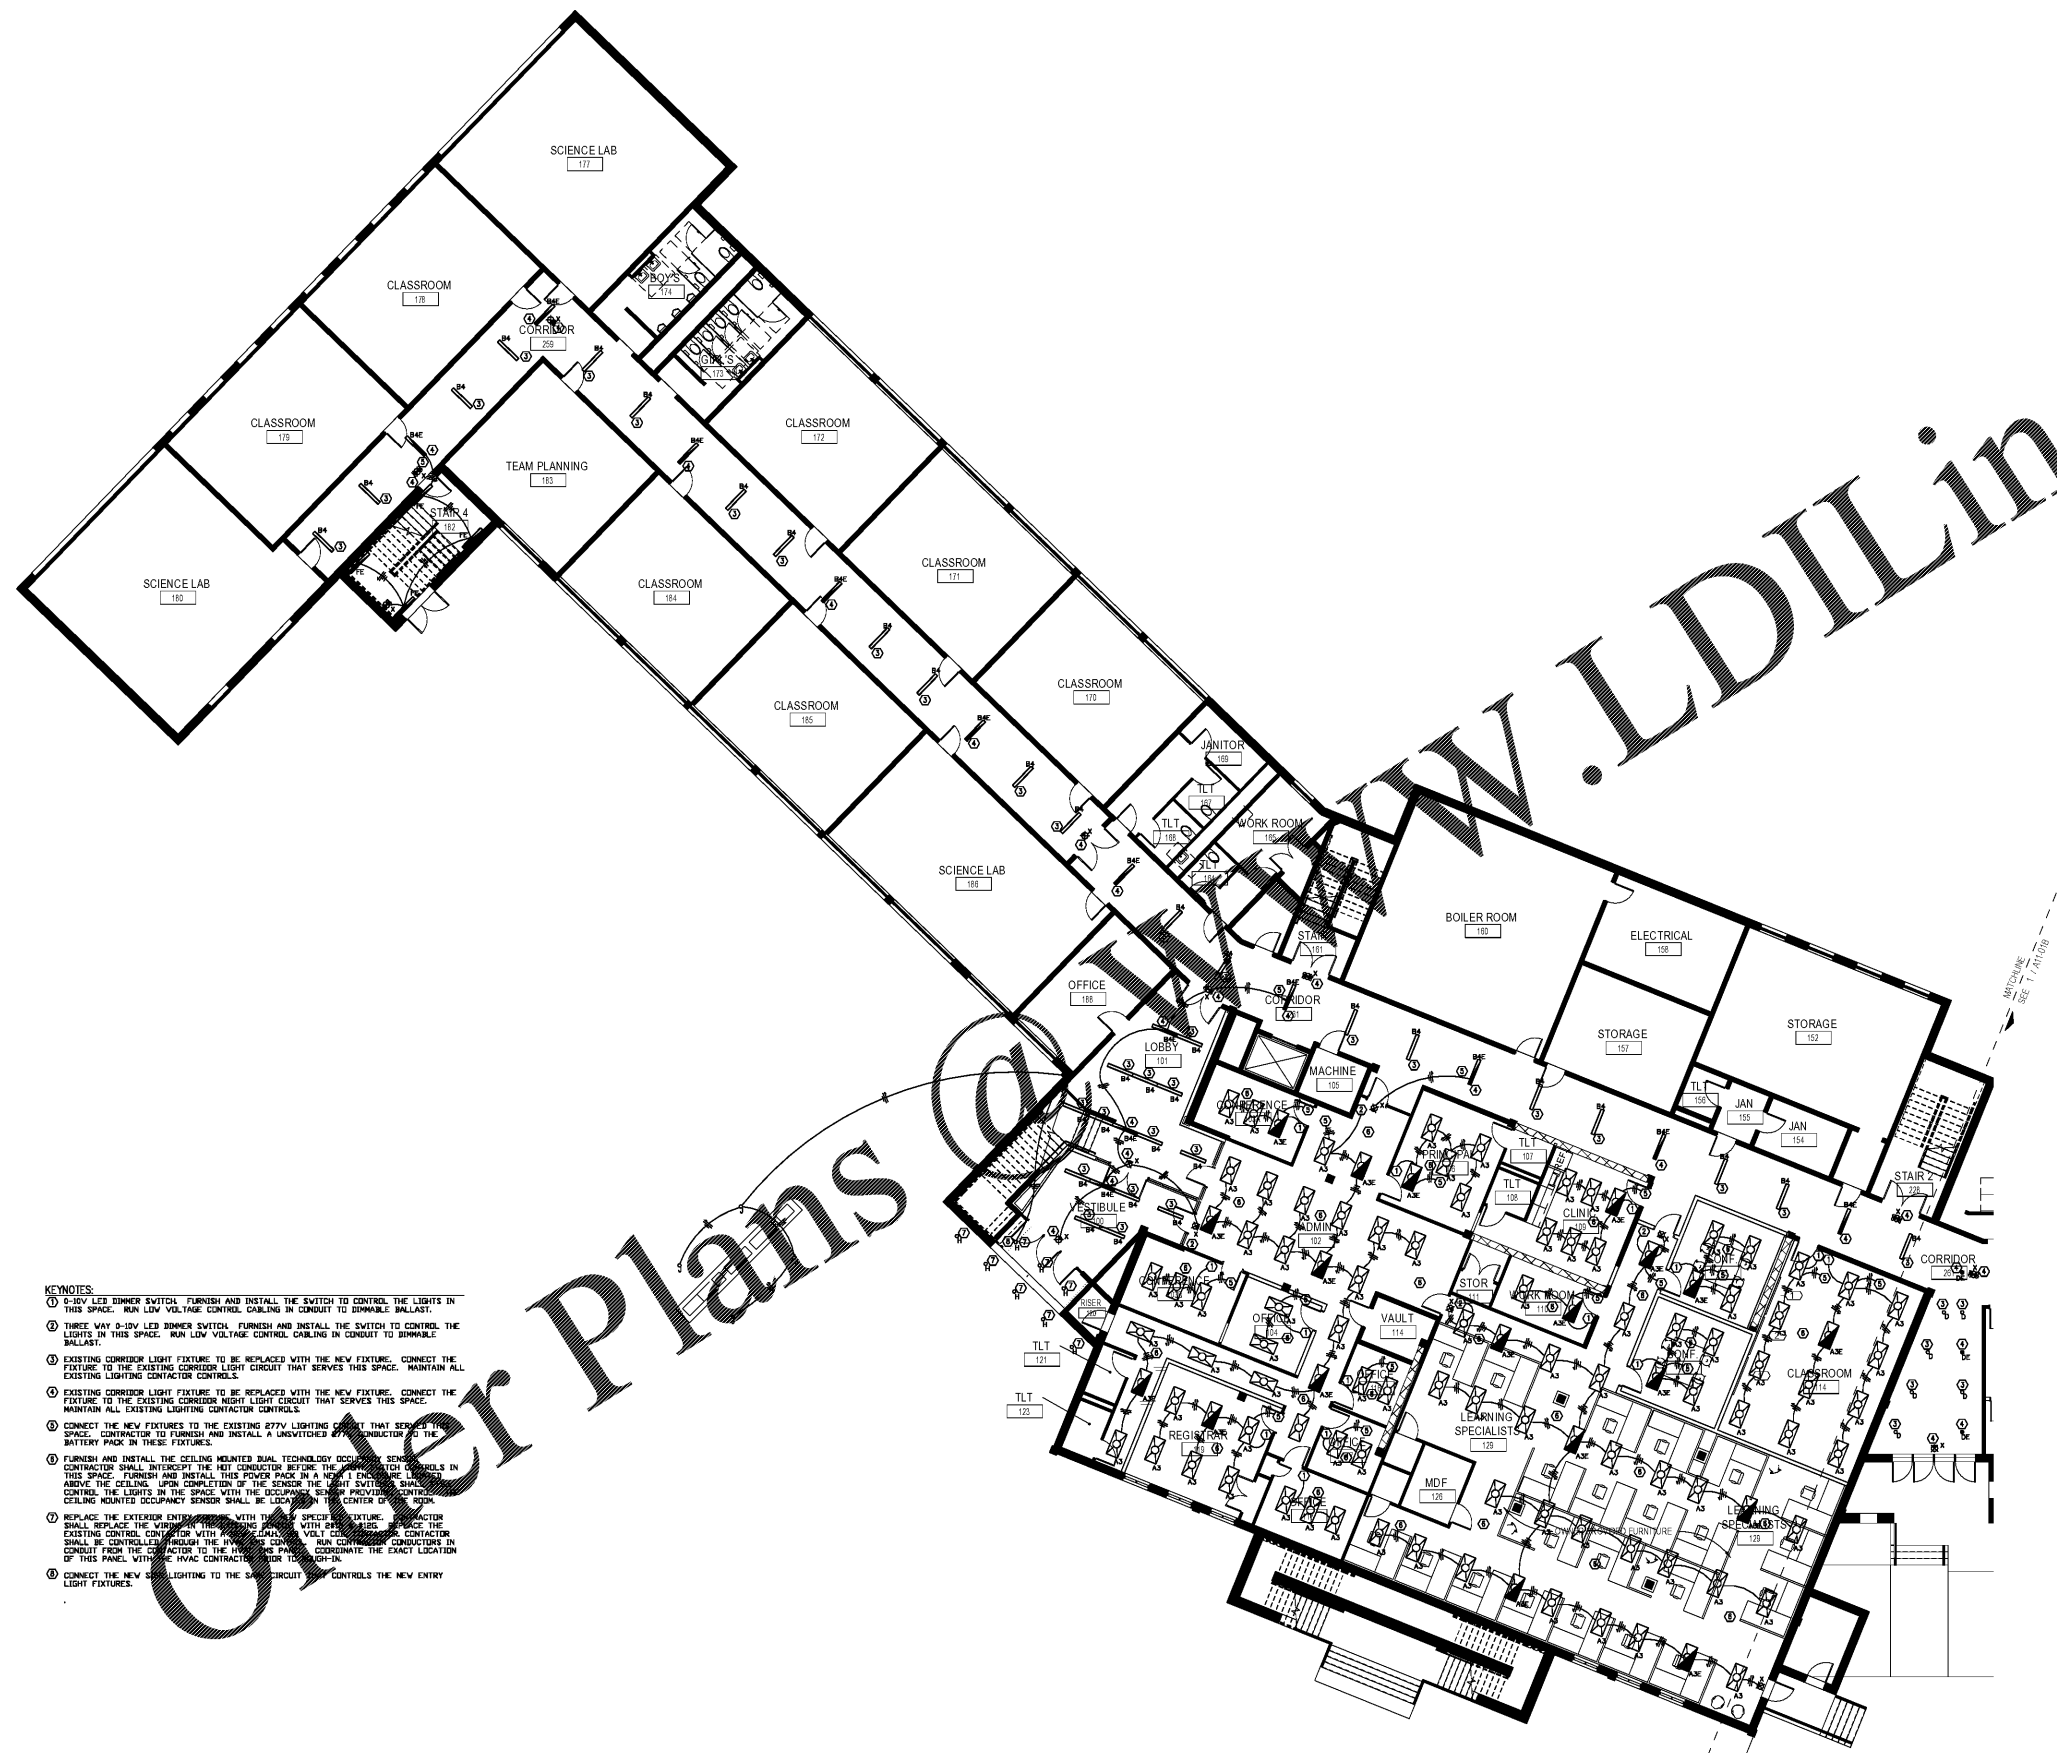

- KEYNOTES:**
- 0-10V LED DIMMER SWITCH. FURNISH AND INSTALL THE SWITCH TO CONTROL THE LIGHTS IN THIS SPACE. RUN LOW VOLTAGE CONTROL CABLE IN CONDUIT TO DIMMABLE BALLAST.
 - THREE WAY 0-10V LED DIMMER SWITCH. FURNISH AND INSTALL THE SWITCH TO CONTROL THE LIGHTS IN THIS SPACE. RUN LOW VOLTAGE CONTROL CABLE IN CONDUIT TO DIMMABLE BALLAST.
 - EXISTING CORRIDOR LIGHT FIXTURE TO BE REPLACED WITH THE NEW FIXTURE. CONNECT THE FIXTURE TO THE EXISTING CORRIDOR LIGHT CIRCUIT THAT SERVES THIS SPACE. MAINTAIN ALL EXISTING LIGHTING CONTACTOR CONTROLS.
 - EXISTING CORRIDOR LIGHT FIXTURE TO BE REPLACED WITH THE NEW FIXTURE. CONNECT THE FIXTURE TO THE EXISTING CORRIDOR LIGHT CIRCUIT THAT SERVES THIS SPACE. MAINTAIN ALL EXISTING LIGHTING CONTACTOR CONTROLS.
 - CONNECT THE NEW FIXTURES TO THE EXISTING 277V LIGHTING CIRCUIT THAT SERVES THIS SPACE. CONTRACTOR TO FURNISH AND INSTALL A UNWITNESSED 277V CONTACTOR AND THE BATTERY PACK IN THESE FIXTURES.
 - FURNISH AND INSTALL THE CEILING MOUNTED DUAL TECHNOLOGY OCCUPANCY SENSORS. CONTRACTOR SHALL INTERCEPT THE WET CONDUIT BEFORE THE UNWITNESSED CONTACTORS IN THIS SPACE. FURNISH AND INSTALL THIS POWER PACK IN A NEW 1" EXCLUSIVE LED ABOVE THE CEILING. UPON COMPLETION OF THE SENSOR THE LIGHT SWITCHES SHALL CONTROL THE LIGHTS IN THE SPACE WITH THE OCCUPANCY SENSOR PROVIDED CONTROLS. CEILING MOUNTED OCCUPANCY SENSOR SHALL BE LOCATED IN THE CENTER OF THE ROOM.
 - REPLACE THE EXTERIOR ENTRY LIGHTS WITH THE NEW EXTERIOR ENTRY LIGHTS. CONTRACTOR SHALL REPLACE THE WIREWORK WITH NEW WIREWORK WITH 277V LED. REPLACE THE EXISTING CONTROL CONTACTOR WITH NEW CONTACTOR. CONTRACTOR SHALL RUN CONTACTOR CONDUCTORS IN CONDUIT FROM THE CONTACTOR TO THE HANGERS PANEL. COORDINATE THE EXACT LOCATION OF THIS PANEL WITH THE HVAC CONTRACTOR. MINOR 1/2" MIN.
 - CONNECT THE NEW EXTERIOR LIGHTING TO THE SAME CIRCUIT THAT CONTROLS THE NEW ENTRY LIGHT FIXTURES.

1 01 - FIRST FLOOR - PART - A
3/32" = 1'-0"