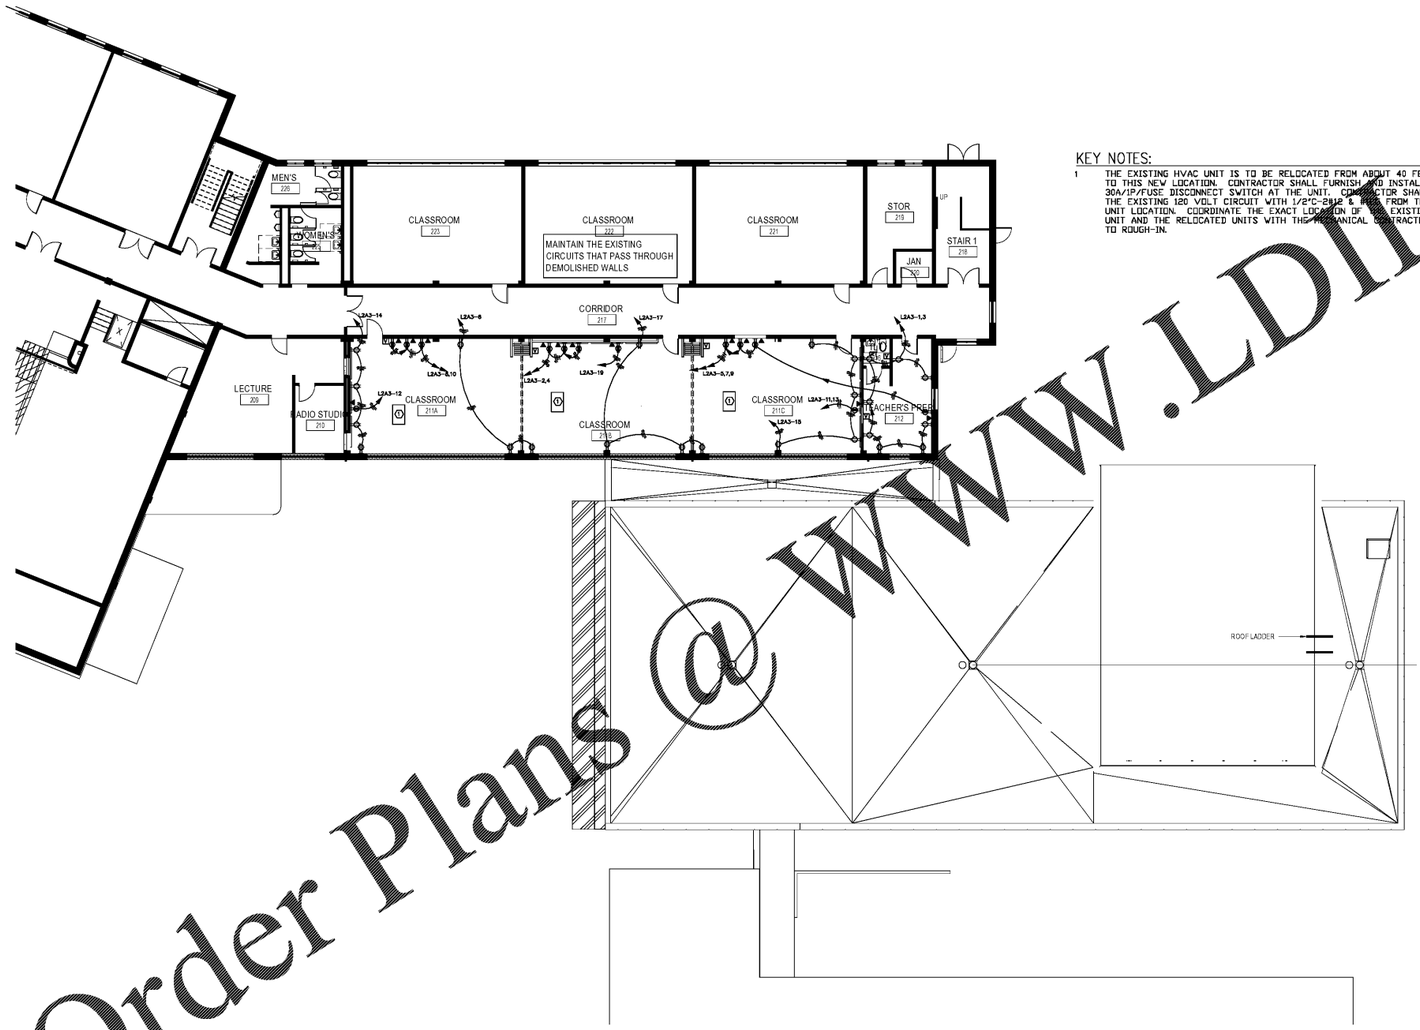

KEY NOTES:

1 THE EXISTING HVAC UNIT IS TO BE RELOCATED FROM ABOUT 40 FEET AWAY TO THIS NEW LOCATION. CONTRACTOR SHALL FURNISH AND INSTALL A NEW 30A/1P/FUSE DISCONNECT SWITCH AT THE UNIT. CONTRACTOR SHALL EXTEND THE EXISTING 120 VOLT CIRCUIT WITH 1/2"C-2#12 & #12G FROM THE OLD UNIT LOCATION. COORDINATE THE EXACT LOCATION OF THE EXISTING HVAC UNIT AND THE RELOCATED UNITS WITH THE MECHANICAL CONTRACTOR PRIOR TO ROUGH-IN.

1 02 - SECOND FLOOR - PART B - POWER
3/32" = 1'-0"

Order Plans @ WWW.LDLine.com

PERKINS +WILL

1315 Peachtree St NE
Atlanta, GA 30309
t 404.873.7300
f 404.892.5823
www.perkinswill.com

CONSULTANTS

CIVIL
Breedlove Land Planning
15 Simpson St. NW, Atlanta, GA 30308

STRUCTURAL
Uzun+Case
1230 Peachtree St. NE, Suite 2500, Atlanta GA 30309

MEP
Matheson Ball & Associates
11285 Elkins Rd., Suite F3, Roswell, GA 30076

LANDSCAPING
Perkins+Will
1315 Peachtree St. NE, Atlanta, GA 30309

Camacho
3103 Medlock Bridge Road, Norcross, GA 30071

OWNER
KIPP Metro Atlanta Schools
504 Fair St SW Suite 300

FACILITY

CONTRACTOR

RELEASED FOR CONSTRUCTION 06/07/2019

PROJECT

KIPP ATLANTA COLLEGIATE - Addition and Renovations
98 Anderson Ave NW
Atlanta GA 30314

KEYPLAN

ISSUE CHART

Marks	Issue	Date

Job Number	
Drawn	PAT
Checked	PAT
Approved	PAT

TITLE

FLOOR PLAN - SECOND FLOOR - PART B - POWER

SHEET NUMBER

E2.2B

Copyright © 2018 Perkins+Will