

3 LOBBY CEILING
1/8" = 1'-0"

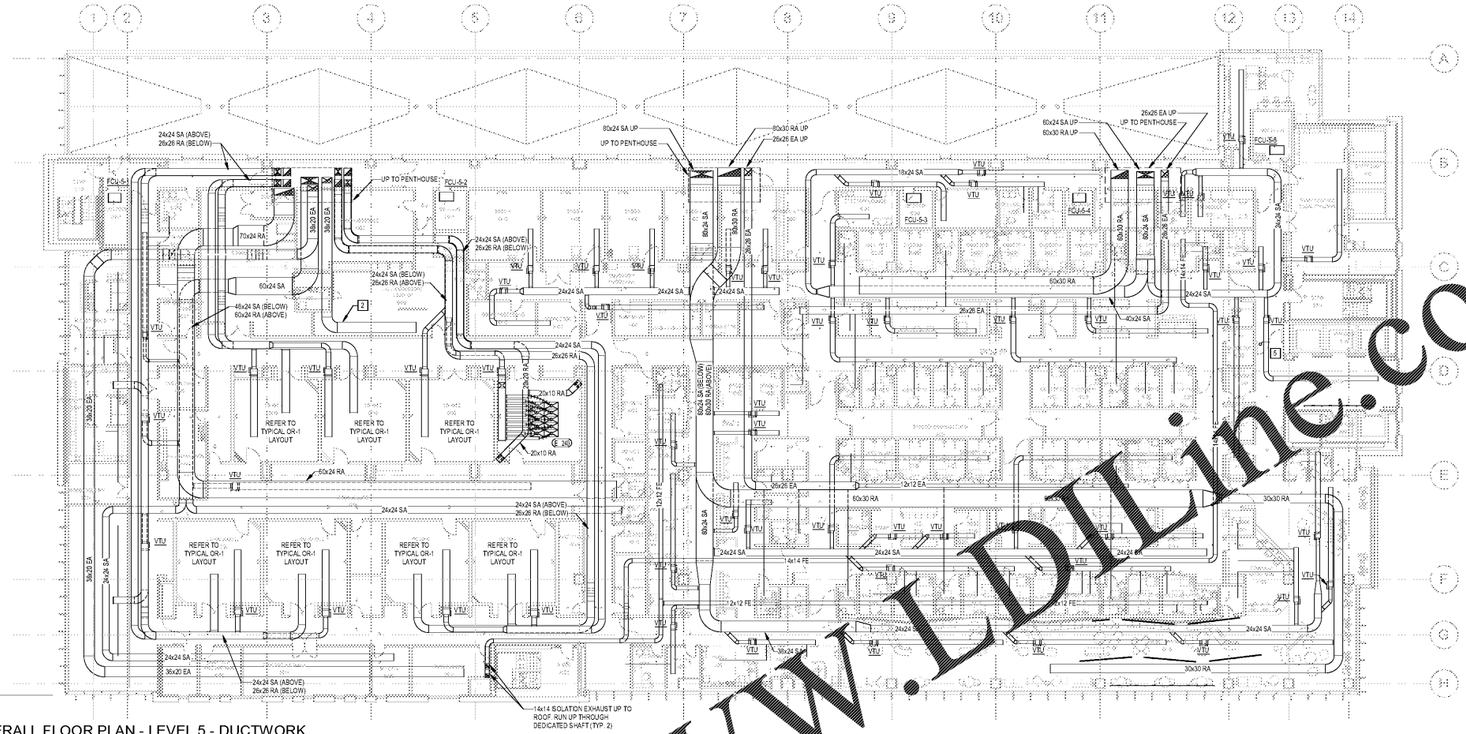

1 OVERALL FLOOR PLAN - LEVEL 5 - DUCTWORK
1/16" = 1'-0"

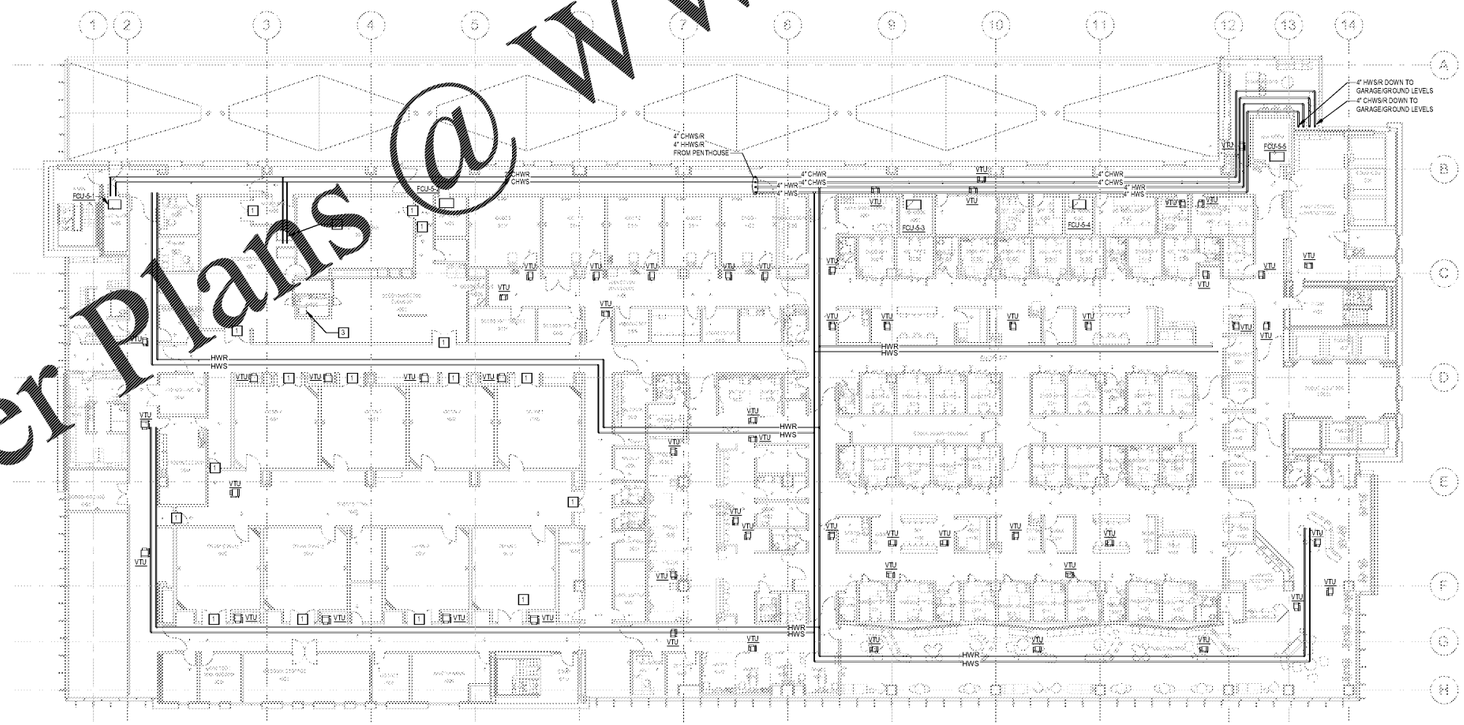

2 OVERALL FLOOR PLAN - LEVEL 5 - PIPING
1/16" = 1'-0"

#	KEYNOTES
1	PROVIDE DIGITAL ROOM PRESSURE MONITORS BETWEEN CORRIDORS AND OPERATING ROOMS, CLEAN CORE, STERILE PROCESSING, DECONTAM, STERILE STORAGE.
2	STERILE PROCESSING EXHAUST SHALL BE CONSTRUCTED OF STAINLESS STEEL, SLOPE DUCTWORK IN THE DIRECTION OF AIRFLOW, AND PROVIDE DRAIN AT DUCT LOW POINT.
3	PROVIDE STEAM PIPING BETWEEN BOILER (FURNISHED BY OTHERS) AND STERILIZERS. PROVIDE CONDENSATE RETURN PIPING, STEAM TRAPS, AND STEAM SAFETY SHUTOFF VALVE PIPING.
4	PROVIDE CHILLED WATER FOR STERILIZERS.
5	PROVIDE ACCESS PANEL IN GYPSUM BOARD CEILING FOR ACCESS TO SMOKE DAMPER AND BUILDING DAMPER MOTORS.

GENERAL NOTES

1. THIS FLOOR SHALL HAVE A FULLY DUCTED RETURN AIR SYSTEM

Order Plans @ WWW.LDLine.com

Grady

Project
THE CENTER FOR ADVANCED SURGICAL SERVICES (CASS)
88 JESSE HILL DRIVE
ATLANTA, GA 30303

Prepared For
GRADY HEALTH SYSTEM
80 JESSE HILL DR. SE
ATLANTA, GA 30303

Hellmuth, Obata & Kassabaum, Inc.
191 Peachtree Street, NE, Suite 2250
Atlanta, GA 30303 USA
t +1 404 439 9000 f +1 404 439 9001

All reproduction & intellectual property rights reserved © 2019

In Association with

TLC ENGINEERING for ARCHITECTURE
©Copyright 2019
255 S. Orange Avenue
Suite 1600
Orlando, FL 32801
P 407.841.9050
COA PE1002660
www.tlc-engineers.com
TLC No.: 118548
TAMPA, ORLANDO, GEORGIA

Key Plan



Professional Seals
Benjamin Roseborough, P.E.
Georgia License #PE036005

NOT FOR CONSTRUCTION

No.	Description	Date
1	DD - GMP	2019-07-03

Project No: 18.16013.00

Sheet Title
LEVEL 5 FLOOR PLAN - OVERALL - MECHANICAL

Original is 30 x 42. Do not scale contents of this drawing.

Sheet Number
M105

7/1/2019 4:03:08 PM C:\Revit Local\GRADY\CASS-TLC-MECH_Michael.Petrone.rvt