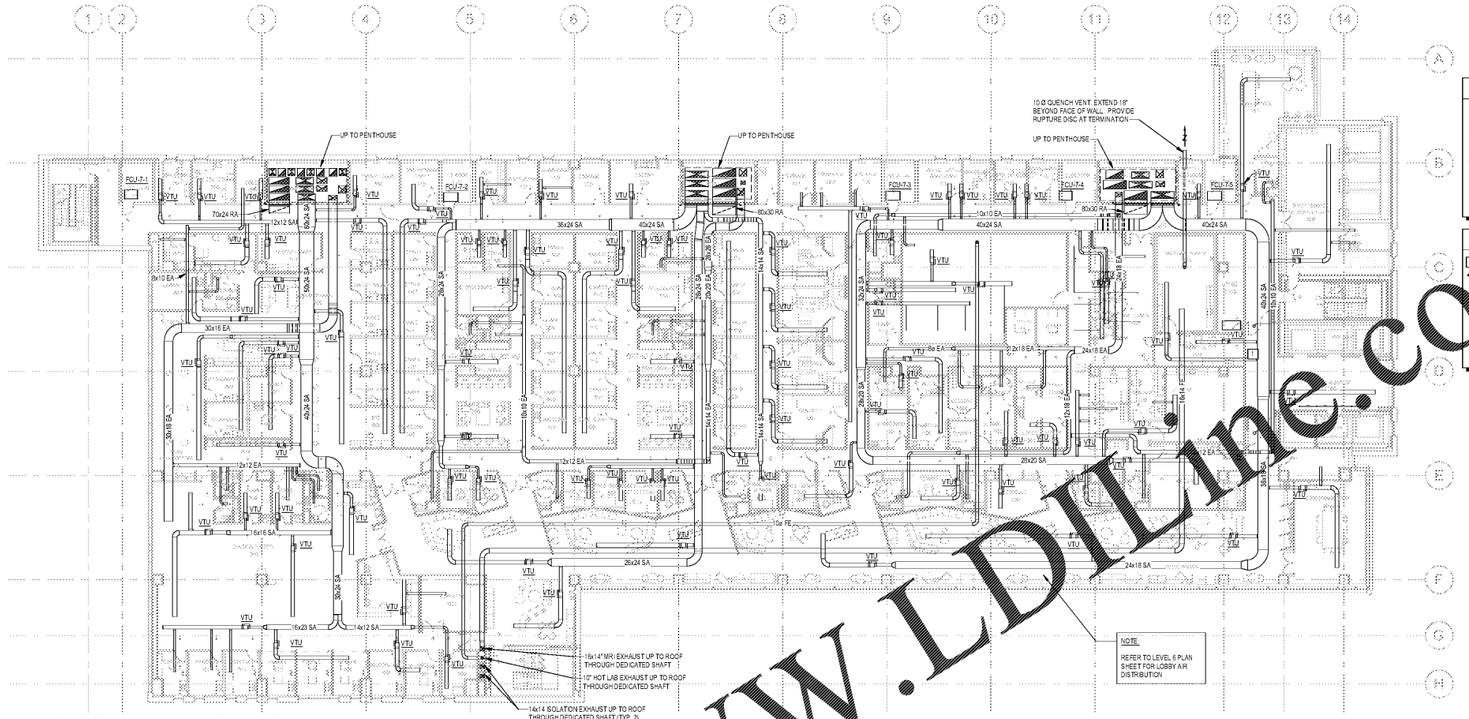

1 OVERALL FLOOR PLAN - LEVEL 7 - DUCTWORK
1/16" = 1'-0"

2 OVERALL FLOOR PLAN - LEVEL 7 - PIPING
1/16" = 1'-0"

GENERAL NOTES

1. THIS FLOOR HAS NON-DUCTED RETURN AIR PLENUM.
2. PROVIDE ABOVE-CEILING AIR TRANSFER OPENINGS IN FULL-HEIGHT WALLS TO FACILITATE AIR MOVEMENT IN PLENUM. - SIZE FOR 300 FPM
3. ALL ITEMS INSTALLED WITHIN THE RETURN AIR PLENUM SHALL HAVE MAXIMUM FLAME SPREAD / SMOKE DEVELOPED RATINGS OF 25 / 50.

KEYNOTES

1. PROVIDE ADDED PANEL IN ELEVATOR LOBBY CEILING FOR ACCESS TO SMOKE DAMPER AND BALANCING DAMPER ACTUATORS

Grady

Project
THE CENTER FOR ADVANCED SURGICAL SERVICES (CASS)
88 JESSE HILL DRIVE
ATLANTA, GA 30303

Prepared For
GRADY HEALTH SYSTEM
80 JESSE HILL DR. SE
ATLANTA, GA 30303

Hellmuth, Obata & Kassabaum, Inc.
191 Peachtree Street, NE, Suite 2250
Atlanta, GA 30303 USA
t +1 404 439 9000 f +1 404 439 9001

All reproduction & intellectual property rights reserved © 2019

In Association with

TLC ENGINEERING SOLUTIONS
©Copyright 2019
255 S. Orange Avenue
Suite 1600
Orlando, FL 32801
P 407.841.9050
COA PEF002660
www.tlc-engineers.com
TLC No.: 118548
THINK. LISTEN. CREATE.

Key Plan



Professional Seals
Benjamin Roseborough, P.E.
Georgia License #PE036005

NOT FOR CONSTRUCTION

No.	Description	Date
1	DD - GMP	2019-07-03

Project No: 18.16013.00

Sheet Title
LEVEL 7 FLOOR PLAN - OVERALL - MECHANICAL

Original is 30 x 42. Do not scale contents of this drawing.

Sheet Number
M107

C:\Revit Local\GRADY\CASS-TLC-MECH_Michael.Petrone.rvt
7/1/2019 4:03:46 PM

Order Plans @ WWW.LDILine.com