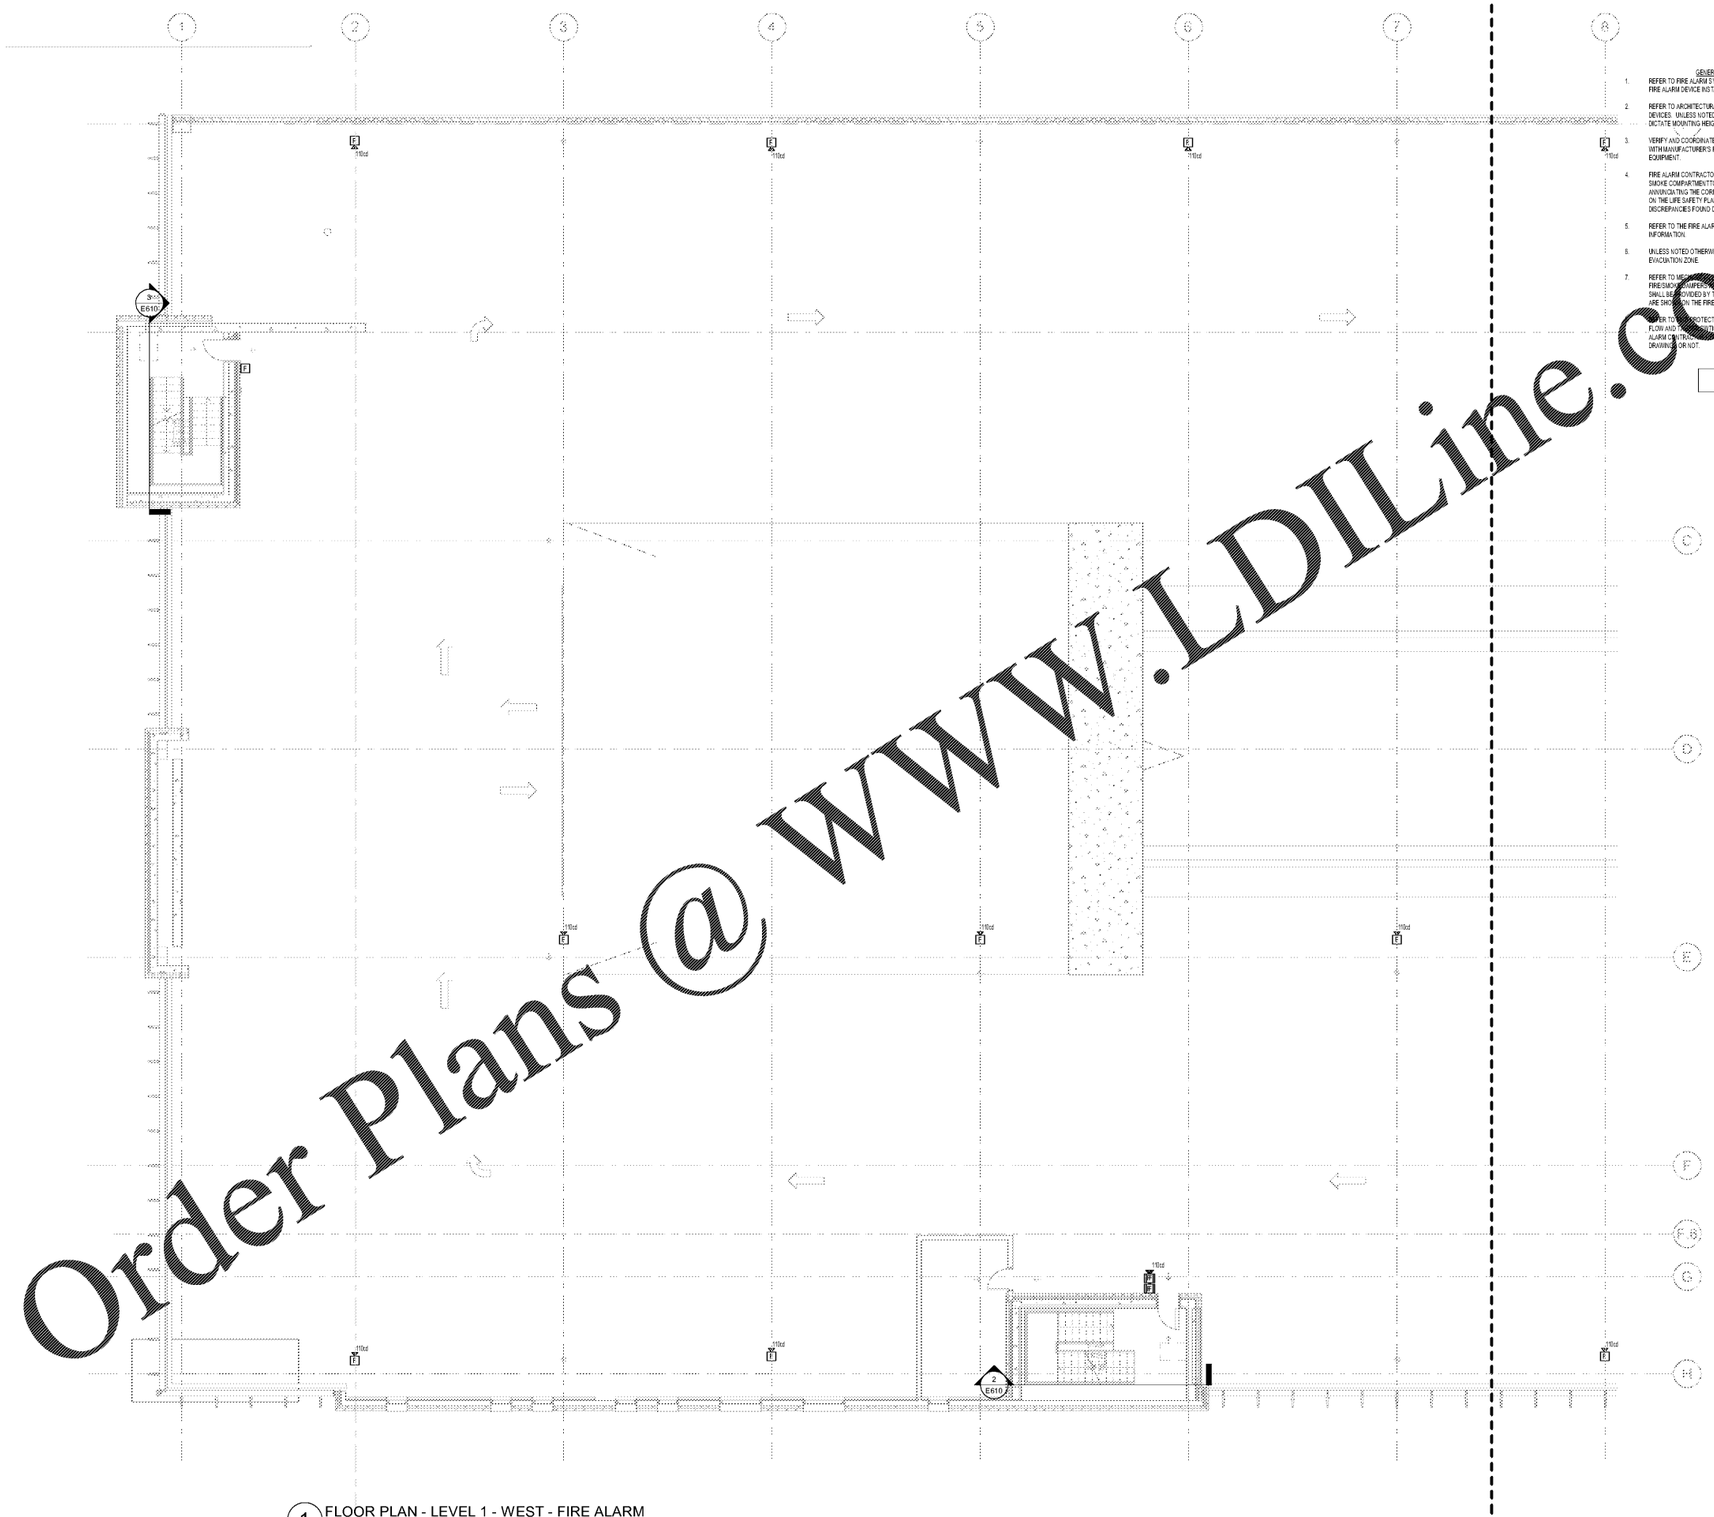


GENERAL FIRE ALARM PLAN NOTES:

1. REFER TO FIRE ALARM SYMBOL LEGEND FOR DETAILED REQUIREMENTS FOR ALL FIRE ALARM DEVICE INSTALLATIONS.
2. REFER TO ARCHITECTURAL ELEVATIONS FOR FINAL MOUNTING HEIGHTS OF ALL DEVICES. UNLESS NOTED OTHERWISE, ARCHITECTURAL ELEVATIONS SHALL DICTATE MOUNTING HEIGHTS OF ALL FIXTURES.
3. VERIFY AND COORDINATE EXACT ELECTRICAL REQUIREMENTS OF ALL EQUIPMENT WITH MANUFACTURER'S RECOMMENDATIONS PRIOR TO INSTALLATION OF EQUIPMENT.
4. FIRE ALARM CONTRACTOR SHALL FULLY TEST ALL INITIATING DEVICES WITHIN THE SMOKE COMPARTMENT TO ENSURE THAT ALL DEVICES ARE CORRECTLY ANNUNCIATING THE CORRECT SMOKE COMPARTMENT IDENTIFICATION, AS SHOWN ON THE LIFE SAFETY PLANS. CONTRACTOR SHALL CORRECT ANY AND ALL DISCREPANCIES FOUND DURING SAID TESTING PROCEDURE.
5. REFER TO THE FIRE ALARM SYSTEM RISER DIAGRAM AND NOTES FOR ADDITIONAL INFORMATION.
6. UNLESS NOTED OTHERWISE, EACH SMOKE COMPARTMENT SHALL SERVE AS A FIRE EVACUATION ZONE.
7. REFER TO MECHANICAL DRAWINGS FOR QUANTITIES AND LOCATIONS OF ALL FIRE/SMOKE DAMPERS AND DUCT MOUNTED SMOKE DETECTORS. THESE DEVICES SHALL BE PROVIDED BY THE FIRE ALARM CONTRACTOR REGARDLESS OF IF THEY ARE SHOWN ON THE FIRE ALARM DRAWINGS OR NOT.
8. REFER TO FIRE PROTECTION DRAWINGS FOR QUANTITIES AND LOCATIONS OF ALL FLOW AND SUPERVISORY SWITCHES. THESE DEVICES SHALL BE PROVIDED BY THE FIRE ALARM CONTRACTOR REGARDLESS OF IF THEY ARE SHOWN ON THE FIRE ALARM DRAWINGS OR NOT.

KEY NOTES

1 FLOOR PLAN - LEVEL 1 - WEST - FIRE ALARM
1/8" = 1'-0"

Order Plans @ WWW.LDILine.com

C:\Revit Local\GRADYCASS-TLC-ELEC_KOEHILDENBRANDKGIEY.rvt
7/1/2019 5:10:37 PM

Grady

Project
THE CENTER FOR ADVANCED SURGICAL SERVICES (CASS)
88 JESSE HILL DRIVE
ATLANTA, GA 30303

Prepared For
GRADY HEALTH SYSTEM
80 JESSE HILL DR. SE
ATLANTA, GA 30303

Hellmuth, Obata & Kassabaum, Inc.
191 Peachtree Street, NE, Suite 2250
Atlanta, GA 30303 USA
t +1 404 439 9000 f +1 404 439 9001

All reproduction & intellectual property rights reserved © 2019

In Association with

TLC ENGINEERING for ARCHITECTURE
©Copyright 2019
255 S. Orange Avenue
Suite 1800
Orlando, FL 32801
P 407.841.9050
COA PEF002660
www.tlc-engineers.com
TLC No.: 118548
TAMPA, ORLANDO, GEORGIA

Key Plan

Professional Seals
Emory Neal Boothe, P.E.
Georgia License #PE039005

**NOT FOR CONSTRUCTION**

| No. | Description | Date |
|---|---|---|
| 1 | DD - CMP | 2019.07.03 |

Project No: 18.16013.00

Sheet Title
LEVEL 1 FLOOR PLAN - WEST - FIRE ALARM

Original is 30 x 42. Do not scale contents of this drawing.

Sheet Number
E401A