


**NOT FOR
CONSTRUCTION**

No.	Description	Date
1	DD - GMP	2019-07-03

- GENERAL POWER PLAN NOTES**
1. VERIFY AND COORDINATE EXACT ELECTRICAL REQUIREMENTS OF ALL EQUIPMENT WITH MANUFACTURER'S RECOMMENDATIONS PRIOR TO INSTALLATION OF EQUIPMENT. MODIFY LAYOUT AS REQUIRED PER MANUFACTURER'S SPACE REQUIREMENTS.
 2. REFER TO ARCHITECTURAL ELEVATIONS AND CASEWORK DRAWINGS FOR FINAL MOUNTING HEIGHTS AND INSTALLATION REQUIREMENTS OF ALL DEVICES. UNLESS NOTED OTHERWISE, ARCHITECTURAL ELEVATIONS SHALL DICTATE MOUNTING HEIGHTS OF ALL FIXTURES AND DEVICES.
 3. COORDINATE FINAL LOCATIONS OF ALL DIVISION 23 EQUIPMENT IN FIELD WITH DIVISION 23 EQUIPMENT. FIELD LOCATIONS SHALL DICTATE.
 4. COORDINATE MOUNTING HEIGHTS AND LOCATIONS OF ALL DEVICES WITH ARCHITECTURAL ELEVATIONS AND CASEWORK.
 5. CRITICAL BRANCH WIRING FROM ANY PANEL DOWNSTREAM OF AUTOMATIC TRANSFER SWITCHES (ATS-C1 AND ATS-C2) SHALL NOT BE ON THE SAME RACEWAY. CONTRACTOR SHALL MAINTAIN SEPARATION OF THESE TRANSFER SWITCHES AND THEIR DISTRIBUTION ALL THE WAY TO THE LOADS.

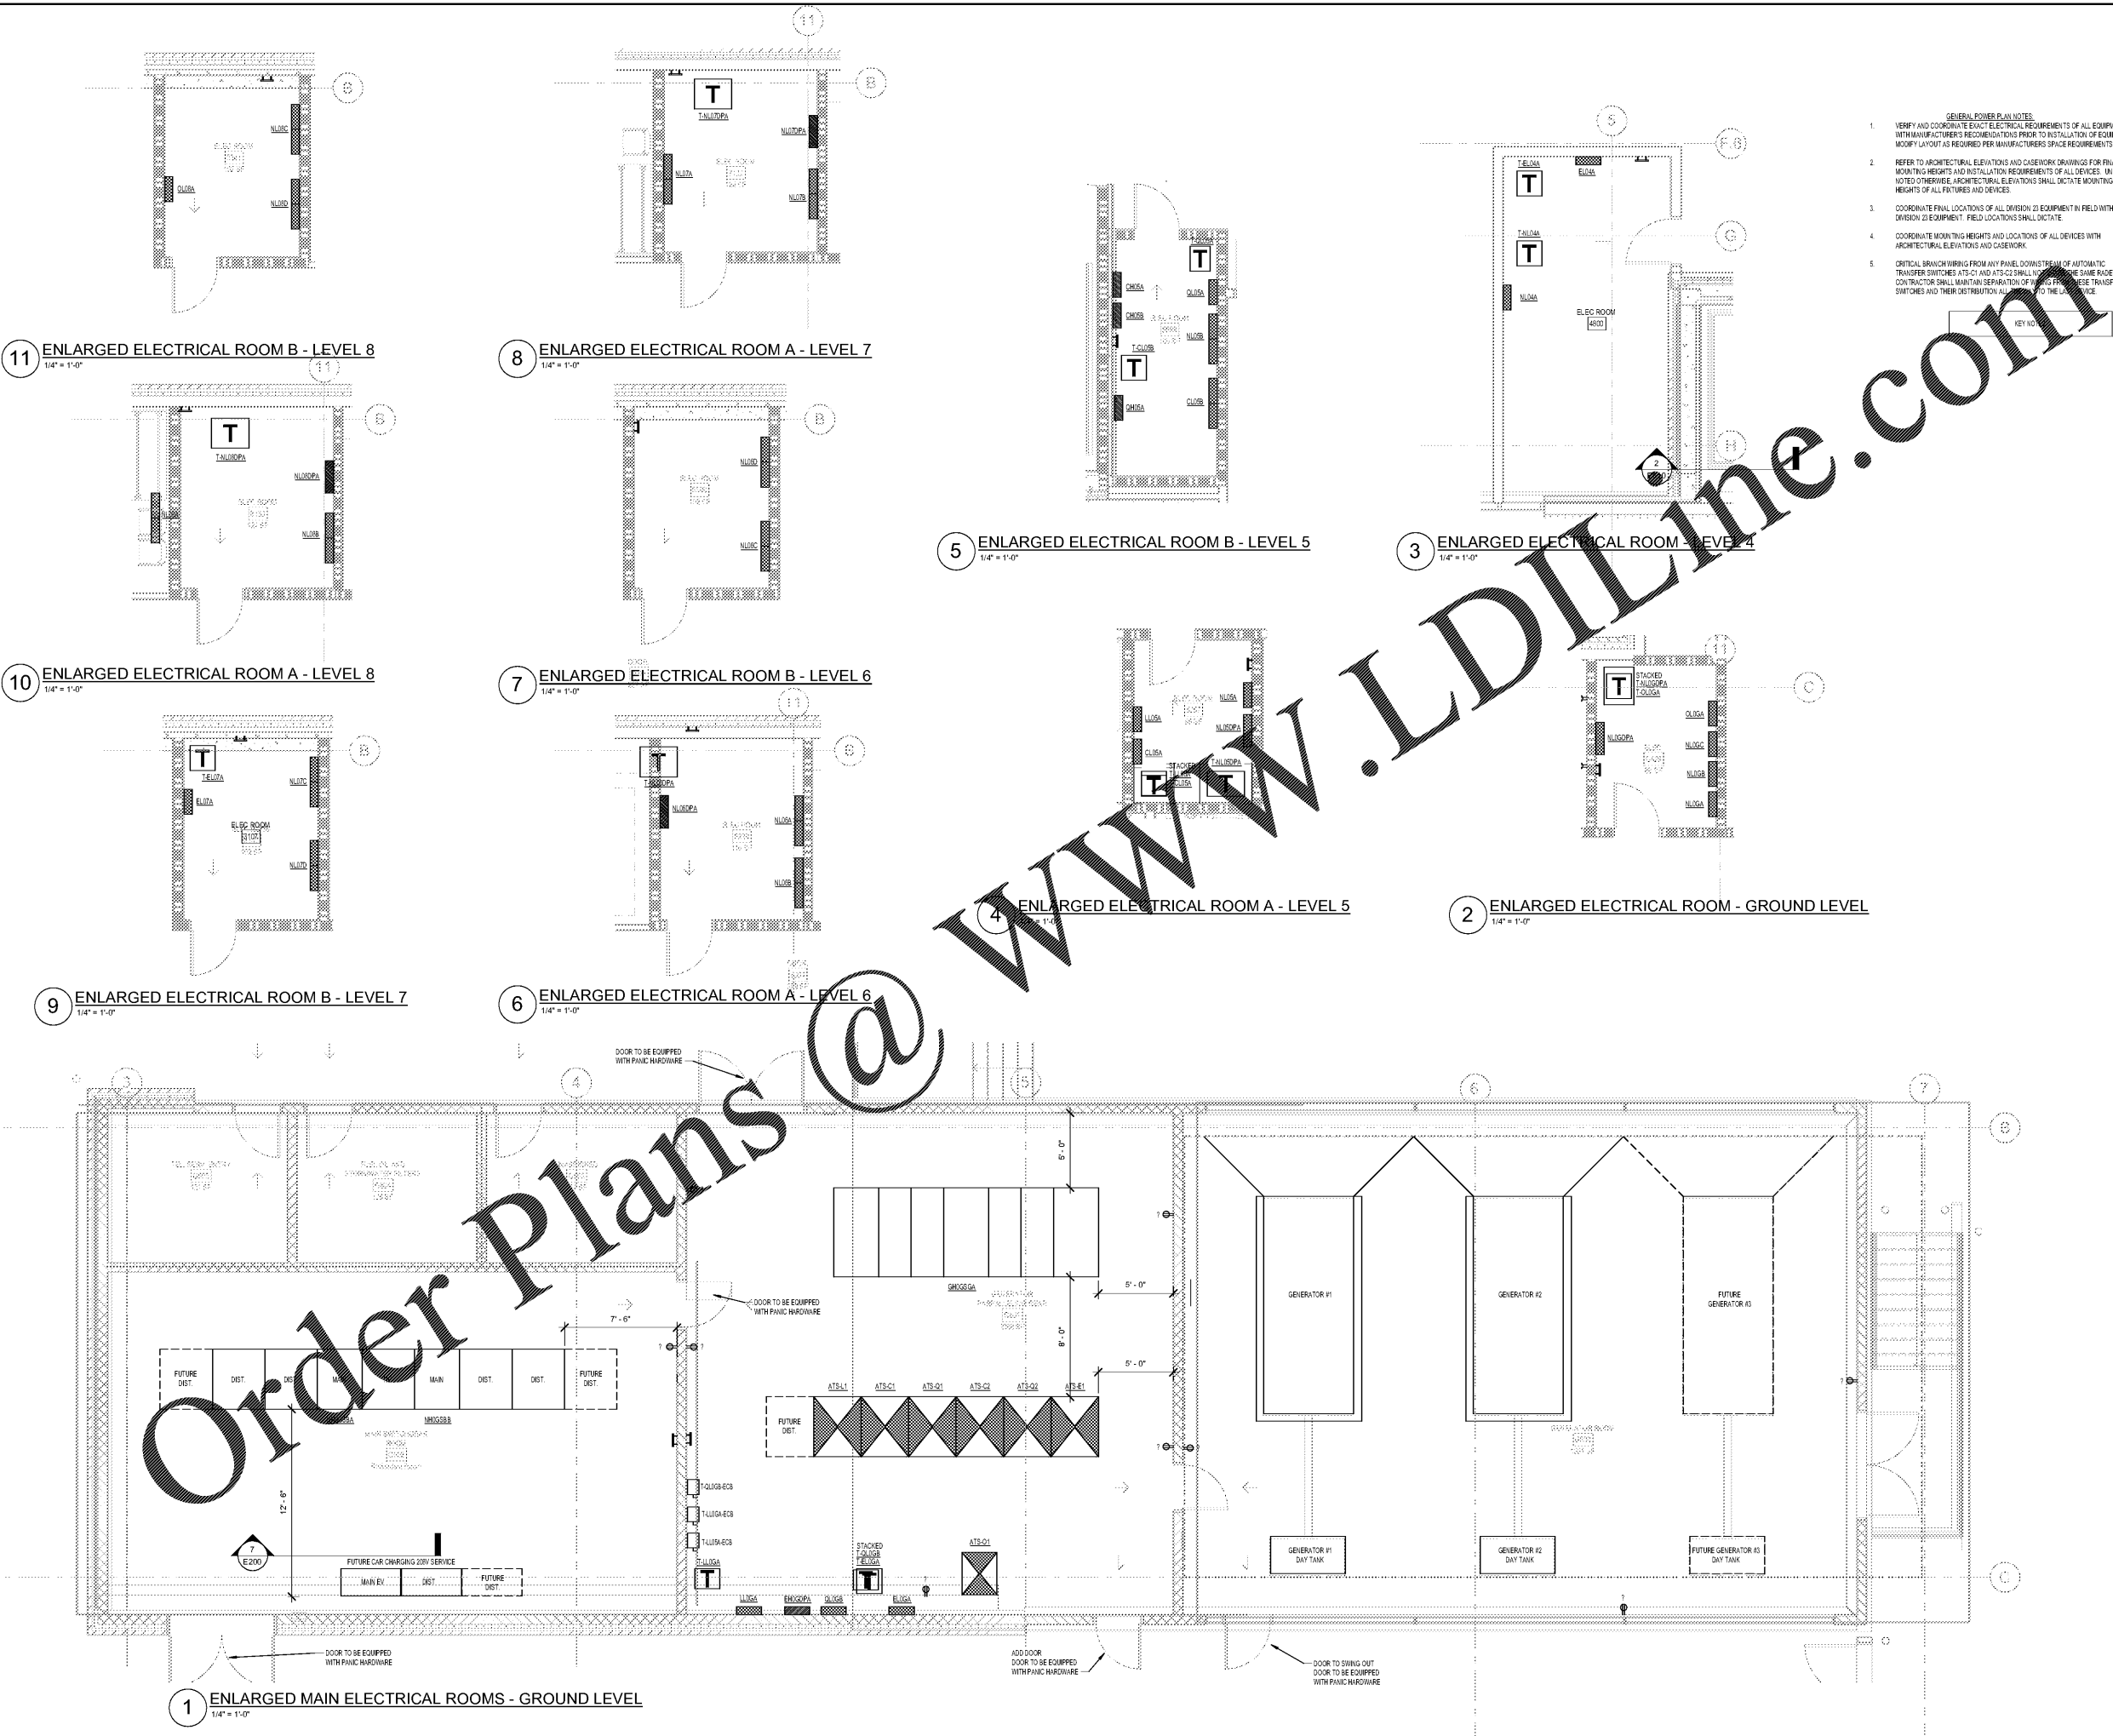

11 ENLARGED ELECTRICAL ROOM B - LEVEL 8
1/4" = 1'-0"

8 ENLARGED ELECTRICAL ROOM A - LEVEL 7
1/4" = 1'-0"

5 ENLARGED ELECTRICAL ROOM B - LEVEL 5
1/4" = 1'-0"

3 ENLARGED ELECTRICAL ROOM - LEVEL 4
1/4" = 1'-0"

10 ENLARGED ELECTRICAL ROOM A - LEVEL 8
1/4" = 1'-0"

7 ENLARGED ELECTRICAL ROOM B - LEVEL 6
1/4" = 1'-0"

4 ENLARGED ELECTRICAL ROOM A - LEVEL 5
1/4" = 1'-0"

2 ENLARGED ELECTRICAL ROOM - GROUND LEVEL
1/4" = 1'-0"

9 ENLARGED ELECTRICAL ROOM B - LEVEL 7
1/4" = 1'-0"

6 ENLARGED ELECTRICAL ROOM A - LEVEL 6
1/4" = 1'-0"

1 ENLARGED MAIN ELECTRICAL ROOMS - GROUND LEVEL
1/4" = 1'-0"

Order Plans @