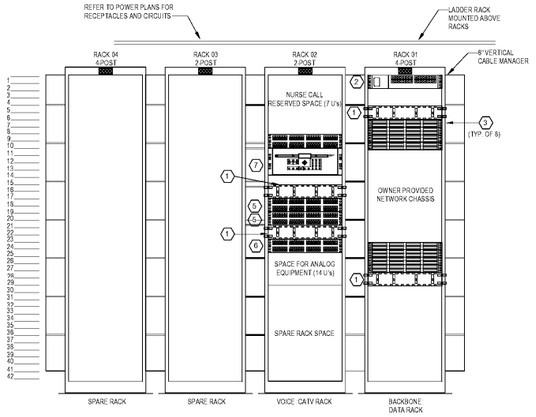

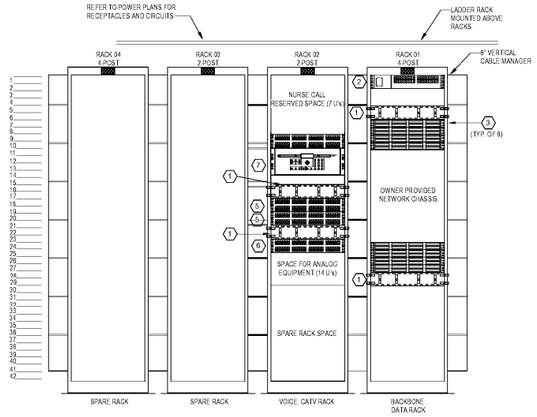

GENERAL NOTES:

1. PROVIDE EQUIPMENT SHOWN FOR EACH ROW OF (3) RACKS.
2. PROVIDE THE REQUIRED PATCH PANELS AND HORIZONTAL CABLE MANAGERS FOR THE VOICE/DATA SHOWN ON PLANS. PROVIDE A 15% SPARE CAPACITY.
3. ALL WIRELESS ACCESS POINT, AND CAMERA CABLING SHALL BE PATCHED INTERMINGLED AMONG THE OTHER NETWORK PATCHING, PER GRADY CASS IS DIRECTION.
4. ALL COPPER PATCH PANELS SHALL BE LABELED HORIZONTALLY, SO THE ODD NUMBERS ARE THE TOP ROW, AND THE EVEN NUMBERS ARE THE BOTTOM ROW, PER GRADY CASS IS DIRECTION.

KEYED NOTES:

1. PROVIDE 2RU WIRE MANAGEMENT SYSTEM TO LOCATION SHOWN.
2. PROVIDE 2RU OPTICAL FIBER PATCH PANEL.
3. PROVIDE 1RU, 48 PORT, ANGLED, HIGH DENSITY PATCH PANEL FOR DATA CABLES TO LOCATION SHOWN.
4. PROVIDE 2RU, 48 PORT CAT6 PATCH PANEL FOR ANALOG VOICE CABLES FROM OUTLETS.
5. PROVIDE 2RU, 48 PORT PATCH PANEL FOR VOICE TIE CABLES FROM 110 BLOCK. PROVIDE PANELS THAT HAVE CONNECTIONS FOR (2) RJ21 WITH (1) PAIR PER PORT.
6. PROVIDE 2RU, 48 PORT CAT6 PATCH PANEL FOR DTV CABLES.
7. PROVIDE Z-BAND EQUIPMENT.

2 TECHNOLOGY - RACK ELEVATIONS - 9TH FLOOR MDF
12" = 1'-0"

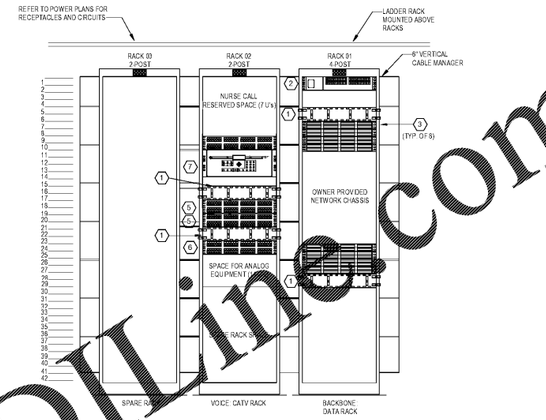

GENERAL NOTES:

1. PROVIDE EQUIPMENT SHOWN FOR EACH ROW OF (3) RACKS.
2. PROVIDE THE REQUIRED PATCH PANELS AND HORIZONTAL CABLE MANAGERS FOR THE VOICE/DATA SHOWN ON PLANS. PROVIDE A 15% SPARE CAPACITY.
3. ALL WIRELESS ACCESS POINT, AND CAMERA CABLING SHALL BE PATCHED INTERMINGLED AMONG THE OTHER NETWORK PATCHING, PER GRADY CASS IS DIRECTION.
4. ALL COPPER PATCH PANELS SHALL BE LABELED HORIZONTALLY, SO THE ODD NUMBERS ARE THE TOP ROW, AND THE EVEN NUMBERS ARE THE BOTTOM ROW, PER GRADY CASS IS DIRECTION.

KEYED NOTES:

1. PROVIDE 2RU WIRE MANAGEMENT SYSTEM TO LOCATION SHOWN.
2. PROVIDE 2RU OPTICAL FIBER PATCH PANEL.
3. PROVIDE 1RU, 48 PORT, ANGLED, HIGH DENSITY PATCH PANEL FOR DATA CABLES TO LOCATION SHOWN.
4. PROVIDE 2RU, 48 PORT CAT6 PATCH PANEL FOR ANALOG VOICE CABLES FROM OUTLETS.
5. PROVIDE 2RU, 48 PORT PATCH PANEL FOR VOICE TIE CABLES FROM 110 BLOCK. PROVIDE PANELS THAT HAVE CONNECTIONS FOR (2) RJ21 WITH (1) PAIR PER PORT.
6. PROVIDE 2RU, 48 PORT CAT6 PATCH PANEL FOR DTV CABLES.
7. PROVIDE Z-BAND EQUIPMENT.

1 TECHNOLOGY - TYPICAL RACK ELEVATIONS - GROUND - 5TH-8TH
12" = 1'-0"

Order Plans @ www.LDLine.com

C:\Users\chris.lorenz\Documents\GRADY\CASS-TLC-TECH_chris.lorenz.rvt

6/27/2019 4:52:45 PM

Grady

Project
THE CENTER FOR ADVANCED SURGICAL SERVICES (CASS)
88 JESSE HILL DRIVE
ATLANTA, GA 30303

Prepared For
GRADY HEALTH SYSTEM
80 JESSE HILL DR. SE
ATLANTA, GA 30303

Hellmuth, Obata & Kassabaum, Inc.
191 Peachtree Street, NE, Suite 2250
Atlanta, GA 30303 USA
t +1 404 439 9000 f +1 404 439 9001

All reproduction & intellectual property rights reserved © 2019

In Association with

TLC ENGINEERING
©Copyright 2019
255 S. Orange Avenue
Suite 1600
Orlando, FL 32801
P 407.841.9050
COA PEF002660
www.tlc-engineers.com
TLC No.: 118648
FRANK, LORENZ, CREARE,

Key Plan



Professional Seals
Emory Neal Boothe, P.E.
Georgia License #PE039005

NOT FOR CONSTRUCTION

No.	Description	Date
3	DD - CMP	2019-07-03

Project No: 18.16013.00

Sheet Title
TECHNOLOGY RACK ELEVATIONS

Original is 30 x 42. Do not scale contents of this drawing.

Sheet Number
T402