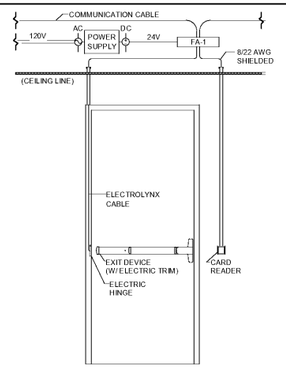

- CARD READER IN
- ELECTRIC TRIM
- RATED ASSEMBLY
- USES FA-1 CONTROL PANEL

LAC-02 DOOR WIRING DIAGRAM — 10

SCALE: N. T. S.

IN ACCORDANCE WITH GRADY CASS STANDARD PRACTICES, THE FOLLOWING COLOR CODE SHALL APPLY TO CABLE AND MODULAR JACKS.

SYSTEM	CABLE COLOR	JACK COLOR
DATA/VOICE	YELLOW	MATCH FACEPLATE
WIRELESS ACCESS POINTS	BLUE	BLUE
PATIENT MONITORING	ORANGE	BY VENDOR
NURSE CALL	SEA-FOAM GREEN	BY VENDOR
DTV OUTLET	VIOLET	VIOLET

STRUCTURED CABLING COLOR CODE — 7

No Scale

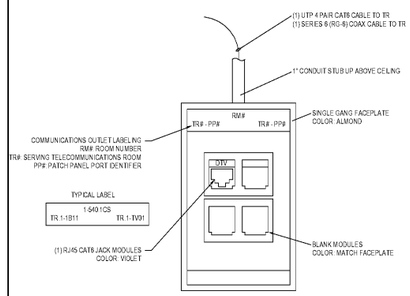

DTV

TYPICAL "DTV" COMMUNICATIONS OUTLET — 4

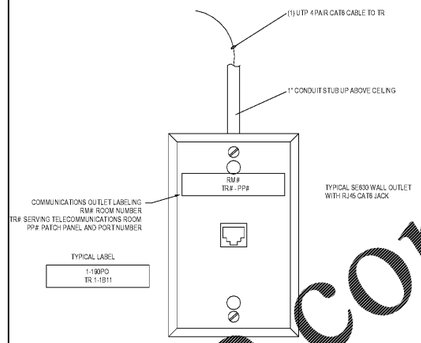

F1
W

TYPICAL WALL PHONE OUTLET — 1

No Scale

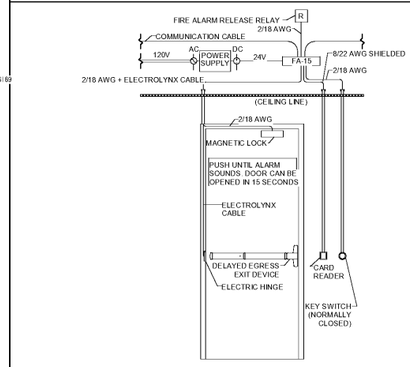

- DELAYED EGRESS
- CARD READER IN
- ELECTRIC TRIM
- MAGNETIC LOCK
- USES FA-15 CONTROL PANEL

LAC-07 DOOR WIRING DIAGRAM — 11

SCALE: N. T. S.

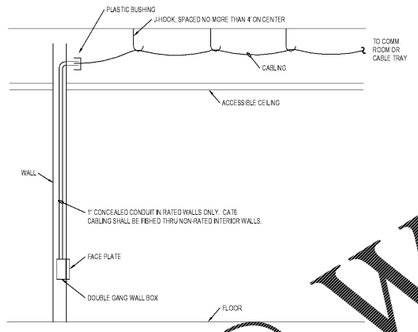

FLUSH OUTLET AND CONDUIT — 8

No Scale

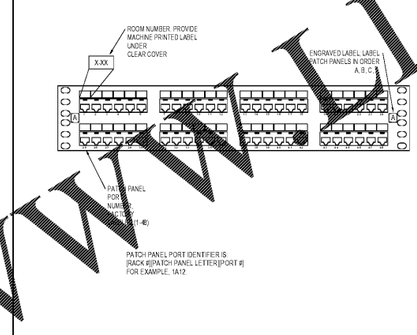

TYPICAL PATCH PANEL LABELING — 5

No Scale

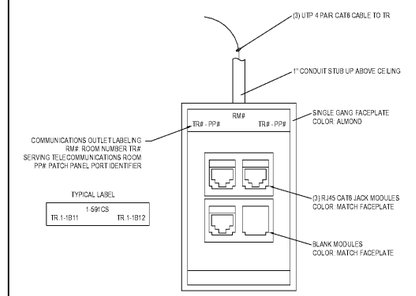

F3

TYPICAL "F3" COMMUNICATIONS OUTLET — 2

No Scale

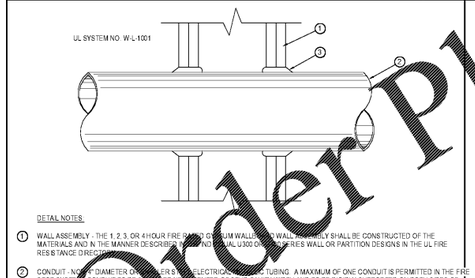

MAXIMUM CONDUIT DIAMETER IN INCHES	ANNULAR SPACE IN INCHES	FIRE RATING IN HOURS	T RATING IN HOURS
1	0 TO 3/16	1 OR 2	0, 1 OR 2
1	1/4 TO 1/2	3 OR 4	3 OR 4
4	0 TO 1-1/2	1 OR 2	0
6	1/4 TO 1/2	3 OR 4	0
12	3/16 TO 3/8	1 OR 2	0

CONDUIT PENETRATION OF FIRE WALL — 12

No Scale

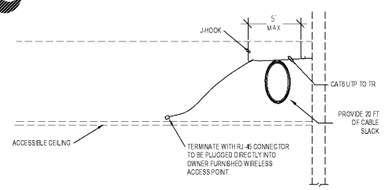

WAP

OUTLET MOUNTING FOR WIRELESS ACCESS POINT — 9

No Scale



NOTES:

1. CABLE LABELS SHALL BE MACHINE PRINTED, SELF-LAMINATING, WRAP AROUND TYPE.
2. LABEL CABLE AT BOTH ENDS. ALLOW SUFFICIENT LENGTH FROM LABEL TO TERMINATION TO RETERMINATE CABLE WITHOUT RE-LABELING.

TYPICAL CABLE I.D. LABEL DETAIL — 6

No Scale

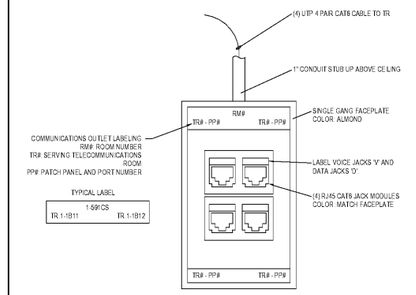

F4

TYPICAL "F4" COMMUNICATIONS OUTLET — 3

No Scale

Order Plans @ WWW.DTline.com

Grady

Project
THE CENTER FOR ADVANCED SURGICAL SERVICES (CASS)
88 JESSE HILL DRIVE
ATLANTA, GA 30303

Prepared For
GRADY HEALTH SYSTEM
80 JESSE HILL DR. SE
ATLANTA, GA 30303

Hellmuth, Obata & Kassabaum, Inc.
191 Peachtree Street, NE, Suite 2250
Atlanta, GA 30303 USA
t +1 404 439 9000 f +1 404 439 9001

All reproduction & intellectual property rights reserved © 2019

In Association with

TLC ENGINEERING for ARCHITECTURE
©Copyright 2019
255 S. Orange Avenue
Suite 1600
Orlando, FL 32801
P 407.841.9050
COA: PEF002660
www.tlc-engineers.com
TLC No.: 118648
FARKAS, LANTZAN, CASSARA,

Key Plan



Professional Seals
Emory Neal Boothe, P.E.
Georgia License #PE039005

NOT FOR CONSTRUCTION

No.	Description	Date
3	DD - GMP	2019-07-03

Project No: 18.16013.00

Sheet Title
TECHNOLOGY DETAILS

Original is 30 x 42. Do not scale contents of this drawing.

Sheet Number
T701

C:\Users\chris.lorenz\Documents\GRADYCASS-TLC-TECH_chris.lorenz.rvt
6/27/2019 4:53:16 PM