


| KITCHEN EQUIPMENT SCHEDULE | | | | | | | | | |
|----------------------------|-------|--------------------------------------|---------|-------------|---------|----------------------|------------|-----------|--|
| ITEM # | Count | DESCRIPTION | VOLTAGE | BASE OFFSET | WATTAGE | CIRCUIT BREAKER SIZE | CONN. PLUG | WIRE SIZE | COMMENTS |
| E01 | 1 | 40#T MANAGEMENT SYSTEM | 120V | 0" | 200 | 20A/1P | 52P | #12.34/C | FLOOR BOX FOR POWER AND DATA |
| E03 | 5 | 55" TV AND MOUNT | 120V | 1'-6" | 200 | 20A/1P | 52P | #12.34/C | |
| E04 | 1 | 65" TV AND MOUNT | 120V | 3'-4" | 200 | 20A/1P | 52P | #12.34/C | WALL MOUNT WALL BORD |
| E07 | 5 | CONV. RECEPT (BAR) | 120V | 3'-2" | 200 | 20A/1P | 52P | #12.34/C | |
| E12 | 1 | GLASS CRACK STORAGE | 120V | 1'-6" | 500 | 20A/1P | 52OR | #12.34/C | |
| E16 | 2 | BLENDER | 120V | 1'-6" | 500 | 20A/1P | 51P | #12.34/C | |
| E19 | 2 | BAR MIXER | 120V | 1'-6" | 1500 | 20A/1P | 51P | #12.34/C | |
| E21 | 1 | BAR BLENDER | 120V | 1'-6" | 1000 | 20A/1P | 51P | #12.34/C | |
| E22 | 1 | 8" GLASS FROSTER | 120V | 1'-6" | 1000 | 20A/1P | 51P | #12.34/C | 2 1/2" CASTERS |
| E24 | 1 | 24" GLASS FROSTER | 120V | 1'-6" | 1000 | 20A/1P | 51P | #12.34/C | 2 1/2" CASTERS |
| E27 | 1 | 10X24 CORNER DRINKBOARD | 120V | 1'-6" | 500 | 20A/1P | 52OR | #12.34/C | |
| E32 | 1 | 24X30 CORNER DRINKBOARD | 120V | 1'-6" | 500 | 20A/1P | 52OR | #12.34/C | |
| E33 | 1 | WINE COOLER | 120V | 1'-6" | 284 | 20A/1P | 51P | #12.34/C | 2 1/2" CASTERS |
| E34 | 1 | LOW PROFILE BACKBAR COOLER | 120V | 1'-6" | 360 | 20A/1P | 51P | #12.34/C | 2 1/2" CASTERS |
| E35 | 1 | POS SYSTEM (BAR) | 120V | 3'-2" | 200 | 20A/1P | 52P | #12.34/C | |
| E35.2 | 2 | POS SYSTEM (BOH) | 120V | 3'-2" | 200 | 20A/1P | 52P | #12.34/C | |
| E37 | 3 | PRINTER (BAR) | 120V | 3'-2" | 480 | 20A/1P | 51P | #12.34/C | |
| E37.2 | 4 | PRINTER (CHEF COUNTER) | 120V | 3'-2" | 480 | 20A/1P | 51P | #12.34/C | |
| E37.3 | 2 | PRINTER (BOH) | 120V | 7'-0" | 480 | 20A/1P | 51P | #12.34/C | |
| E39 | 1 | GLASS WASHER | 208V | 2'-0" | 6700 | 50A/2P | 145OP | #8.34/C | 6" LEGS |
| E41 | 1 | LOW PROFILE BACKBAR COOLER | 120V | 3'-2" | 200 | 20A/1P | 51P | #12.34/C | WALL MOUNT WALL BORD |
| E44 | 2 | POS SYSTEM (TAKE OUT) | 120V | 4'-0" | 200 | 20A/1P | 51P | #12.34/C | |
| E45 | 1 | CAR TOPPER | 120V | 1'-6" | 480 | 20A/1P | 51P | #12.34/C | X |
| E46 | 5 | PRINTER (TAKE OUT) | 120V | 4'-0" | 200 | 20A/1P | 51P | #12.34/C | |
| E48 | 5 | SURVEILLANCE MONITOR | 120V | 9'-0" | 200 | 20A/1P | 51P | #12.34/C | |
| E49 | 1 | DELIVERY MONITOR | 120V | 6'-2" | 200 | 20A/1P | 51P | #12.34/C | 6A0 |
| E50 | 1 | TAKE OUT UTILITY | 120V | 1'-6" | 200 | 20A/1P | 51P | #12.34/C | |
| E51 | 1 | AIR CURTAIN | 120V | 1'-6" | 200 | 20A/1P | 51P | #12.34/C | |
| E56 | 1 | WALK IN COOLER | 208V | 8'-6" | 1040 | 20A/2P | 51P | #12.34/C | FOR ITEM 55 |
| E59 | 1 | MEDIUM TEMP REMOTE CONDENSER | 208V | 1'-6" | 2080 | 20A/3P | 51P | #12.34/C | FOR ITEM 55, LOCATED ON ROOF |
| E67 | 1 | WALK IN COOLER | 120V | 8'-6" | 2400 | 20A/1P | 51P | #12.34/C | |
| E68 | 1 | MEDIUM TEMP BLOWER COIL | 208V | 1'-6" | 2080 | 20A/3P | 51P | #12.34/C | FOR ITEM 67 |
| E71 | 1 | MED. TEMP. REMOTE CONDENSER | 208V | 1'-6" | 1440 | 20A/3P | 51P | #12.34/C | |
| E73 | 1 | WALK IN COOLER | 120V | 8'-6" | 2400 | 20A/1P | 51P | #12.34/C | |
| E76 | 1 | LOW TEMP BLOWER COIL | 208V | 8'-6" | 2288 | 20A/2P | 51P | #12.34/C | FOR ITEM 73 |
| E77 | 1 | WALK IN FREEZER | 120V | 9'-6" | 2288 | 20A/1P | 51P | #12.34/C | |
| E82 | 1 | 50X60 PREP TABLE | 120V | 9'-6" | 1000 | 20A/1P | 50.2OR | #12.34/C | |
| E84 | 1 | BLENDER WITH TMR | 120V | 9'-6" | 1200 | 20A/1P | 51P | #12.34/C | |
| E84 | 1 | 30 QT MIXER | 120V | 9'-6" | 860 | 20A/1P | 51P | #12.34/C | |
| E86 | 1 | POTATO STEAMER | 208V | 9'-6" | 6000 | 30A/3P | 51P | #12.34/C | |
| E88 | 1 | TWO COMPARTMENT SINK | 120V | 9'-6" | 200 | 20A/1P | 52OR | #12.34/C | |
| E102 | 2 | SALAD DRYER | 120V | 9'-6" | 720 | 20A/1P | 51P | #12.34/C | |
| E114 | 1 | COOK AND HOLD (UTILITIES ONLY) | 120V | 9'-6" | 1920 | 20A/1P | 52P | #12.34/C | |
| E116 | 1 | BAG IN BOX SODA SYSTEM | 120V | 7'-6" | 500 | 20A/1P | 51P | #12.34/C | BY SODA VENDOR |
| E120 | 1 | BEER BLAST SYSTEM | 120V | 7'-6" | 960 | 20A/1P | 51P | #12.34/C | BY PURVEYOR |
| E121 | 1 | REMOTE BEER COOLING SYSTEM | 120V | 9'-6" | 1840 | 20A/1P | 52P | #12.34/C | ETL |
| E124 | 1 | DIGITAL CLOCK | 120V | 1'-6" | 200 | 20A/1P | 52P | #12.34/C | |
| E128 | 1 | HEAT RECOVERY REFRIGERATOR | 120V | 7'-0" | 605 | 20A/1P | 51P | #12.34/C | HALF DOORS |
| E127 | 1 | DRILL LIC REFRIGERATOR | 120V | 7'-0" | 460 | 20A/1P | 51P | #12.34/C | |
| E128 | 1 | SUPER STEAMER MICROWAVE | 208V | 6'-0" | 4400 | 30A/2P | 63OP | #10.34/C | |
| E134 | 1 | 60" GRID/ GAS | 120V | 7'-0" | 120 | 20A/1P | 51P | #12.34/C | |
| E140 | 1 | UG REFRIGERATED DRAWERS | 120V | 7'-0" | 575 | 20A/1P | 51P | #12.34/C | |
| E144 | 1 | 30" SAUTE REFRIGERATOR | 120V | 7'-0" | 575 | 20A/1P | 51P | #12.34/C | |
| E147 | 1 | CONVECTION OVEN GAS | 120V | 2'-0" | 960 | 20A/1P | 51P | #12.34/C | INCLUDED IN ITEM 148 |
| E149 | 1 | CONVECTION OVEN GAS | 120V | 2'-0" | 960 | 20A/1P | 51P | #12.34/C | INCLUDED IN ITEM 148 |
| E152 | 1 | DRYER BATTERY WITH FILTER | 120V | 2'-0" | 120 | 20A/1P | 51P | #12.34/C | |
| E152.1 | 1 | DRYER FILTER PUMP | 120V | 2'-0" | 1500 | 20A/2P | 51P | #12.34/C | NOT SHOWN FOR ITEM 152 |
| E153 | 1 | REF. BREADING STATION | 120V | 2'-0" | 1725 | 20A/1P | 51P | #12.34/C | WITH OVERSELS-F |
| E154 | 1 | EXHAUST HOOD (MAIN COOKLINE) | 120V | 8'-6" | 575 | 20A/1P | 51P | #12.34/C | VERIFY REQUIREMENTS WITH MANU. SHOP DWGS |
| E157 | 1 | EXHAUST HOOD (MAIN COOKLINE) | 120V | 8'-6" | 575 | 20A/1P | 51P | #12.34/C | VERIFY REQUIREMENTS WITH MANU. SHOP DWGS |
| E159 | 1 | EXHAUST HOOD (MAIN COOKLINE) | 120V | 8'-6" | 575 | 20A/1P | 51P | #12.34/C | VERIFY REQUIREMENTS WITH MANU. SHOP DWGS |
| E162 | 1 | EXHAUST HOOD (MAIN COOKLINE) | 120V | 8'-6" | 575 | 20A/1P | 51P | #12.34/C | VERIFY REQUIREMENTS WITH MANU. SHOP DWGS |
| E166 | 1 | FIRE SUPPRESSION SYSTEM | 120V | 8'-6" | 575 | 20A/1P | 51P | #12.34/C | PRE-PIPED HOODS |
| E169 | 3 | DRIPPERWELL | 120V | 1'-6" | 480 | 20A/1P | 52P | #12.34/C | |
| E172 | 1 | ICE CREAM CABINET | 120V | 1'-6" | 230 | 20A/1P | 51P | #12.34/C | WITH CASTERS |
| E174 | 1 | REF. SALAD MAKEUP TABLE | 120V | 1'-6" | 1600 | 20A/1P | 52P | #12.34/C | |
| E175 | 1 | WORKTOP REFRIGERATOR | 120V | 1'-6" | 388 | 20A/1P | 51P | #12.34/C | E175 |
| E176 | 1 | UNDERCOUNTER FREEZER W/ THAW DRAWERS | 120V | 1'-6" | 299 | 20A/1P | 51P | #12.34/C | 2" CASTERS |
| E179 | 3 | FOOD WARMER | 120V | 1'-6" | 1450 | 20A/1P | 51P | #12.34/C | |
| E181 | 1 | POTATO HOLDING DRAWERS | 120V | 6'-0" | 1290 | 20A/1P | 51P | #12.34/C | |
| E184 | 1 | COOK AND HOLD | 120V | 1'-6" | 1752 | 20A/1P | 51P | #12.34/C | |
| E185 | 1 | UNDERCOUNTER REF. W/ DRAWERS | 120V | 1'-6" | 388 | 20A/1P | 51P | #12.34/C | 2 1/2" CASTERS |
| E188 | 1 | HEAT LAMP | 208V | 8'-0" | 1400 | 20A/2P | 51P | #12.34/C | WITH REMOTE TOGGLE SWITCH |
| E189 | 1 | HEAT LAMP | 208V | 6'-0" | 3420 | 20A/2P | 51P | #12.34/C | |
| E190 | 1 | HEAT LAMP (SOUP BOWLS) | 208V | 6'-0" | 800 | 20A/2P | 51P | #12.34/C | WITH REMOTE TOGGLE SWITCH |
| E192 | 1 | HEAT LAMP | 208V | 6'-0" | 2550 | 20A/2P | 51P | #12.34/C | WITH REMOTE TOGGLE SWITCH |
| E193 | 1 | HEAT LAMP | 208V | 6'-0" | 2420 | 20A/2P | 51P | #12.34/C | WITH REMOTE TOGGLE SWITCH |
| E194 | 4 | MICROWAVE | 208V | 6'-0" | 1700 | 20A/2P | 62OP | #12.34/C | |
| E195 | 1 | WORKTOP REF. W/ DRAWERS | 120V | 1'-6" | 388 | 20A/1P | 51P | #12.34/C | |
| E197 | 1 | 1000W MICROWAVE OVEN | 120V | 1'-6" | 1550 | 20A/1P | 51P | #12.34/C | |
| E200 | 3 | POS SYSTEM | 120V | 3'-2" | 200 | 20A/1P | 51P | #12.34/C | |
| E209 | 2 | ICE COOLED DROP IN DISPENSER | 120V | 2'-0" | 1650 | 20A/1P | 51P | #12.34/C | BY SODA VENDOR WITH BASE |
| E214 | 1 | COFFEE BREWER | 120V | 7'-0" | 1880 | 20A/1P | 51P | #12.34/C | |
| E216 | 1 | ICED TEA BREWER | 120V | 7'-0" | 1600 | 20A/1P | 51P | #12.34/C | BY PURVEYOR |
| E221 | 1 | BREAD OVEN | 208V | 2'-0" | 3744 | 20A/2P | 63OP | #12.34/C | |
| E223 | 2 | ICE MACHINE | 120V | 0" | 230 | 20A/1P | 51P | #12.34/C | |
| E224 | 2 | LOW TEMP REMOTE CONDENSER | 208V | 1'-6" | 3162 | 20A/2P | 51P | #12.34/C | |
| E236 | 1 | RACK CONVEYOR DISHWASHER | 208V | 0" | 13200 | 70A/3P | NA-110/C | #14-110/C | |
| E237 | 1 | BOOSTER HEATER | 208V | 0" | 30000 | 80A/3P | NA-112/C | #14-112/C | FOR ITEM 236 |

ELECTRICAL SYMBOL LEGEND

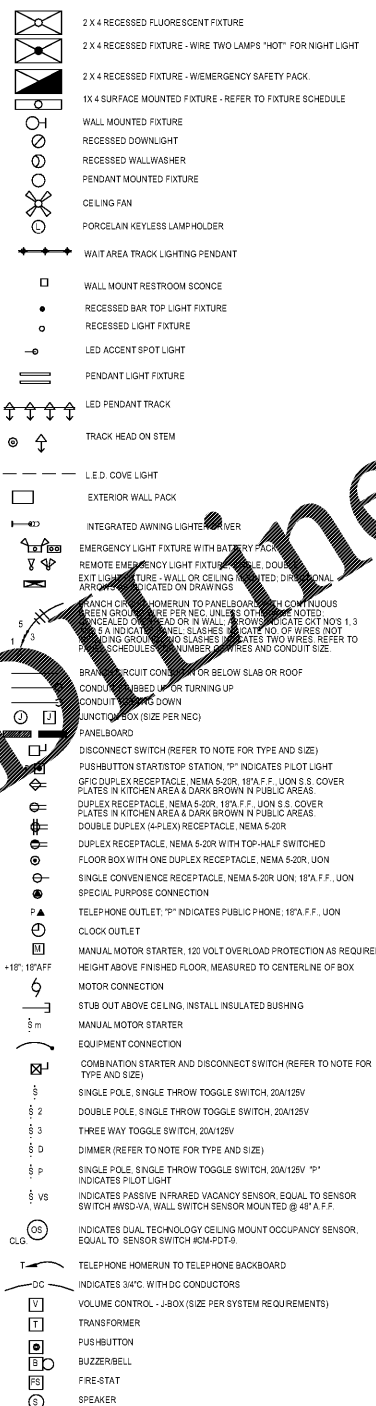

ABBREVIATIONS

| | | | |
|-----|--------------------------|---------|-----------------------|
| GRD | GROUND | CKT BRK | CIRCUIT BREAKER |
| NEC | NATIONAL ELECTRICAL CODE | DISC SW | DISCONNECT SWITCH |
| CKT | CIRCUIT | CU | COPPER |
| AFV | ABOVE FINISHED FLOOR | MLO | MAIN LUGS ONLY |
| C | CIRCUIT | MB | MAIN BREAKER |
| NC | NOT IN CONTRACT | SN | SOLD NEUTRAL |
| SBO | SUPPLIED BY OWNER | GC | GENERAL CONTRACTOR |
| NF | NON FUSED | MC | MECHANICAL CONTRACTOR |
| UN | UNLESS OTHERWISE NOTED | JB | JUNCTION BOX |
| EC | ELECTRICAL CONTRACTOR | DC | DIRECT CURRENT |

GENERAL NOTES

- THE EQUIPMENT ROUGH-INS AS SHOWN ARE ACCURATE TO THE BEST OF OUR KNOWLEDGE. HOWEVER, IN SOME INSTANCES, THE OWNER OR SUPPLIER MAY SUBSTITUTE OR THE EQUIPMENT MAY VARY FROM WHAT IS SHOWN. THEREFORE, THE CONTRACTOR SHALL VERIFY ALL CRITICAL DIMENSIONS WITH THE OWNER PRIOR TO CONSTRUCTION. FAILURE OF THE CONTRACTOR TO VERIFY THESE DIMENSIONS SHALL PLACE THE RESPONSIBILITY FOR ANY SUBSEQUENT RELOCATION DIRECTLY UPON THE CONTRACTOR.
- ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE LATEST EDITION OF THE NEC AND STATE AND LOCAL CODES AS THEY APPLY.
- MATERIALS, EQUIPMENT, AND SYSTEMS SHALL MEET ALL PERTINENT REQUIREMENTS OF THE AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI), THE NATIONAL ELECTRIC CODE (NEC), THE NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION (NEMA), NATIONAL FIRE PROTECTION ASSOCIATION (NFPA), AMERICAN NATIONAL STANDARDS INSTITUTE (ANSI), AND OTHER NATIONALLY RECOGNIZED AGENCIES AS WELL AS APPLICABLE LOCAL CODES.
- STARTERS SHALL BE LICENSED CONTRACTORS IN ACCORDANCE WITH LOCAL AND STATE LAWS.
- STARTERS AND RELATED WIRING SHALL BE INSTALLED BY ELECTRICAL CONTRACTOR. OVERLOAD UNITS SHALL BE INSTALLED AS PER NAME PLATE DATA ON EQUIPMENT EXCEPT FOR SUCH ITEMS AS ARE NORMALLY SUPPLIED WITH STARTERS INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. ALL STARTERS SHALL BE SUPPLIED AND INSTALLED BY THE ELECTRICAL CONTRACTOR. THE ELECTRICAL CONTRACTOR WILL MOUNT ALL SUCH STARTERS, AS DIRECTED, FURNISHING SUPPORTING STRUCTURES WHERE NECESSARY.
- ANY FEES ASSOCIATED WITH CONSTRUCTION, PERMITTING AND TESTING SHALL BE BORNE BY THE CONTRACTOR IN ORDER TO DELIVER TO THE OWNER A FINISHED BUILDING, READY FOR OCCUPANCY AND 100% OPEN.
- TWO COPIES OF OPERATION AND MAINTENANCE MANUALS FOR THE EQUIPMENT, HEREIN INSTALLED SHALL BE GIVEN TO THE OWNER PRIOR TO ACCEPTANCE OF THE BUILDING FOR OCCUPANCY.
- PANEL BOARD AND EMERGENCY LIGHTING PANELS SHALL BE LABELED WITH RESPECT TO THE VOLTAGE AND PHASE. "EL" "A" "1000000" LABEL SHALL BE PROVIDED TO IDENTIFY WHITE LEADS AND BLACK BACKGROUND LABELS SHALL BE PROVIDED TO IDENTIFY RED LEADS AND BLACK BACKGROUND LABELS SHALL BE PROVIDED TO IDENTIFY BLUE LEADS. ALL PANEL BOARDS SHALL BE LABELED AT 75% MINIMUM. PANEL BOARDS SHALL BE PROVIDED WITH A CLEAR ACCESS TO THE MAIN DISCONNECT TO INSIDE OF PANEL DOOR WITH A CLEAR ACCESS TO THE MAIN DISCONNECT TO INSIDE OF PANEL DOOR.
- ALL SUBMITTALS MUST BE SET OUT IN FRONT OF THE LIGHTED OR RED LINED TO INDICATE PRODUCT NUMBER, INCLUDING SUPPLY AND OPTIONS AND SHALL BE SUBMITTED TO THE ARCHITECT AND THE ARCHITECT'S HARD COPIES OF SUBMITTALS SHALL NOT BE REVIEWED.
- WHERE THERE ARE DISCREPANCIES BETWEEN THE CONTRACT DOCUMENTS THAT DO NOT FALL WITHIN THE SCOPE OF INSTALLATION OR NATURE OF WORK REQUIRED, THE CONTRACTOR SHALL MAKE SUCH CHANGES WITHOUT ADDITIONAL COST TO THE OWNER. NO OTHER CHANGES MAY BE MADE WITHOUT WRITTEN PERMISSON OF THE OWNER.
- THE CONTRACTOR SHALL GUARANTEE ALL WORK FOR WHICH MATERIALS ARE FURNISHED, FABRICATED OR FIELD ERRECTED, ALL FACTORY ASSEMBLED EQUIPMENT FOR WHICH NO SPECIFIC MANUFACTURER'S GUARANTEE IS FINISHED, AND ALL WORK IN CONNECTION WITH INSTALLING MANUFACTURER'S GUARANTEED EQUIPMENT. THIS CONTRACTOR'S GUARANTEE SHALL EXIST FOR A PERIOD OF ONE (1) YEAR FROM THE DATE OF FINAL OWNER ACCEPTANCE OF THE WORK AND SHALL APPLY TO DEFECTS IN MATERIALS AND TO DEFECTIVE WORKMANSHIP OF ANY KIND.
- BOIDERS SHALL THOROUGHLY ACQUAINT THEMSELVES WITH THE CONDITIONS UNDER WHICH THE WORK IS TO BE PERFORMED. THEY SHALL EXAMINE ALL SERVICES, EQUIPMENT, SURFACES, ETC. WHICH THEIR WORK IS IN ANY WAY DEPENDENT UPON, AND BRING ANY DISCREPANCIES DETERMINED OR OMISSIONS FOUND IN THE DRAWINGS TO THE OWNER'S ATTENTION BEFORE SUBMITTING BID.
- TRADE NAMES ARE GIVEN TO CLARIFY TYPE OF PRODUCT AND QUALITY DESIRED. CONTRACTORS SHALL VERIFY VOLTAGE WITH UTILITY COMPANY AND REVERSE AND BALANCE PANELS AS REQUIRED.
- CONTRACTOR SHALL VERIFY LOCATION OF PARKING LOT LIGHTS AND Pylon SIGNS ON INDIVIDUAL SITE PLAN.
- ALL REMOTE DISCONNECTS ON ROOF OR GROUND SHALL HAVE A DISCONNECT SWITCH AT EACH PIECE OF EQUIPMENT. FURNISH FUSED DISCONNECTS AS REQUIRED BY NEC.
- ANYTHING DRAWN OR SPECIFIED SHALL NOT BE CONSTRUED TO CONFLICT WITH ANY LOCAL, MUNICIPAL OR STATE LAW, REGULATION OR ORDINANCE WHICH GOVERNS THE INSTALLATION OF ANY ELECTRICAL RELATED WORK. ITEMS SHALL NOT BE INSTALLED IN CONFLICT WITH THE NEC, RESOLVE ANY AND ALL CONFLICTS BEFORE INSTALLATION AT NO ADDITIONAL EXPENSE TO THE OWNER.
- INSTALL ALL CONDUIT PASSING THROUGH WALLS, COOLERS, WALL AROUND CONDUIT WITH O-RING SEAL WHERE IT PASSES THROUGH CO