

SEAL:

**THIS DOCUMENT IS NOT
FOR REGULATORY
APPROVAL, PERMITTING,
OR CONSTRUCTION.**

GENERAL NOTES

- A. FIRE EXTINGUISHER: 10# ABC WITH UL RATING 4A-60BC. SURFACE MOUNTED ON WALL WITH MANUFACTURERS ALL STEEL WALL BRACKET. J.L INDUSTRIES INC. (COSMIC 10E) OR APPROVED EQUAL WITH INSPECTION TAG AS REQUIRED BY LOCAL CODES.
- B. SIGNS STATING THE MAXIMUM OCCUPANT CONTENT SHALL BE CONSPICUOUSLY POSTED IN EACH AREA OF ASSEMBLY, ASSEMBLY ROOM, OR ROOM USED FOR SIMILAR PURPOSE.
- C. MAXIMUM EFFORT TO OPERATE DOORS SHALL NOT EXCEED: 5.0 L.B.F. FOR INTERIOR DOORS.
- D. ALL DOORS SHALL BE KEYLESS IN DIRECTION OF EGRESS.

KEY NOTES

- 1. PROVIDE LEVEL LANDINGS EACH SIDE OF DOORS PER FBC 1008.1. PROVIDE A MAXIMUM THRESHOLD HEIGHT OF 1/2" WITH BEVELED EDGE PER FBC-ACCESSIBILITY, 303.3.
 - 1.1 - LANDING AREA TO BE 54" WIDE X 60" DEEP. 18" CLEAR AT PULL SIDE OF DOOR STRIKE SIDE.
 - 1.2 - LANDING AREA TO BE 48" WIDE X 48" DEEP. 12" CLEAR AT PUSH SIDE OF DOOR STRIKE SIDE.
 - 1.3 - LANDING AREA TO BE 72" WIDE X 60" DEEP.
 - 1.4 - LANDING AREA TO BE 72" WIDE X 48" DEEP.
- 2. ALTERNATE WATER EMERGENCY SHUT-OFF FOR FUEL (SEE ELECT. DWGS.)

LEGEND

- EXIT SIGN
- FIRE EXTINGUISHER
- EMERGENCY LIGHT
- 44" EGRESS PATH (MIN.)

OCCUPANCY LOAD

OCCUPANT LOAD ANALYSIS
2017 FLORIDA FIRE PREVENTION CODE 6TH ED. NFPA 101:

MERCHANDISE	2540/30 = 85
SALES	297/100 = 3
OFFICE	56/100 = 1
WORKROOM	413/300 = 1
COOLER VAULT	368/300 = 1
BEER CAVE	237/300 = 1

TOTAL OCCUPANT LOAD = 92 PEOPLE
MINIMUM NUMBER OF EXITS: 2 REQUIRED AND X PROVIDED.

EGRESS WIDTH REQUIRED = 2 X OCCUPANT LOAD
= 2 X 92 = 18.4 INCHES
EGRESS WIDTH PROVIDED = 102 INCHES

MAXIMUM TRAVEL DISTANCE TO AN EXIT:
DOES NOT EXCEED 200' (UNSPRINKLED CRITERIA)
FIRE EXTINGUISHERS: PROVIDE (2) 4A,60-BC F.E.,
BRACKET MOUNTED- VERIFY LOCATIONS W/ LOCAL FIRE INSPECTOR.

NO.	DATE	REVISIONS
1	03.18.19	PEER COMMENTS
		REMARKS




BID SET
JUNE 27, 2019
**7-ELEVEN
STORE #38777**
12060 US 301 N
PARRISH, FL
34219

PROJECT NO: 2018.0891
DATE: FEBRUARY 26, 2019

A0.2
LIFE SAFETY PLAN

CHECKED: RW DRAWN: JUM

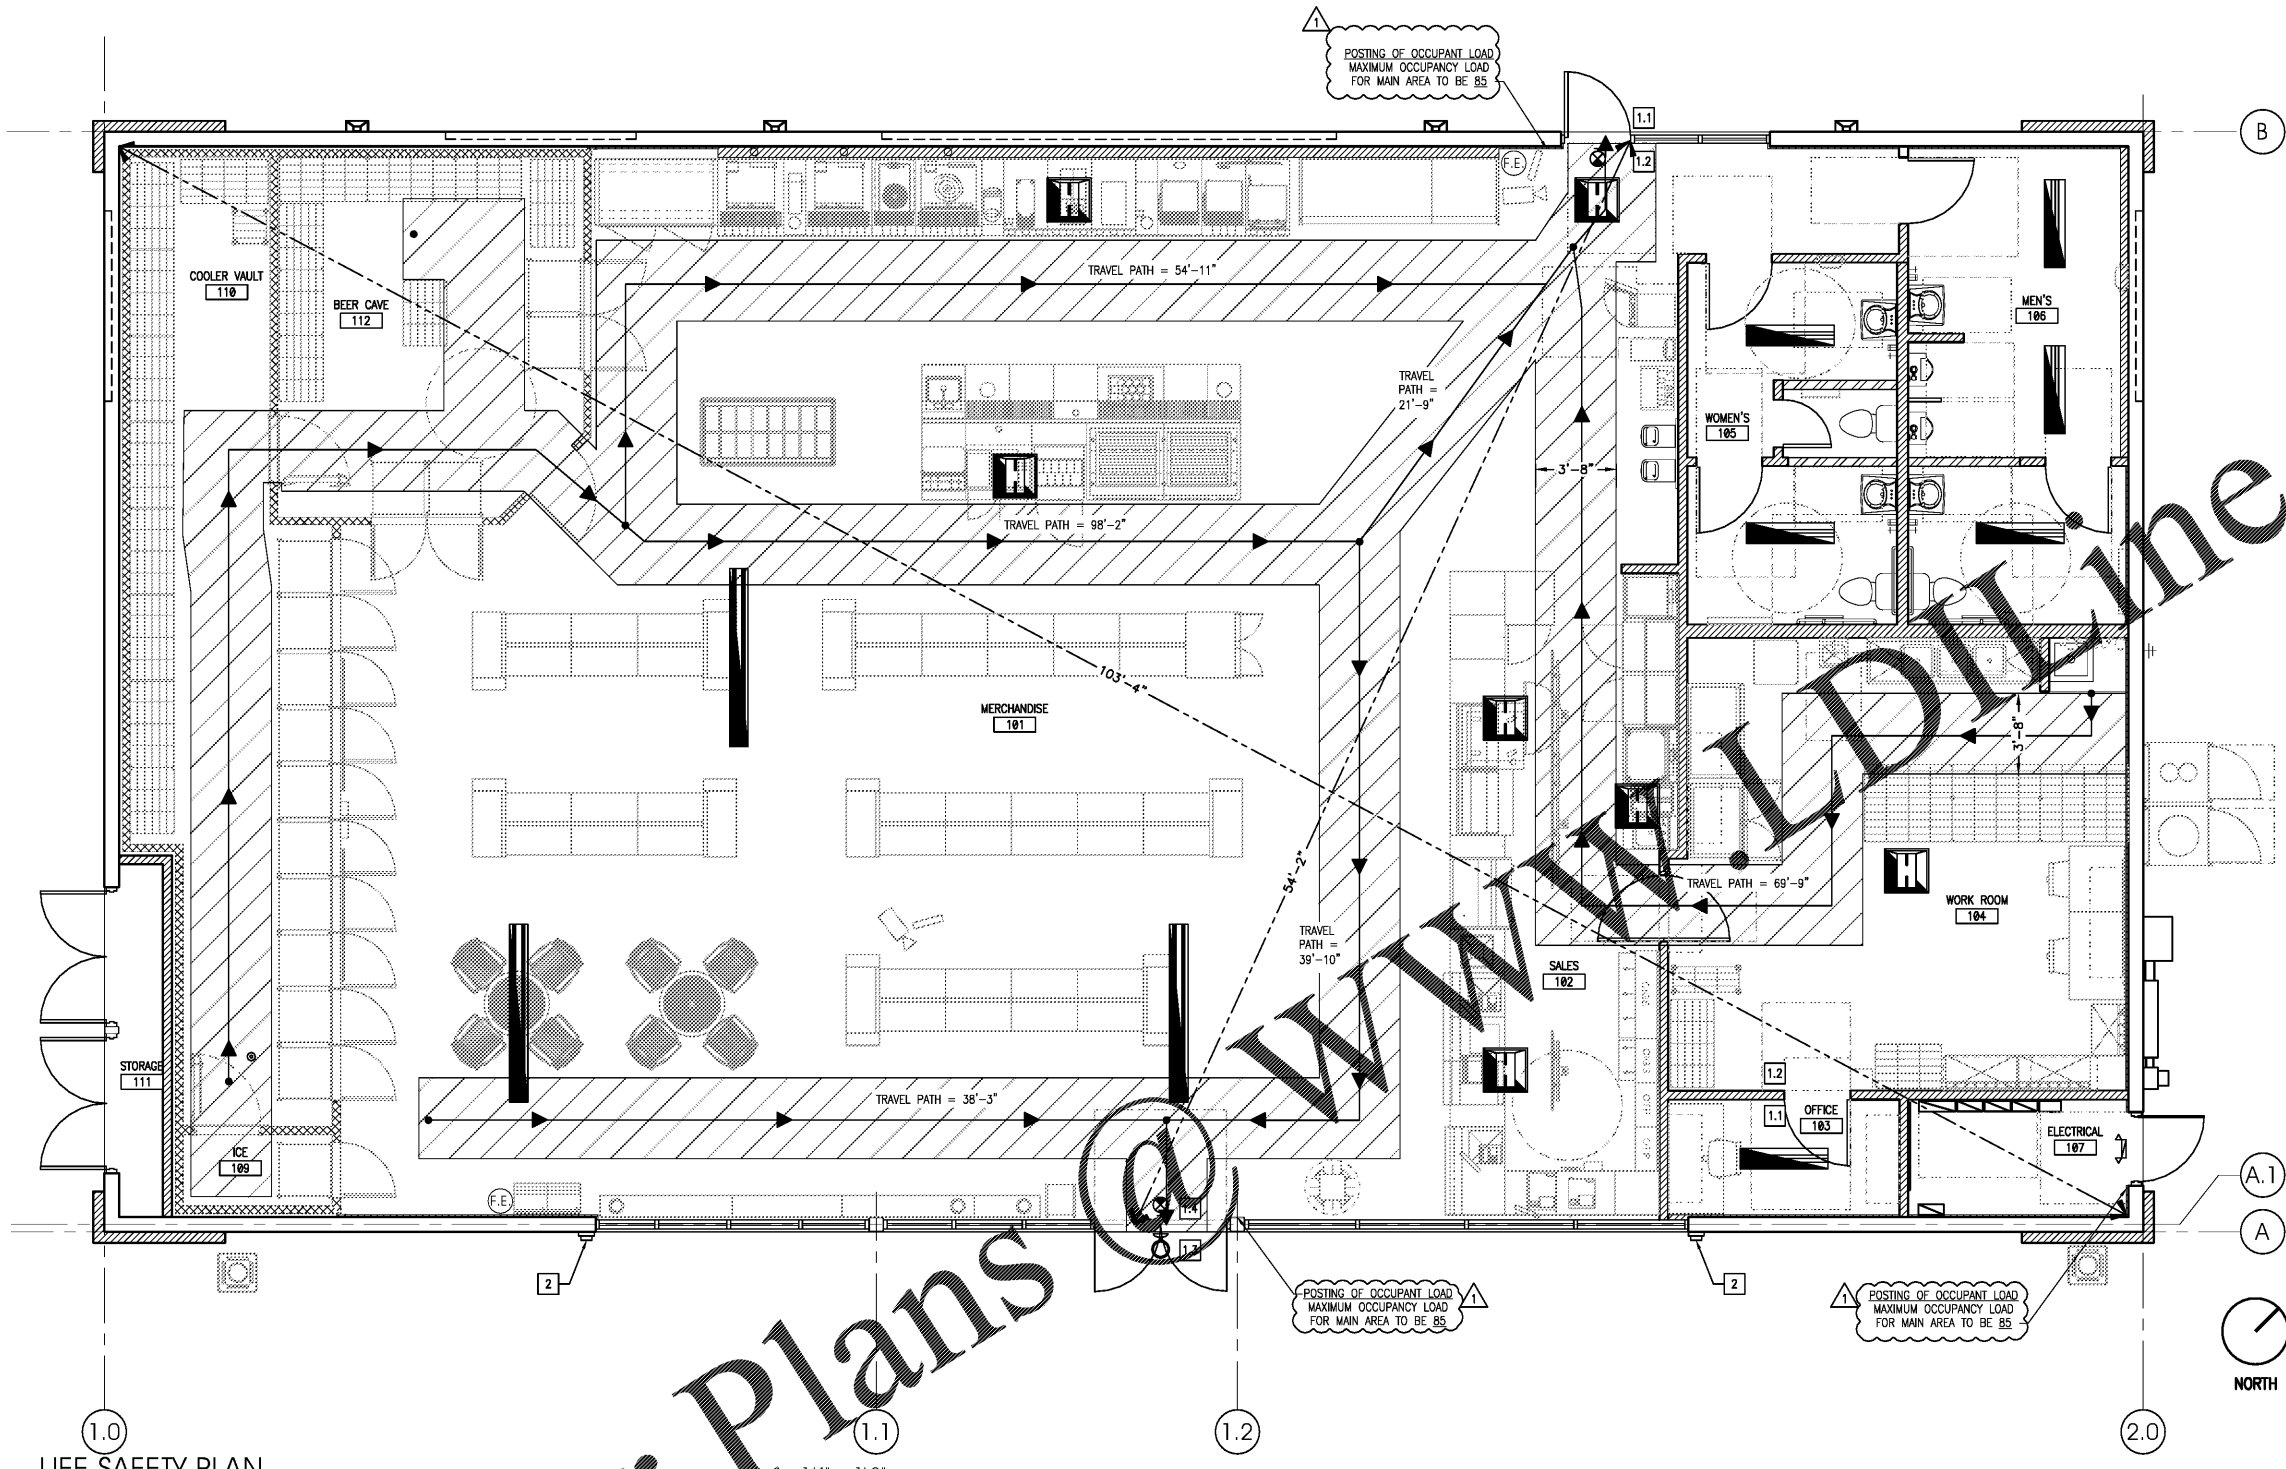

POSTING OF OCCUPANT LOAD
MAXIMUM OCCUPANCY LOAD
FOR MAIN AREA TO BE 85

POSTING OF OCCUPANT LOAD
MAXIMUM OCCUPANCY LOAD
FOR MAIN AREA TO BE 85

POSTING OF OCCUPANT LOAD
MAXIMUM OCCUPANCY LOAD
FOR MAIN AREA TO BE 85

1.0 LIFE SAFETY PLAN

1/4" = 1'-0"

Order Plans @ www.dline.com

COPYRIGHT © 2019 INTERPLAN LLC. RESERVE COPYRIGHT & OTHER RIGHTS RESTRICTING THESE DOCUMENTS TO THE ORIGINAL SET OR TAPSCREED WHICH THEY WERE PREPARED. REPRODUCTIONS, CHANGES OR ASSIGNMENTS ARE PROHIBITED.