


SEAL:

THIS DOCUMENT IS NOT
FOR REGULATORY
APPROVAL, PERMITTING,
OR CONSTRUCTION.

KEYED NOTES

- 1. SERVICE RECEPTACLE, WEATHERPROOF GFCI ON ROOF.
- 2. FLEXPACK UNIT ON ROOF, REFER TO MECHANICAL SHEET M1.3.

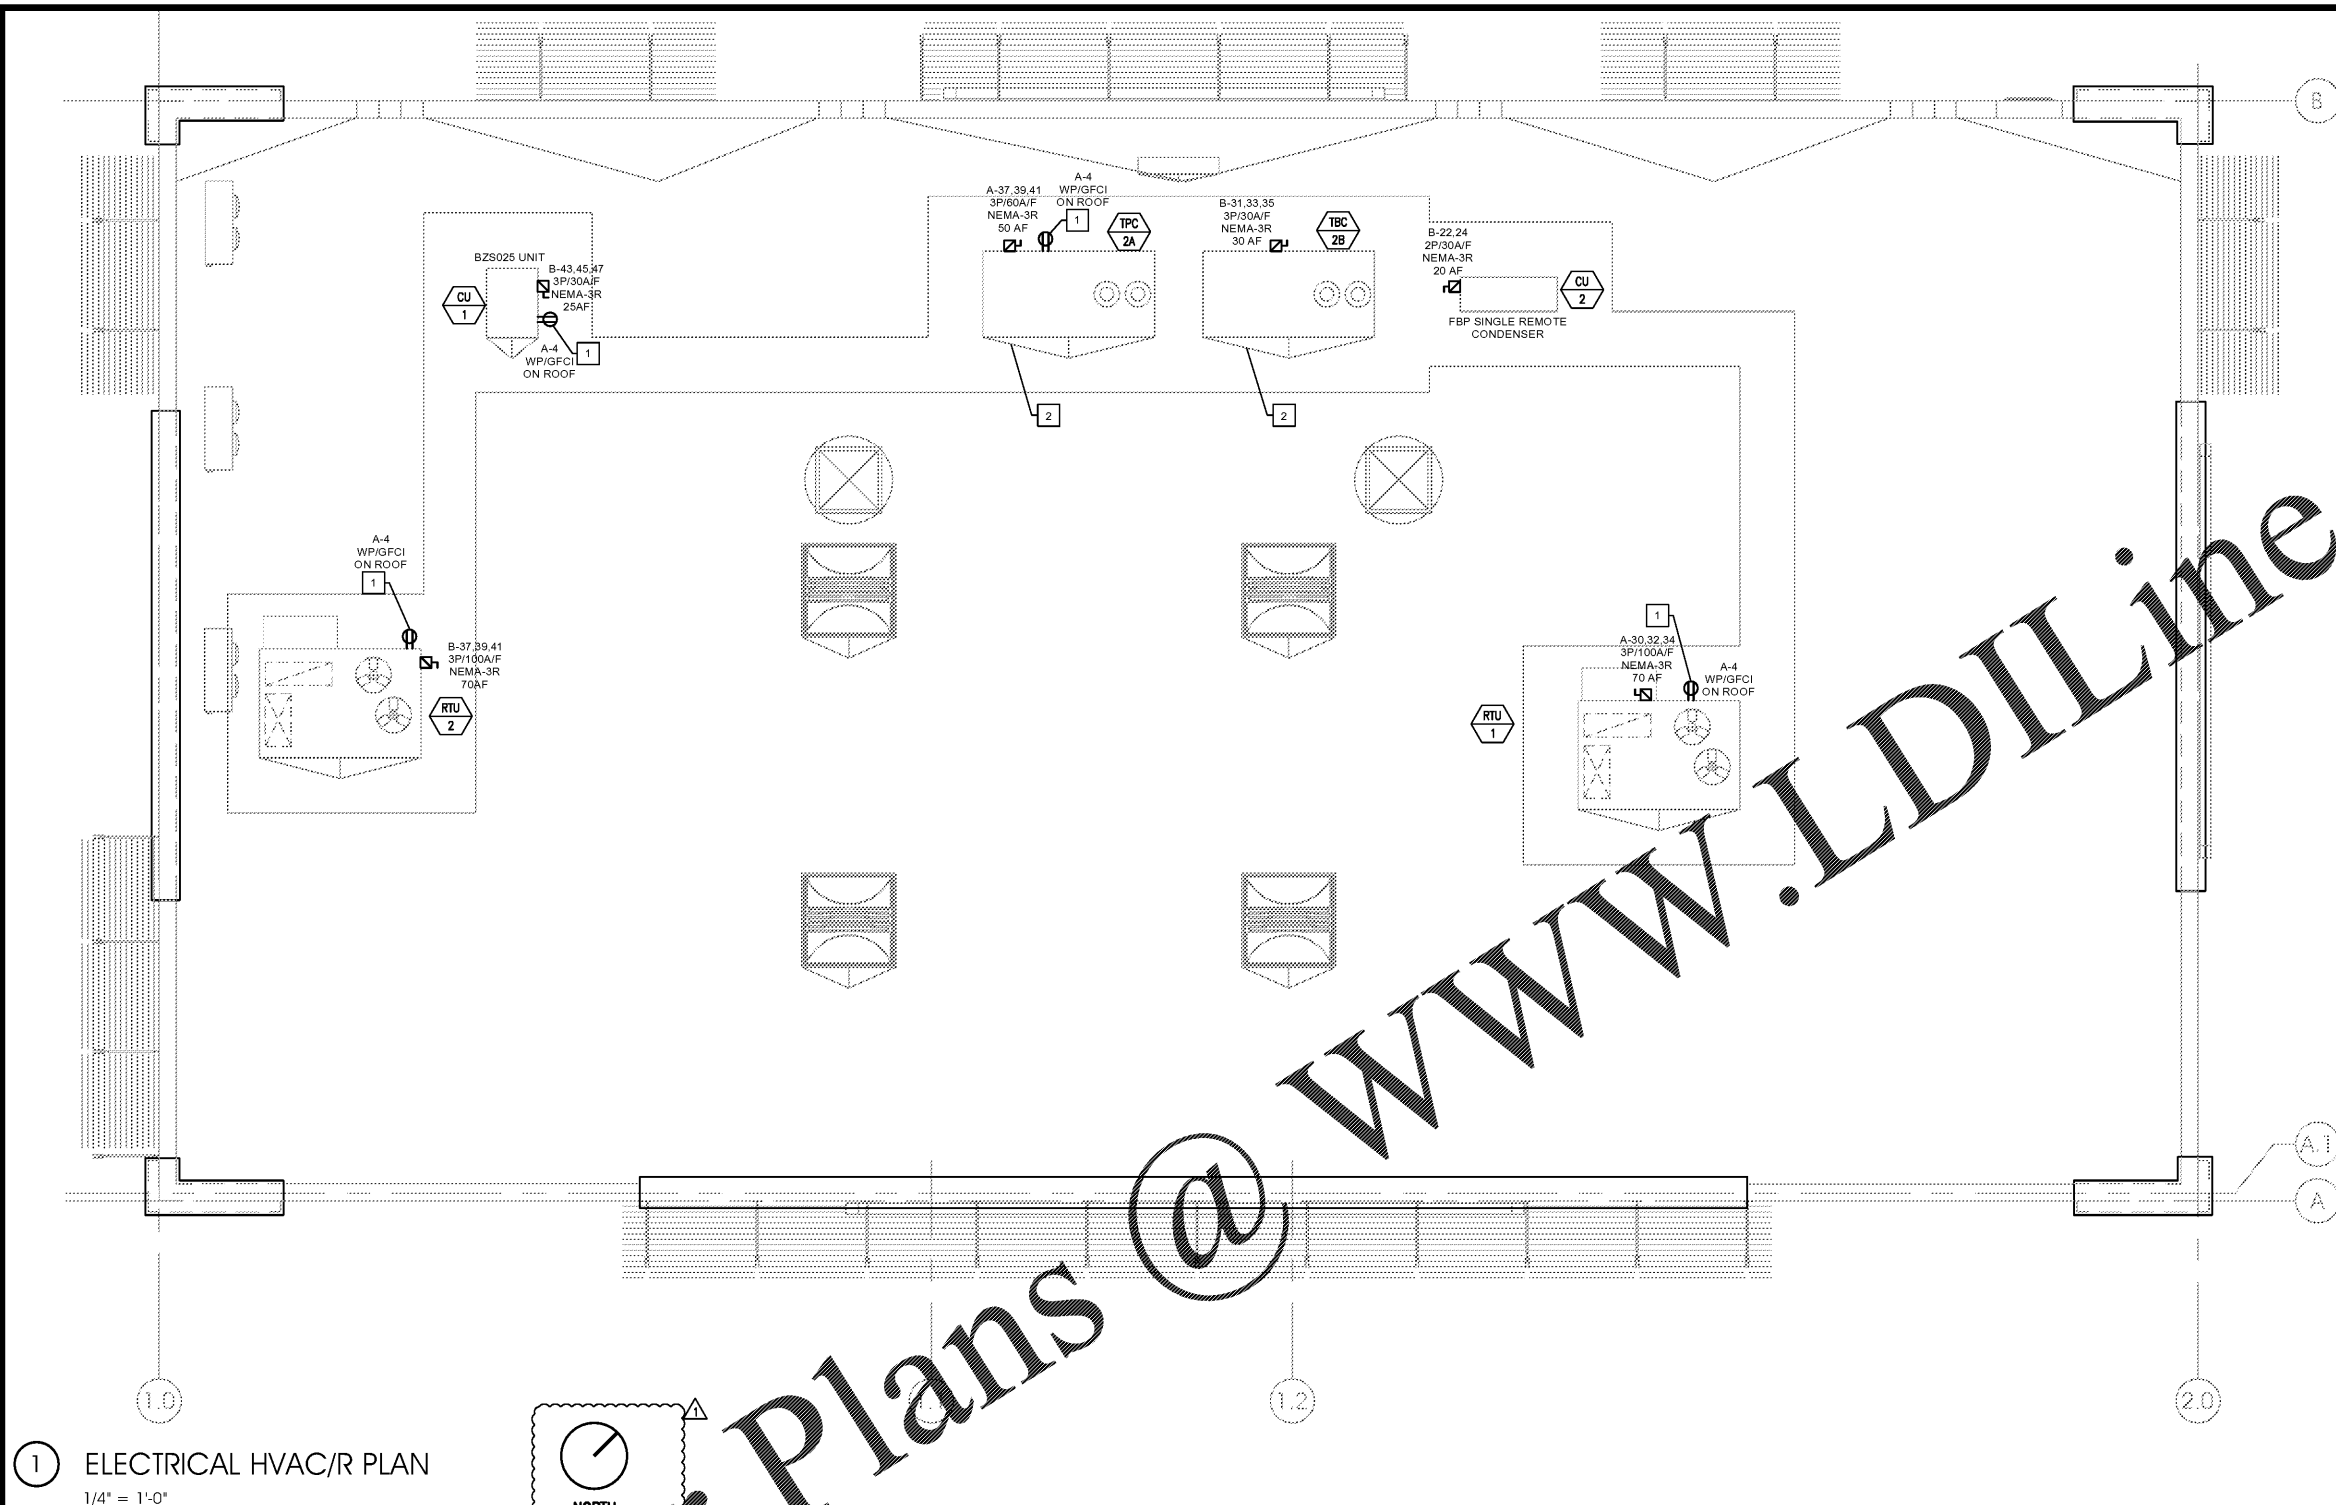

1 ELECTRICAL HVAC/R PLAN
1/4" = 1'-0"

Order Plans @ www.LDILine.com

NO.	DATE	REVISIONS
1	03.18.19	PEER COMMENTS
		REMARKS



BID SET
JUNE 27, 2019

7-ELEVEN
STORE #38777

12060 US 301 N
PARRISH, FL
34219

PROJECT NO: 2018.0891
DATE: FEBRUARY 26, 2019

E1.3
ELECTRICAL HVAC-R PLAN

CHECKED: BKJ DRAWN: MM

COPYRIGHT © 2019 INTERPLAN LLC. RESERVE COPYRIGHT & OTHER RIGHTS RESTRICTING THESE DOCUMENTS TO THE ORIGINAL SET OR TISSUE FOR WHICH THEY WERE PREPARED. REPRODUCTIONS, CHANGES OR ASSIGNMENTS ARE PROHIBITED.