



**KEY NOTES**


- 1 CONCRETE SLAB. REF G0.1 AND CIVIL DRAWINGS FOR TOS ELEVATIONS. ALL MANHOLES WITHIN THE TANK SLAB AREA TO BE RAISED 1" ABOVE THE NORMAL GRADE OF CONCRETE. SLOPE CONCRETE TO MANHOLES 1/4" PER FT. CROWN CONCRETE AS TO NOT INHIBIT WATER DRAINAGE OFF THE TANK SLAB (NO POOLING).
- 2 GEOTECH FABRIC MATERIAL TO EXTEND 60" MINIMUM PAST THE TANK HOLE EXCAVATION. ALL GEOTECH FABRIC MATERIAL TO BE PINNED PRIOR TO BACKFILLING. METHOD OF PINNING FABRIC AT TOP OF EXCAVATION TO BE APPROVED BY THE 7-ELEVEN CONSTRUCTION MGR.
- 3 MOH STRAP ANCHOR SYSTEM SUPPLIED BY TANK MANUFACTURER. PLACE DEADMEN PER MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- 4 PE GRAVEL BACKFILL TYP (OR APPROVED ALTERNATE) UNDER TANK AND SHORING.
- 5 MATERIAL DEPTH GREATER THAN 5'-8" REQUIRES 7-ELEVEN AND MANUFACTURER'S APPROVAL.
- 6 UNDISTURBED SOIL OR COMPACTED BACK FILL NOT LESS THAN 95% OF MODIFIED PROCTOR DENSITY (AASHTO-T-180).

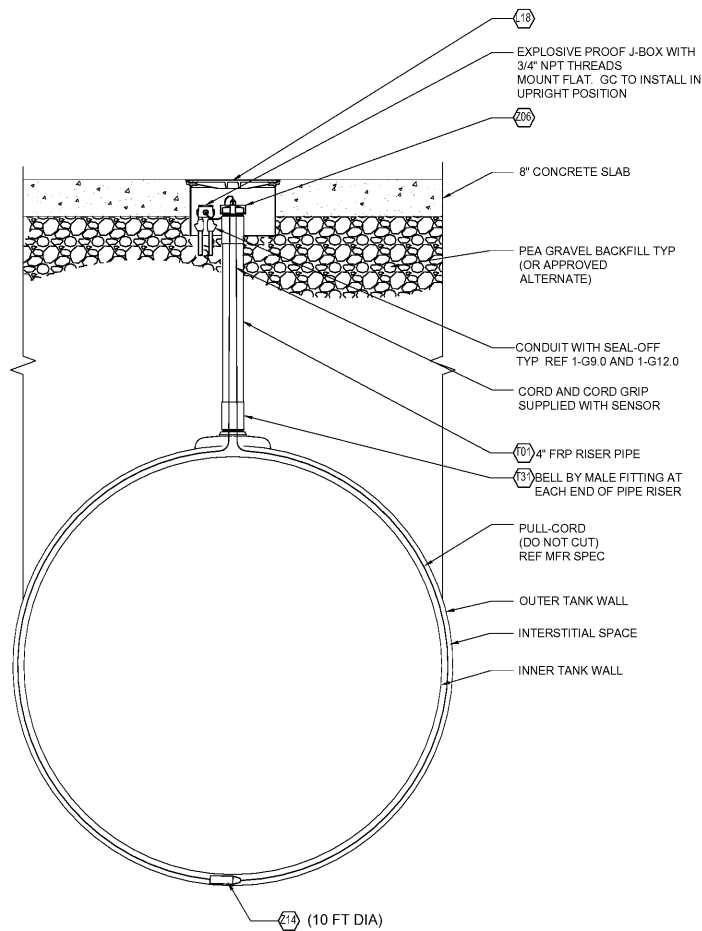

4 ANNULAR SPACE RISER AND SENSOR SECTION  
1/2"=1'-0"

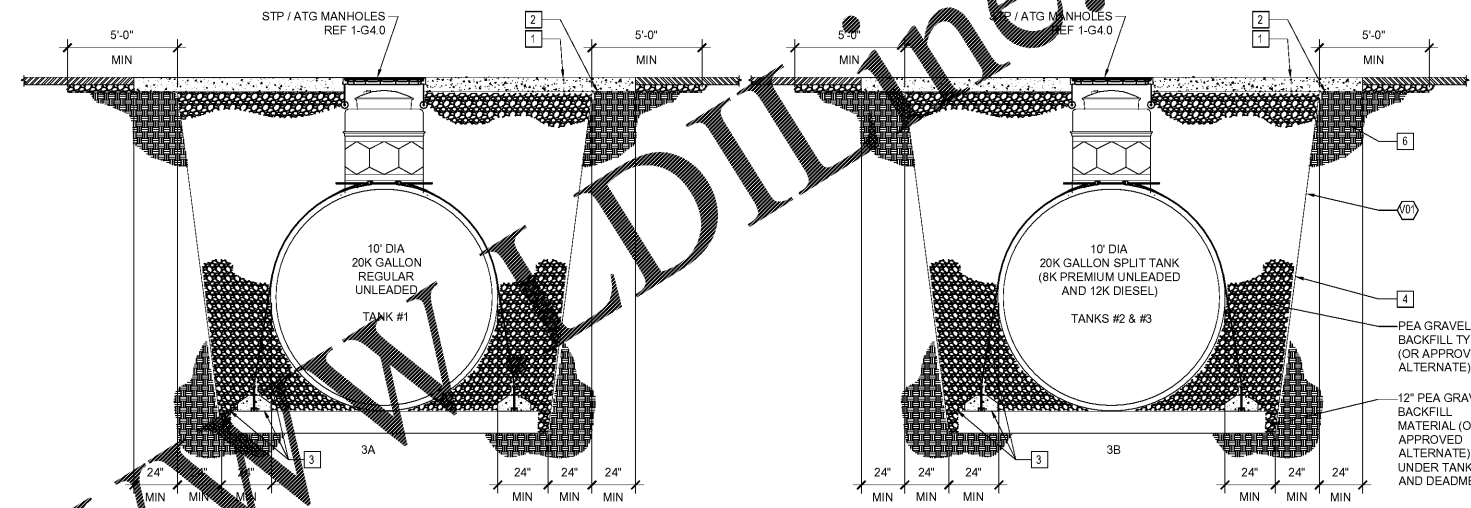

3 10' DIA UNDERGROUND STORAGE TANK SECTION  
1/4"=1'-0"

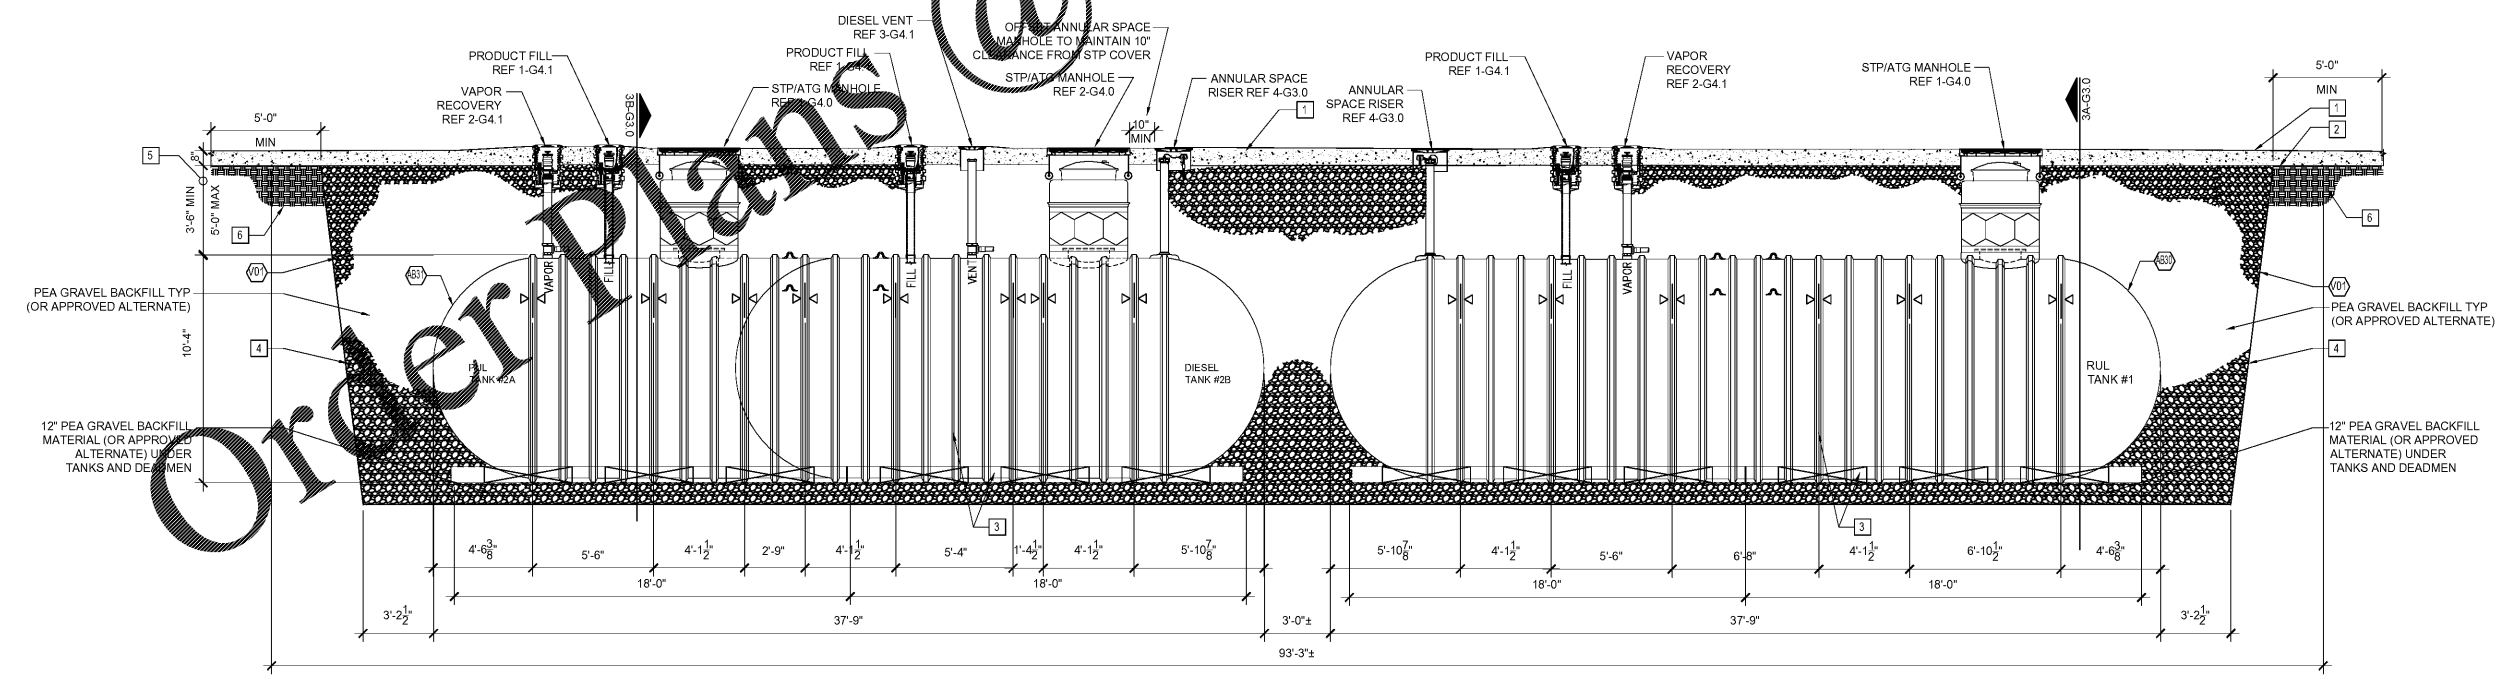

2 10' DIA 20,000 GALLON SPLIT TANK SECTION  
1/4"=1'-0"

1 10' DIA 20,000 GALLON TANK SECTION  
1/4"=1'-0"

PRINTED BY: RENTZ  
DRAWING NAME: 30777 - G3.0 TANK SECTIONS  
PRINT DATE: Jun 04, 2019 - 5:41pm



Rev. #	Date	Description

Proto 11-05-18

7-ELEVEN, INC.  
3200 HACKBERRY ROAD, IRVING TEXAS 75063

7-ELEVEN #38777  
US 301 & FORT HAMER ROAD  
PARRISH, FL 34219

TANK SECTIONS



Job#: SEI-26848  
Scale: AS NOTED  
Date: 05/06/19  
Drawn By: RMK  
Checked By: KMS

Documents prepared by Core States Group are to be used only for the specific project and no other projects, by owner or any other party, without the consent of Core States Group. It is done at the user's own risk. If used in a project, the user will hold Core States Group harmless from all claims and losses.



SHEET:  
**G3.0**  
FUELING - USA