


Order Plans

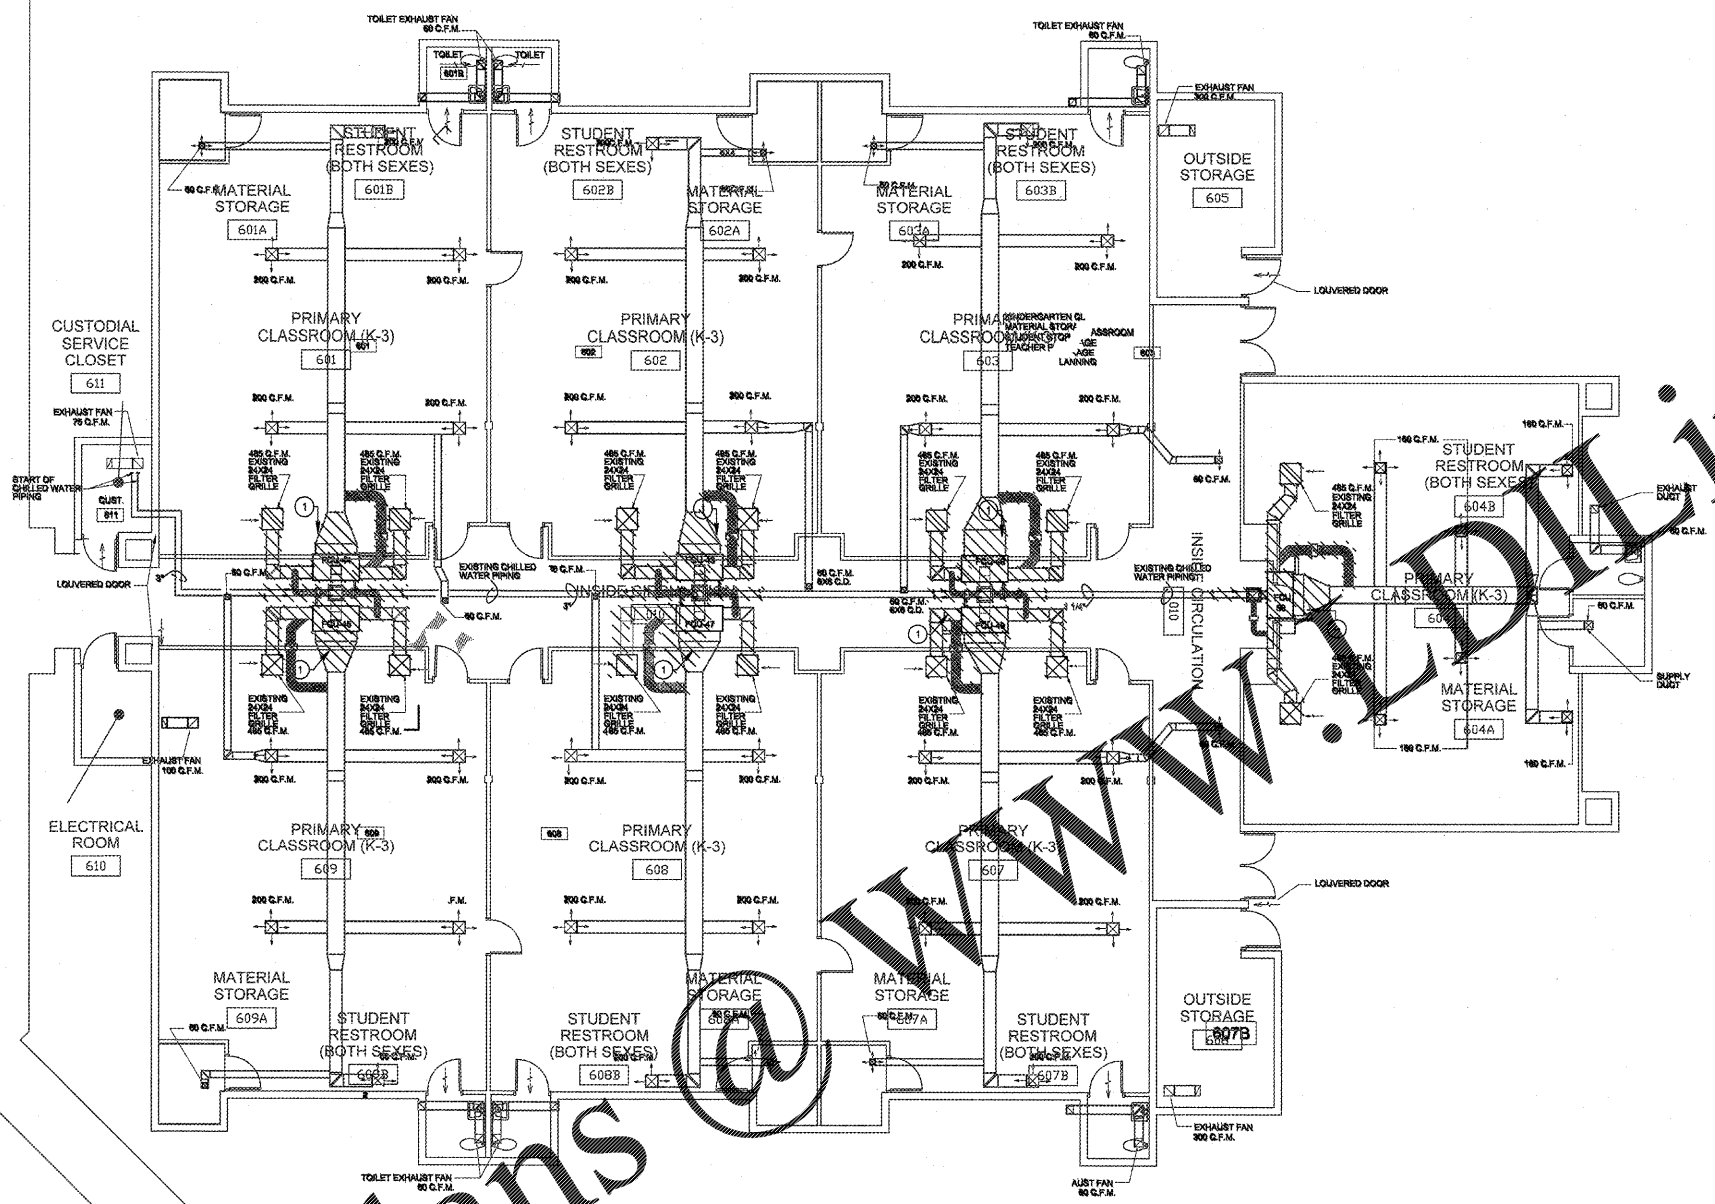

DEMOLITION LEGEND
 [Hatched Box] EXISTING CHWS&R PIPING TO BE REMOVED
 [Hatched Box] EXISTING DUCTWORK TO BE REMOVED

DEMOLITION KEY NOTES:
 ① REMOVE EXISTING FAN COIL UNIT AND DUCT HEATER AND REPLACE WITH NEW. REMOVE PORTION OF SUPPLY AND RETURN DUCTWORK IN ORDER TO REPLACE THE UNIT.

DEMOLITION NOTES:
 A. EXISTING CONTROLS ARE BEING REPLACED WITH NEW DDC CONTROLS. ALL EXISTING CONTROLS ARE TO BE REMOVED. REFER TO CONTROL SCHEMATIC SHEET M-302 FOR NEW CONTROLS REQUIREMENTS.

RECEIVED
 DEC 19 2017
 BUILDING DEPARTMENT
 BCPS

Bid Documents Only
 Not For Construction

