


WWW.LDILine.com

Order Plans @

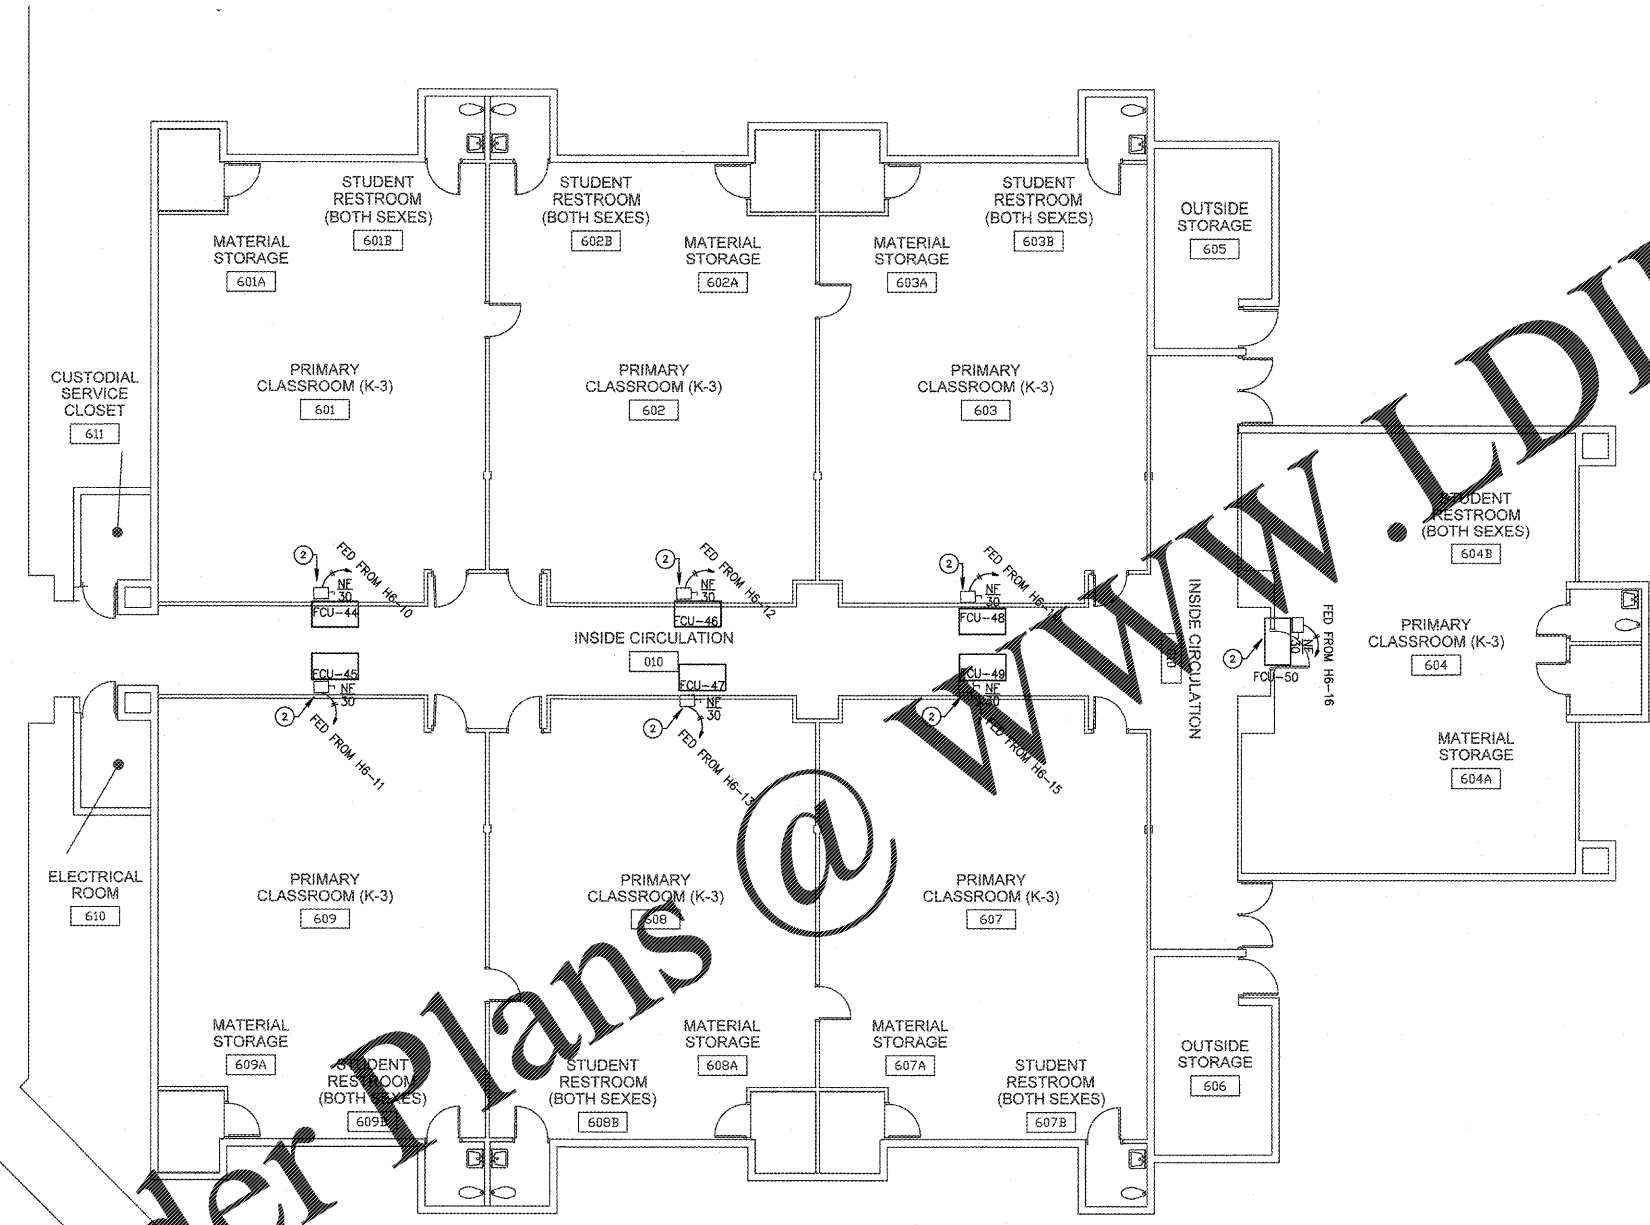

RECEIVED  
 DEC 19 2017  
 BUILDING DEPARTMENT  
 BCPS

- DRAWING KEY NOTES:**
- ① LOCATION OF NEW AIR HANDLING UNIT. PROVIDE NEW DISCONNECT, CONDUIT, AND WIRING AS REQUIRED.
  - ② LOCATION OF NEW FAN COIL UNIT AND DUCT HEATER. PROVIDE NEW DISCONNECT, CONDUIT, AND WIRING AS REQUIRED.
  - ③ LOCATION OF NEW HVAC CIRCULATING PUMP. PROVIDE NEW DISCONNECT, CONDUIT, AND WIRING AS REQUIRED.
  - ④ LOCATION OF NEW FAN COIL UNIT. PROVIDE NEW DISCONNECT, CONDUIT, AND WIRING AS REQUIRED.
  - ⑤ LOCATION OF EXISTING CHILLER TO REMAIN.
  - ⑥ LOCATION OF NEW RTU LOCATED ON ROOF. PROVIDE NEW DISCONNECT, CONDUIT, AND WIRING AS REQUIRED.
  - ⑦ PROVIDE POWER FOR NEW INCLINED CHAIR LIFT.

