


FIRE ALARM ABBREVIATIONS	
E	EXISTING TO REMAIN
ETR	EXISTING TO BE RELOCATED
ETBR	EXISTING TO BE REMOVED
N	NEW
R	RELOCATED
RC	ELEVATOR RECALL
PV	POST INDICATOR VALVE
DDCV	DOUBLE DETECTOR CHECK VALVE


  

FIRE ALARM SYMBOLS	
[FACP]	FIRE ALARM CONTROL PANEL
[FAAP]	FIRE ALARM ANNUNCIATOR PANEL
[PS1]	FIRE ALARM POWER SUPPLY 1
[PS2]	FIRE ALARM POWER SUPPLY 2
[F]	ADDRESSABLE MANUAL PULL STATION
[SD]	ADDRESSABLE PHOTOELECTRIC SMOKE DETECTOR
[D]	ADDRESSABLE DUCT DETECTOR
[R]	REMOTE ALARM/TEST SWITCH
[HD]	ADDRESSABLE HEAT DETECTOR
[TS]	TAMPER SWITCH
[FS]	FLOW SWITCH
[L/S]	SPEAKER/STROBE DEVICE
[L]	STROBE LIGHT
[R]	RELAY
[M]	MONITOR MODULE

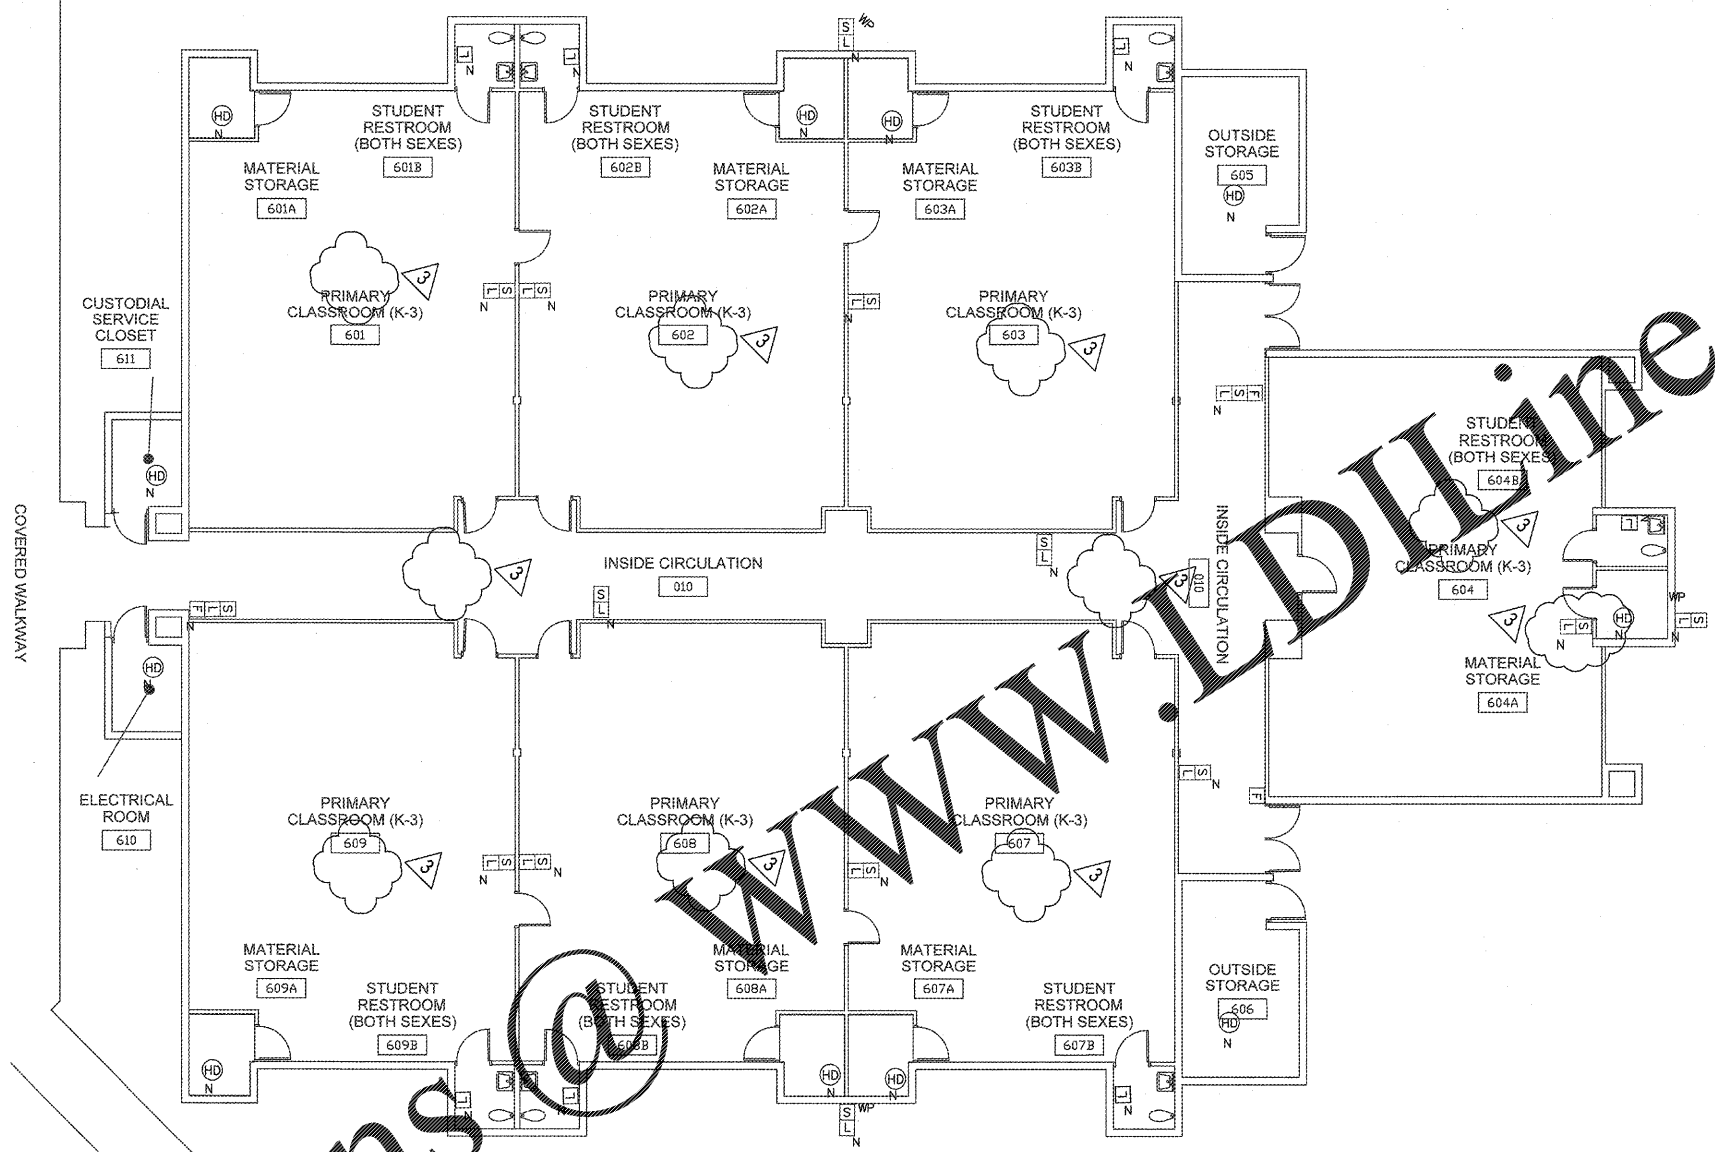

Order Plans @ [www.edline.com](http://www.edline.com)

- FIRE ALARM GENERAL NOTES**
1. ALL FIRE ALARM DEVICES ARE NEW UNLESS OTHERWISE NOTED.
  2. THE BATTERY BACK UP FOR ALARM AND SUPERVISORY FUNCTIONS SHALL BE ADEQUATE TO PROVIDE POWER AS REQUIRED BY CODE.
  3. THE FIRE ALARM CONTRACTOR SHALL SUBMIT TO THE ENGINEER OF RECORD FOR REVIEW AND APPROVAL PRIOR TO SUBMITTAL TO THE BUILDING DEPARTMENT SIGNED AND SEALED SHOP DRAWINGS AND CALCULATIONS BY A LICENSED FLORIDA PROFESSIONAL ENGINEER FOR THE FIRE ALARM SYSTEM.
  4. CONTRACTOR SHALL NOTIFY TO THE OWNER OR OWNERS REPRESENTATIVE AND A/E OF ANY EXISTING ALARM, SUPERVISORY OR TROUBLE CONDITION IN THE ALARM PANEL PRIOR TO COMMENCING WORK ON THE FIRE ALARM SYSTEM. ALARM PANEL SHALL BE CLEARED OF ALL TROUBLES BEFORE COMMENCING WORK.
  5. REMOTE DUCT DETECTOR INDICATOR/TEST STATIONS IN ACCORDANCE W/ BCPS 13845 3.1 FOR ALL NEW AND REPLACEMENT AIR HANDLERS SHALL BE MOUNTED INSIDE THE MECHANICAL ROOM ADJACENT TO THE DOOR OPENING HARDWARE, UNIFORMLY SURFACE MOUNTED BETWEEN 48" TO 54" ABOVE THE FLOOR.
  6. PROVIDE AN EMERGENCY VOICE EVACUATION SYSTEM IN DINING, MULTI-PURPOSE ROOM, OR ANY SPACE WHERE OCCUPANCY EXCEEDS 300 PEOPLE.

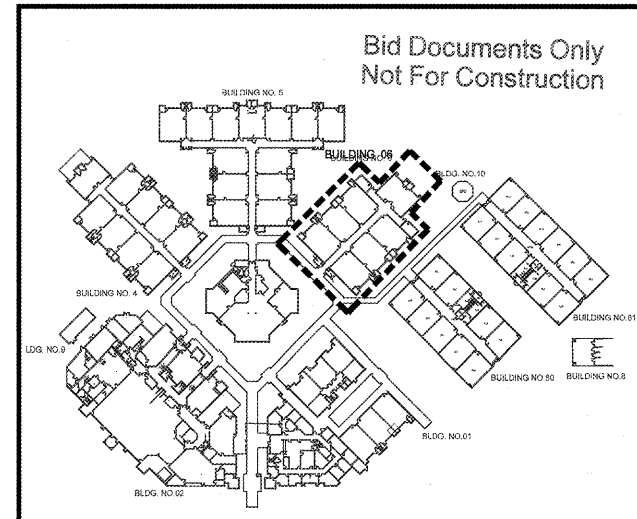

RECEIVED  
 OCT 29 2018  
 BUILDING DEPARTMENT  
 BCPS

SEA CASTLE  
 ELEMENTARY SCHOOL  
 9600 MIRAMAR BOULEVARD  
 MIRAMAR, FLORIDA 33025

THE SCHOOL BOARD OF BROWARD COUNTY

PARTIAL FIRE ALARM  
 FLOOR PLAN BUILDING 06

100% SUBMITTAL  
 JOB PHASE: P.001632  
 SBBG PROJECT: AS SHOW  
 DATE: 12.15.18  
 SCALE: HA  
 DRAWN BY: EH  
 CHECKED BY: EA  
 CAE PROJECT NO. 2015.55

FL LIC # 39048  
 ERIC J. HAMMOND  
 PROFESSIONAL ENGINEER  
 MECHANICAL/ELECTRICAL  
 SEAL

DRAWING No.  
**E-306**