UL U356 - 1 HOUR RATED WALL

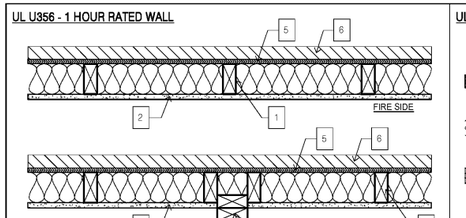

1. Wood Studs — Nom 2 by 4 in. spaced 16 in. OC with two 2 by 4 in. top and one 2 by 4 in. bottom plates. Studs laterally-braced by wood structural panel sheathing (Item 5). When Mineral and Fiber Boards* (Item 5A) are considered as bracing for the studs, the load is restricted to 76% of allowable axial load. Walls effectively fire stopped at top and bottom of wall.
2. Gypsum Board* — Any 5/8 in. thick UL Classified Gypsum Board that is eligible for use in Design Nos. U501, U512 or U505. Nom 5/8 in. thick, 4 ft wide, applied vertically and nailed to studs and bearing plates 7 in. OC with 6d cement-coated nails, 1-7/8 in. long with 1/4 in. diam head.
When Item 7, Steel Framing Members*, is used, gypsum panels attached to furring channels with 1 in. long Type S bugle-head steel screws spaced 12 in. OC.
When Item 7A, 7B, or 7C Steel Framing Members*, is used, two layers of gypsum panels attached to furring channels. Base layer attached to furring channels with 1 in. long Type S bugle-head steel screws spaced 12 in. OC. Face layer attached to furring channels with 1-5/8 in. long Type S bugle-head steel screws spaced 12 in. OC. All joints in face layers staggered with joints in base layers.
ACADIA DRYWALL SUPPLIES LTD (View Classification) — CKNX R2S270
AMERICAN GYPSUM CO (View Classification) — CKNX R14166
BEIJING NEW BUILDING MATERIAL PUBLIC LTD (View Classification) — CKNX R19374
CERTAINTEED GYPSUM INC (View Classification) — CKNX R9990
CGC INC (View Classification) — CKNX R19751
CONTINENTAL BUILDING PRODUCTS OPERATING CO, L C (View Classification) — CKNX R15482
GEORGIA-PACIFIC GYPSUM L L C (View Classification) — CKNX R2717
LOADMASTER SYSTEMS INC (View Classification) — CKNX R11909
NATIONAL GYPSUM CO (View Classification) — CKNX R3501
PABCO BUILDING PRODUCTS L L C, DBA PABCO GYPSUM (View Classification) — CKNX R7194
PANEL REY S A (View Classification) — CKNX R21766
SAM GYPSUM INDUSTRY (SARAJEVO) CO, LTD (View Classification) — CKNX R19262
THAI GYPSUM PRODUCTS PCL (View Classification) — CKNX R27917
UNITED STATES GYPSUM CO (View Classification) — CKNX R1319
USG MEXICO S A DE C V (View Classification) — CKNX R16081
2A. Gypsum Board* — (As an alternate to Item 2, Not Shown) — Any 5/8 in. thick 4 ft wide gypsum panels that are eligible for use in Design Nos. U501, U512 or U505, supported by Classified Companies listed below shown in the Gypsum Board* (CKNX) category. Applied vertically and attached to studs and bearing plates with 1-1/4 in. long Type W coarse thread gypsum panel steel screws spaced a max 8 in. OC, with last screw 1 in. from edge of board.
CGC INC
UNITED STATES GYPSUM CO
USG MEXICO S A DE C V
2B. Gypsum Board* — (As an alternate to Item 2, Not Shown) — 5/8 in. thick 4 ft wide gypsum panels applied vertically and attached to studs and bearing plates with 1-1/4 in. long Type W coarse thread gypsum panel steel screws spaced a max 8 in. OC with last screw 1 in. from edge of board.
ACADIA DRYWALL SUPPLIES LTD — Type X, 5/8 Type X, Type Blueglass Exterior Sheathing
AMERICAN GYPSUM CO — Type AGX-1, M-Glass, AG-C
CERTAINTEED GYPSUM INC — Type C, Type X or Type X-I
GEORGIA-PACIFIC GYPSUM L L C — Types X, Veneer Plaster Base-Type X, Water Rated-Type X, Sheathing Type-X, Soffit-Type X, Type X ComfortGuard Sound Deadening Gypsum Board
PABCO BUILDING PRODUCTS L L C, DBA PABCO GYPSUM — Types FG-11, FGS-WRS
THAI GYPSUM PRODUCTS PCL — Type C or Type X
2C. Gypsum Board* — (As an alternate to Item 2, Not Shown) — For Use with Item 5A only - 5/8 in. thick 4 ft wide gypsum panels applied horizontally and attached to studs and bearing plates with 1-1/4 in. long Type W coarse thread gypsum panel steel screws spaced a max 8 in. OC, with last screw 1 in. and 4 in. from edges of board. Finish Rating is 25 min
ACADIA DRYWALL SUPPLIES LTD — 5/8 Type X, Type Blueglass Exterior Sheathing
GEORGIA-PACIFIC GYPSUM L L C — Type X, Veneer Plaster Base-Type X, Water Rated-Type X, Sheathing Type-X, Soffit-Type X
PABCO BUILDING PRODUCTS L L C, DBA PABCO GYPSUM — Types FG-11, FGS-WRS
THAI GYPSUM PRODUCTS PCL — Type C or Type X
2D. Gypsum Board* — (As an alternate to Item 2) — Not to be used with Item 7. 5/8 in. thick, 4 ft. wide, paper surfaced, applied vertically only and fastened to the studs and plates with 6d cement coated nails 1-7/8 in. long, 0.9/0 in. shank diam and 1/4 in. diam heads, 7 in. OC.
NATIONAL GYPSUM CO — SoundBreak XP Type X Gypsum Board
2E. Gypsum Board* — (As an alternate to Items 2 through 2G) — Nominal 5/8 in. thick, 4 ft wide panels, secured as described in Item 2
PABCO BUILDING PRODUCTS L L C, DBA PABCO GYPSUM — Type QuestRock ES
2F. Gypsum Board* — (As an alternate to Item 2) — Not to be used with Item 7. 5/8 in. thick, 4 ft. wide, paper surfaced, applied vertically only and fastened to the studs and plates with 6d cement coated nails 1-7/8 in. long, 0.9/0 in. shank diam and 1/4 in. diam heads, 7 in. OC.
CERTAINTEED GYPSUM INC — Type SilentFX
2G. Wall and Partition Facings and Accessories* — (As an alternate to Items 2 through 2F) — Nominal 5/8 in. thick, 4 ft wide panels, secured as described in Item 2
PABCO BUILDING PRODUCTS L L C, DBA PABCO GYPSUM — Type QuietRock 527
2H. Gypsum Board* — (As an alternate to Item 2) — 5/8 in. thick gypsum panels, with beveled, square, or tapered edges, applied either horizontally or vertically. Gypsum panels fastened to framing with 1-1/4 in. long Type W coarse thread gypsum panel steel screws spaced a maximum 10 in. OC with the last two screws 4 and 1 in. from the edges of the board. When used in widths other than 48 in., gypsum panels are to be installed horizontally.
CONTINENTAL BUILDING PRODUCTS OPERATING CO, L C — Type LGFC6A (finish rating 21 min), Type LGFC2A, Type LGFC-GA, Type LGFC-MD, Type LGLLX
2I. Gypsum Board* — (As an alternate to Item 2) — 5/8 in. thick gypsum panels, with beveled, square, or tapered edges, applied either horizontally or vertically. Gypsum panels fastened to framing with 1-1/4 in. long Type W coarse thread gypsum panel steel screws spaced a max 8 in. OC, with last screw 1 in. from edge of board. When used in widths of other than 48 in., gypsum board are to be installed horizontally.
AMERICAN GYPSUM CO — Types AGX-1 (finish rating 25 min.), M-Glass (finish rating 25 min.), Type AG-C (finish rating 25 min.)
3. Joints and Fastener Heads — (Not Shown) — Gypsum board joints covered with tape and joint compound. Fastener heads covered with joint compound.
4. Batts and Blankets* — Mineral fiber or glass fiber insulation, 3-1/2 in. thick, pressure fit to fill wall cavities between studs and plates. Mineral fiber insulation to be unfaced and to have a min density of 2.5 pcf. Glass fiber insulation to be faced with aluminum foil or kraft paper and to have a min density of 0.6 pcf (min R-13 thermal insulation rating).
See Batts and Blankets* (BKNX) Category in the Building Materials Directory and Batts and Blankets* (BTJZ) Category in the Fire Resistance Directory for names of Classified Companies
4A. Fiber, Sprayed* — As an alternate to Batts and Blankets (Item 4) — Spray applied cellulose material. The fiber is applied with water to completely fill the enclosed cavity in accordance with the application instructions supplied with the product with a nominal dry density of 2.7 lb/ft3. Alternate Application Method: The fiber is applied without water or adhesive at a nominal dry density of 3.5 lb/ft3, in accordance with the application instructions supplied with the product.
U.S.GREENFIBER L L C — INS725.5,INS745 for use with wet or dry application. INSSHILO, INSSHILO, INSS41LO, INS755, INS745, INSTHILO, and INS771LO are to be used for dry application only.
4B. Fiber, Sprayed* — As an alternate to Item 4 and 4A — Spray applied cellulose material. The fiber is applied with water to completely fill the enclosed cavity in accordance with the application instructions supplied with the product. Nominal dry density of 4.58 lb/ft 3.
NU WOOL CO INC — Cellulose Insulation
4C. Fiber, Sprayed* — As an alternate to Batts and Blankets (Item 4) — Spray applied cellulose fiber. The fiber is applied with water to completely fill the enclosed cavity in accordance with the application instructions supplied with the product. The minimum dry density shall be 4.30 lb/ft3.
INTERNATIONAL CELLULOSE CORP — Cellus-WL
5. Wood Structural Panel Sheathing — Min 7/16 in. thick, 4 ft wide wood structural panels, min grade "C-D" or "Sheathing". Installed with long dimension of sheet (strength axis) or face grain of plywood parallel with or perpendicular to studs. Vertical joints backed with nom 2 by 4 in. wood blocking.
Attached to studs on exterior side of wall with 6d cement coated box nails spaced 6 in. OC at perimeter of panels and 12 in. OC along interior studs.
5A. Mineral and Fiber Boards* — As an alternate to Item 5 - Min 1/2 in. thick, 4 ft wide sheathing, installed vertically to studs. Vertical joints centered on studs. Horizontal joints backed with nom 2 by 4 in. wood blocking. Attached to studs on exterior side of wall with 1-1/2 in. long galvanized roofing nails spaced 8 in. OC at perimeter of panels and 12 in. OC along interior studs. As an option a weather resistive barrier may be applied over the Mineral and Fiber Boards.
6. Exterior Facings — Installed in accordance with the manufacturer's installation instructions. One of the following exterior facings is to be applied over the sheathing:
A. Vinyl Siding — Molded Plastic* — Contoured rigid vinyl siding having a flame spread value of 20 or less. See Molded Plastic (BTA7) category in the Building Materials Directory for names of manufacturers
B. Particle Board Siding — Hardboard exterior sidings including patterned panel or lap siding.
C. Wood Structural Panel or Lap Siding — APA Rated Siding, Exterior, plywood, OSB or composite panels with veneer faces and structural wood core, per PS 1 or APA Standard PRP-108, including textured, rough sawn, medium density overlay, brushed, grooved and lap siding.
D. Cementitious Stucco — Portland cement or synthetic stucco systems with self-furring metal lath or adhesive base coat. Thickness from 3/8 to 3/4 in., depending on system.
E. Brick Veneer — Any type or nom 4 in. wide brick veneer. When brick veneer is used, the rating is applicable with exposure on either face. Brick veneer fastened with corrugated metal wall ties attached over sheathing to wood studs with 8d nail per tie; ties spaced not more than each sixth course of brick and max 32 in. OC horizontally. One in. air space provided between brick veneer and sheathing.
F. Exterior Insulation and Finish System (EIFS) — Nom 1 in. Foamed Plastic* insulation bearing the UL Classification Marking, attached over sheathing and finished with coating system, or Portland cement or synthetic stucco systems, in accordance with manufacturer's instructions. See Foamed Plastic (BRYX and CCWX) categories for names of Classified companies.
G. Siding — Aluminum or steel siding attached over sheathing to studs.
H. Fiber-Cement Siding — Fiber-cement exterior sidings including smooth and patterned panel or lap siding.
I. Wall and Partition Facings and Accessories* — Stone veneer is mortar bonded to a lath, scratch coat and water resistant barrier applied to sheathing, installed in accordance with the manufacturers installation instructions, and meeting the requirements of local code agencies.
ELDORADO STONE OPERATIONS L L C — Type Eldorado Stone
6A. Building Units* — As an alternate to Exterior Facing Item 6 — Insulated steel panels, 12 through 42 in. wide. Attached over sheathing through retainer clips to studs or support steel with No. 14 hex head self-tapping screws located at each joint in the concealed rib of the units and spaced in accordance with the structural design requirements.
KINGSPAN INSULATED PANELS INC — Types 200, 300, 400, 900, or KS series, 2 through 6 in. thickness; CWP-V, H, Z through 3 in. nominal thickness or Designseal 4000, 2 and 3 in. nominal thickness
7. Steel Framing Members* — (Optional, Not Shown) — Furring Channels and Steel Framing Members as described below:
a. Furring Channels — Formed of No. 25 MSG galv steel, 2-6/16 in. or 2-03/20 in. wide by 7/8 in. deep, spaced 24 in. OC perpendicular to studs. Channels secured to studs as described in Item b. Ends of adjoining channels are overlapped 6 in. and tied together with double strand of No. 18 SWG galv steel wire near each end of overlap. As an alternate, ends of adjoining channels may be overlapped 6 in. and secured together with two self-tapping #6 framing screws, min. 7/16 in. long at the midpoint of the overlap, with one screw on each flange of the channel. Gypsum board attached to furring channels as described in Item 2.
b. Steel Framing Members* — Used to attach furring channels (Item 7a) to studs. Clips spaced 48 in. OC., and secured to studs with No. 8 x 2-1/2 in. screw drywall screw through the center grommet. Furring channels are friction fitted into clips. RSIC-1 clip for use with 2-6/16 in. wide furring channels. RSIC-1 (F.75) clip for use with 2-03/20 in. wide furring channels.
PACIN INTERNATIONAL L L C — Types RSIC-1, RSIC-1 (F.75)
7A. Steel Framing Members* — (Optional, Not Shown) — Furring channels and Steel Framing Members as described below:
a. Furring Channels — Formed of No. 25 MSG galv steel, spaced 24 in. OC perpendicular to studs. Channels secured to studs as described in Item b. Ends of adjoining channels are overlapped 6 in. and tied together with double strand of No. 18 SWG galv steel wire near each end of overlap. Two layers of gypsum board attached to furring channels as described in Item 2.
b. Steel Framing Members* — Used to attach furring channels (Item 7Aa) to interior side of studs. Clips spaced 48 in. OC., and secured to studs with two No. 8 x 2-1/2 in. screw drywall screws, one through the hole at each end of the clip. Furring channels are friction fitted into clips
KINETICS NOISE CONTROL INC — Type txomax
7B. Steel Framing Members* — (Optional, Not Shown) — Furring channels and Steel Framing Members as described below:
a. Furring Channels — Formed of No. 25 MSG galv steel, 2-3/8 in. wide by 7/8 in. deep, spaced 24 in. OC perpendicular to studs. Channels secured to studs as described in Item b. Ends of adjoining channels are overlapped 6 in. and tied together with double strand of No. 18 SWG galv steel wire near each end of overlap. As an alternate, ends of adjoining channels may be overlapped 6 in. and secured together with two self-tapping #6 framing screws, min. 7/16 in. long at the midpoint of the overlap, with one screw on each flange of the channel. Gypsum board attached to furring channels as described in Item 2.
b. Steel Framing Members* — Used to attach furring channels (Item a) to studs. Clips spaced 48 in. OC. Clips secured to studs with No. 8 x 2-1/2 in. coarse drywall screw through the center hole. Furring channels are friction fitted into clips
PLITEQ INC — Type Genie Clip
7C. Steel Framing Members* — (Optional, Not Shown) — Furring channels and Steel Framing Members as described below:
a. Furring Channels — Formed of No. 25 MSG galv steel. Spaced 24 in. OC perpendicular to studs. Channels secured to studs as described in Item b. Ends of adjoining channels overlapped 6 in. and secured together with four self-tapping No. 8x1/2 in. drilling screws (2 per side of channel, 1 in. from each lap edge). Gypsum board attached to furring channels as described in Item 2. Side joint furring channels to be attached to studs with RESILIMOUNT Sound Isolation Clips - Type AZ37R located approximately 2 in. from each end of length of channel. Both Gypsum Boards at side joints fastened to furring channels with screws spaced 8 in. OC, approximately 1/2 in. from joint edge.
b. Steel Framing Members* — Used to attach furring channels (Item 7Ca) to studs. Clips spaced 48 in. OC., and secured to studs with No. 10 x 2-1/2 in. coarse drywall screw through the center hole. Furring channels are friction fitted into clips.
KEENE BUILDING PRODUCTS CO INC — Quiet Clip
8. Non-Bearing Wall Partition Intersection — (Optional) — Two nominal 2 by 4 in. stud or nominal 2 by 6 in. studs spaced apart to form partition. Studs spaced 16 in. OC with long 10d nails spaced a max. 16 in. OC vertically and fastened to one side of the minimum 2 by 4 in. stud with 3 in. long 10d nails spaced a max 16 in. OC vertically. Intersection between partition wood studs to be flush with the 2 by 4 in. studs. The wall partition wood studs are to be framed by with a second 2 by 4 in. wood stud fastened with 3 in. long 10d nails spaced a max. 16 in. OC. vertically. Maximum one non-bearing wall partition intersection per stud cavity. Non-bearing wall partition stud depth shall be at a minimum equal to the depth of the bearing wall.
* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

UL L505 - 2 HOUR RATED FLOOR/ROOF / CEILING

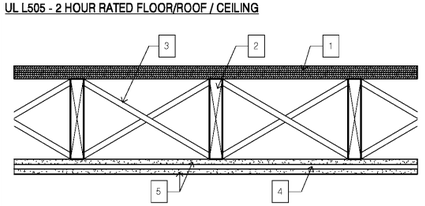

1. Flooring System — The flooring system shall consist of one of the following:
System No. 1
Subflooring — Min 1 by 6 in. T & G lumber fastened diagonally to joists, or min 1/2(2) in. thick wood structural panels or 7/16 in. thick oriented strand board (OSB) wood structural panels, min grade "C-D" or "Sheathing". Face grain of plywood or strength axis of panels to be perpendicular to the joists with joints staggered.
Subflooring (Alternate) - Structural Cement-Fiber Units* — Nominal 19 mm (3/4 in.) thick tongue and groove structural cement-fiber units. Long dimension of panels to be perpendicular to joists with end joints staggered. Panels fastened to the joists with #10 self-drilling, self-tapping cement board screws 1-3/4 in. long. Screws shall be spaced 8 in. OC along the perimeter of each sheet and 12 in. OC in the field of each sheet. Screws shall be spaced 1/2 in. from end joints and 1 in. from side joints.
ECTEK INTERNATIONAL INC — Armoroc Panel
Vapor Barrier — Nom 0.010 in. thick commercial resin-sized building paper.
Finish Flooring — Min 1 by 4 in. T & G lumber fastened perpendicular to joists, or min 13/32 in. wood structural panels, min grade "Underlayment" or "Single Floor". Face grain of plywood or strength axis of panels to be perpendicular to joists with joints staggered.
System No. 2
Subflooring — Min 15/32 in. thick wood structural panels, min grade "C-D" or "Sheathing". Face grain of plywood or strength axis of panels to be perpendicular to the joists with joints staggered.
Vapor Barrier - (Optional) — Nom 0.01 0 in. thick commercial asphalt saturated felt.
Finish Flooring - Floor Topping Mixture* — Min 3/4 in. thickness of floor topping mixture having a minimum compressive strength of 1,000 psi. Refer to manufacturer's instructions accompanying the material for specific mix design.
UNITED STATES GYPSUM CO — Types LRK, HSLRK, CSD
USG MEXICO S A DE C V — Types LRK, HSLRK, CSD
Floor Mat Materials* — (Optional) - Floor mat material loose laid over the subfloor. Refer to manufacturer's instructions regarding the minimum thickness of floor topping over each floor mat material.
UNITED STATES GYPSUM CO — Types SAM, LEVELROCK® Brand Sound Reduction Board, LEVELROCK® Brand Floor Underlayment SRM25
Alternate Floor Mat Materials* - (Optional) — Nom 3/8 in. thick floor mat material loose laid over the subfloor. Floor topping thickness shall be as specified under Floor Topping Mixture.
GRASSWORX LL C — Type SC50
Alternate Floor Mat Materials* — (Optional) - Floor mat material nominal 3/8 in. thick loose laid over the subfloor. Floor topping shall be a min 3/4 or 1 in. thickness of floor topping mixture per 1/2(2) or 15/32 in. thick wood structural panels respectively.
System No. 3
Subflooring — Min 15/32 in. thick wood structural panels, min grade "C-D" or "Sheathing". Face grain of plywood or strength axis of panels to be perpendicular to the joists with joints staggered.
Vapor Barrier - (Optional) — Nom 0.030 in. thick commercial asphalt saturated felt.
Finish Flooring - Floor Topping Mixture* — Min 1-1/2 in. thickness of floor topping mixture having a minimum compressive strength of 1000 psi and a cast density of 105 plus or minus 5 pcf. Foam concentrate mixed 40:1 by volume with water and expanded at 100 psi through nozzle. Mixture shall consist of 1.4 cu feet of preformed foam concentrate to 94 lbs Type I Portland cement, 300 lbs of sand with 5-1/2 gal of water.
ELASTZELL CORP OF AMERICA — Type FF
System No. 4
Subflooring — Min 1/2(2) in. thick wood structural panels, min grade "C-D" or "Sheathing". Face grain of plywood or strength axis of panels to be perpendicular to the joints with joints staggered.
Vapor Barrier - (Optional) — Nom 0.010 in. thick commercial asphalt saturated felt.
Floor Mat Materials* - (Optional) — Floor mat material Nom 3/8 in. thick loose laid over the subfloor. Floor topping thickness shall be a min of 1 in. (25 mm)
HACKER INDUSTRIES INC — Type Hacker SoundMat.
Alternate Floor Mat Materials - (Optional) — Floor mat material nom 1/4 in. (6 mm) thick adhered to subfloor with Hacker Floor Primer. Primer to be applied to the surface of the mat prior to the placement of a min 1-1/4 in. of floor-topping mixture.
ECORE INTERNATIONAL INC — Type Ecore 4082
HACKER INDUSTRIES INC — Type Hacker SoundMat.
Alternate Floor Mat Materials - (Optional) — Floor mat material nom 1/8 in. (3 mm) thick adhered to subfloor with Hacker Floor Primer. Primer to be applied to the surface of the mat prior to the placement of a min 1-1/4 in. (32 mm) of floor-topping mixture.
ECORE INTERNATIONAL INC — Type QTech 3006.3
HACKER INDUSTRIES INC — Type Hacker SoundMat II.
Alternate Floor Mat Materials - (Optional) — Floor mat material nom 1/8 in. (3 mm) thick loose laid over the subfloor. Floor topping thickness shall be a min of 1 in. (25 mm)
HACKER INDUSTRIES INC — Type FIRMFILL SCM125
Alternate Floor Mat Materials - (Optional) — Floor mat material nom 1/4 in. (6 mm) thick loose laid over the subfloor. Floor topping thickness shall be a min of 1 in. (25 mm)
HACKER INDUSTRIES INC — Type FIRMFILL SCM250, Quiet Qurl 65/025
Alternate Floor Mat Materials - (Optional) — Floor mat material nom 3/4 in. (19 mm) thick loose laid over the subfloor. Floor topping thickness shall be a min of 1-1/4 in. (32 mm)
HACKER INDUSTRIES INC — FIRMFILL SCM 400, Quiet Qurl 65/040
Alternate Floor Mat Materials - (Optional) — Floor mat material nom 3/4 in. (19 mm) thick loose laid over the subfloor. Floor topping thickness shall be a min of 1-1/2 in. (38 mm)
HACKER INDUSTRIES INC — Type FIRMFILL SCM 750, Quiet Qurl 65/075
Metal Lath (Optional) — For use with 3/8 in. (10 mm) floor mat materials, 3/8 in. expanded steel diamond mesh, 3.4 lbs/sq yd placed over the floor mat material. Hacker Floor Primer to be applied prior to the placement of the metal lath. When metal lath is used, floor topping thickness a nom 1-1/4 in. over the floor mat. Finish Flooring - Floor Topping Mixture* — Min 1 in. thickness of floor topping mixture for min 15/32 or min 1/2(2) in. thick wood structural panels respectively, having a min compressive strength of 1100 psi. Mixture shall consist of 6.6 gal of water to 80 lbs of floor topping mixture to 1.9 cu ft of sand.
HACKER INDUSTRIES INC — Firm-Fill Gypsum Concrete, Firm-Fill 2510, Firm-Fill 3310, Firm-Fill 4010, Firm-Fill High Strength, DycoSpan Radiant
System No. 5
Subflooring — Min 1/2(2) in. thick wood structural panels, min grade "C-D" or "Sheathing". Face grain of plywood or strength axis of panels to be perpendicular to the joints with joints staggered.
Vapor Barrier - (Optional) — Nom 0.030 in. thick commercial asphalt saturated felt.
Finish Flooring - Floor Topping Mixture* — Min 1in. thickness of floor topping mixture having a min compressive strength of 1000 psi and a cast density of 100 plus or minus 5 pcf. Foam concentrate mixed 40:1 by volume with water and expanded at 100 psi through nozzle. Mixture shall consist of 1.4 cu feet of preformed foam concentrate to 94 lbs Type I Portland cement, 62.5lb of pea gravel, 312.5 lbs of sand with 5-1/2 gal of water.
LITE-CRETE INC — Type I
System No. 6
Subflooring — Min 1/2(2) in. thick wood structural panels, min grade "C-D" or "Sheathing". Face grain of plywood or strength axis of panels to be perpendicular to the joints with joints staggered.
Vapor Barrier - (Optional) — Nom 0.030 in. thick commercial asphalt saturated felt.
Finish Flooring - Floor Topping Mixture* — Min 3/4 or 1 in. thickness of floor topping mixture for 1/2(2) or 15/32 in. thick wood structural panels respectively, having a min compressive strength of 1000 psi. Mixture shall consist of 5 to 8 gal of water to 80 lbs of floor topping mixture to 2 1 cu ft of sand.
ULTRA QUIET FLOORS — UQF-A, UQF-Super Blend, UQF-Plus 200
System No. 7
Subflooring — Min 1/2(2) in. thick wood structural panels, min grade "C-D" or "Sheathing". Face grain of plywood or strength axis of panels to be perpendicular to the joints with joints staggered.
Vapor Barrier - (Optional) — Nom 0.030 in. thick commercial asphalt saturated felt.
Finish Flooring - Floor Topping Mixture* — Min 3/4 or 1 in. thickness of floor topping mixture for 1/2(2) or 15/32 in. thick wood structural panels respectively, having a min compressive strength of 1000 psi. Refer to manufacturer's instructions accompanying the material for specific mix design.
ULTRA QUIET FLOORS — UQF-A, UQF-Super Blend, UQF-Plus 200
System No. 8
Deleted
System No. 9
Subflooring — Min 1 by 6 in. T & G lumber fastened diagonally to joists, or min 1/2(2) in. thick wood structural panels or 7/16 in. thick oriented strand board (OSB) wood structural panels, min grade "C-D" or "Sheathing". Face grain of plywood or strength axis of panels to be perpendicular to the joists with joints staggered.
Finish Floor - Mineral and Fiber Board* — Min 1/2 in. thick, supplied in sizes ranging from 2 ft by 4 ft to 8 ft by 12 ft. All joints to be staggered 12 in. with adjacent sub-floor joints.
HOMASOTE CO — Type 440-32 Mineral and Fiber Board
System No. 10
Subflooring — Min 1/2(2) in. thick wood structural panels, min grade "C-D" or "Sheathing". Face grain of plywood or strength axis of panels to be perpendicular to the joints with joints staggered.
Vapor Barrier - (Optional) — Nom 0.030 in. thick commercial asphalt saturated felt.
Finish Flooring - Floor Topping Mixture* — Min 1-1/2 in. thickness of floor topping mixture having a min compressive strength of [illegible] and a cast density of 105 plus or minus 5 pcf. Foam concentrate mixed 40:1 by volume with water and expanded at [illegible] through nozzle. Mixture shall consist of [illegible] cu feet of preformed foam concentrate to 94 lbs Type I Portland cement, 300 lbs of sand mixed with 5.5 gal of water.
AERIX INDUSTRIES — Floor-Topping Mixture
System No. 11
Subflooring — Min 15/32 in. thick wood structural panels, min grade "C-D" or "Sheathing". Face grain of plywood or strength axis of panels to be perpendicular to the joints with joints staggered.
Vapor Barrier - (Optional) — Nom 0.010 in. thick commercial resin-sized building paper.
Finish Flooring - Floor Topping Mixture* — Min 3/4 or 1 in. thickness of floor topping mixture for 15/32 or 1/2(2) in. thick wood structural panels respectively, having a min compressive strength of 1000 psi. Refer to manufacturer's instructions accompanying the material for specific mix design.
ALLIED CUSTOM GYPSUM — Types Acoustic Mix, Level 1 Mix, Level 2 Mix, AccuLevel 1, AccuLevel 2
Alternate Floor Mat Materials* - (Optional) - 5.5 mm (7/32 in.) nominal - 9.5 mm (3/8 in.) nominal thickness of floor topping mixture over the subfloor. Floor topping shall be a min of 3/4 in. or 1 in. thick of floor topping mixture for 15/32 or 1/2(2) in. thick wood structural panels respectively.
ALLIED CUSTOM GYPSUM — Types Level 1 Mix, Level 2 Mix, P80, Type AccuQuiet CAC, AccuQuiet D13, and Type AccuQuiet D-18.
System No. 12
Subflooring — 15/32 or 1/2(2) in. thick wood structural panels, min. grade "C-D" or "Sheathing". Face grain of plywood or strength axis of panels to be perpendicular to joists with joints staggered
Vapor Barrier — Nom 0.020 in. thick commercial asphalt saturated felt.
Finish Flooring - Floor Topping Mixture* — Min 3/4 or 1 in. thickness of floor topping mixture for 15/32 or 1/2(2) in. thick wood structural panels respectively, having a min. compressive strength of 2150 psi. Refer to manufacturer's instructions accompanying the material for specific mix design.
System No. 13
Subflooring — Min 15/32 in. thick wood structural panels, min grade "C-D" or "Sheathing". Face grain of plywood or strength axis of panels to be perpendicular to the joints with joints staggered.
Vapor Barrier — (Optional) — Commercial asphalt saturated felt, 0.030 in. thick.
Floor Barrier — (Optional) — Nom 0.010 in. thick commercial resin-sized building paper.
Finish Flooring* — Nom 3/4 in. thickness of any Floor Topping Mixture bearing the UL Classification Marking as to Fire Resistance. See Floor- and Roof-Topping Mixtures (CCOR) category for names of Classified Companies
Floor Mat Materials* — (Optional) - Nom 3/32 in. thick loose laid over the subfloor. Floor topping thickness shall be a minimum of 3/4 in.
PLITEQ INC — Type GenieMat RST32
Floor Mat Materials* — (Optional) - Nom 3/16 in. thick loose laid over the subfloor. Floor topping thickness shall be a minimum of 3/4 in.
PLITEQ INC — Type GenieMat FP24
Floor Mat Materials* — (Optional) - Nom 1/4 in. thick loose laid over the subfloor. Floor topping thickness shall be a minimum of 3/4 in.
PLITEQ INC — Type GenieMat FP06
Floor Mat Materials* — (Optional) - Nom 3/8 in. thick loose laid over the subfloor. Floor topping thickness shall be a minimum of 1 in.
PLITEQ INC — Type GenieMat FP10
Floor Mat Materials* — (Optional) - Nom 3/4 in. thick loose laid over the subfloor. Floor topping thickness shall be a minimum of 1-1/2 in.
PLITEQ INC — Type GenieMat FP17
Floor Mat Materials* — (Optional) - Nom 1 in. thick loose laid over the subfloor. Floor topping thickness shall be a minimum of 1-1/2 in.
PLITEQ INC — Type GenieMat FP25
2. Wood Joists — Min 2 by 10, spaced 16 in. OC and effectively fireblocked in accordance with local codes.
3. Cross Bridging — Min 1 by 3 in. or min 2 by 1 in solid blocking.
4. Resilient Channels — Resilient channels, formed from No. 25 MSG galv steel and shaped as shown, spaced 24 in. OC perpendicular to joist. Channels overlapped 1-1/2 in. at splices and secured to each joist with one 8d common nail. Min end clearance of channels to wall to be 3/4 in. Additional pieces, 60 in. long, placed immediately adjacent to continuous channels at end joints of second layer of gypsum board (Item 5) and similarly secured. Additional channels shall extend 6 in. beyond each side edge of board.
4A. Steel Framing Members — As an alternate to Item 4, furring channels and Steel Framing Members* as described below:
a. Furring Channels — Furring channels, formed of No. 25 MSG galv steel, 2-6/16 in. or 2-03/20 in. wide by 7/8 in. deep, spaced 24 in. OC perpendicular to joists. Channels secured to joists as described in Item b. Ends of adjoining channels overlapped 6 in. and tied together with double strand of No. 18 SWG galv steel wire near each end of overlap.
b. Steel Framing Members* — Used to attach furring channels (Item a) to joists (Item 2). Clips spaced 48 in. OC., and secured to alternating joists with No. 8 x 2-1/2 in. coarse drywall screw through the center grommet. Furring channels are friction fitted into clips. RSIC-1 clip for use with 2-6/16 in. wide furring channels. RSIC-1 (F.75) clip for use with 2-03/20 in. wide furring channels. Adjoining channels are overlapped as described in Item a. As an alternate, ends of adjoining channels may be overlapped 6 in. and secured together with two self-tapping #6 framing screws, min 7/16 in. long at the midpoint of the overlap, with one screw on each flange of the channel. Additional clips required to hold furring channel that supports the wallboard butt joints, as described in Item 5.
PACIN INTERNATIONAL L L C — Types RSIC-1, RSIC-1 (F.75)
4B. Steel Framing Members — (Not Shown) * - As an alternate to Items 4, furring channels and Steel Framing Members as described below:
a. Furring Channels — Formed of No. 25 MSG galv steel, 2-6/16 in. wide by 7/8 in. deep, spaced 24 in OC, perpendicular to joists. Channels secured to joists as described in Item b. Ends of adjoining channels overlapped 6 in. and tied together with double strand of No. 18 SWG galv steel wire near each end of overlap.
b. Steel Framing Members* — Used to attach furring channels (Item a) to the wood joists (Item 2). Clips spaced 48 in. OC., and secured to alternating joists with No. 8 x 2-1/2 in. coarse drywall screw through the center grommet. Furring channels are friction fitted into clips. Adjoining channels are overlapped as described in Item a. As an alternate, ends of adjoining channels may be overlapped 6 in. and secured together with two self-tapping No. 6 framing screws, min 7/16 in. long at the midpoint of the overlap, with one screw on each flange of the channel. Additional clips required to hold furring channel that supports the gypsum board butt joints, as described in Item 5.
PLITEQ INC — Type Genie Clip
4C. Alternate Steel Framing Members — (Not Shown)* - As an alternate to Item 4, furring channels and Steel Framing Members as described below.
a. Furring Channels — Formed of No. 25 MSG galv steel, 2-5/8 in. wide by 7/8 in deep, spaced 24 in OC, perpendicular to joists. Channels secured to joists as described in Item b
b. Steel Framing Members* — Used to attach furring channels (Item a) to the wood joists (Item 2). Clips spaced at 16 in. OC and secured to the bottom of the joists with one No. 10 x 2-1/2 Coarse Drywall Screw through the center hole. Furring channels are then friction fitted into clips. Ends of channels are overlapped 6" and screwed with four #8 x 1/2 Self Drilling screws (2 per side 1 in. and 4 in. from overlap edge). Additional clips are required to hold the Gypsum Butt joints and side joints as described in Item 5.
STUDCO BUILDING SYSTEMS — RESILMOUNT Sound Isolation Clips - Type AZ37R
5. Gypsum Board* — Two layers 5/8 in. thick gypsum board. When resilient channels (Item 4) are used, first layer installed with long dimension perpendicular to joists, and end joints of boards located at the joists. Nailed to joists with uncoated 8d box nails spaced 7 in. OC. All nails located 1/2 in. min distance from the edges and ends of the board. Second layer installed with long dimension perpendicular to the resilient channels and center line of boards located under a joint and to be joined. Place the edge joint of this layer is not in alignment with the end joint of the first layer. Secured to resilient channels with 1 in. long gypsum board screws 12 in. OC with additional screws 2 in. from side joints. End joints secured to both resilient channels as shown in end joint detail. All screws located 1 in. min distance from edges of boards. If gypsum board is other than 48 in. wide, length of additional channel may be modified as required to allow full extension along joints, as well as attachment to joists at each end. Joint treatment not required for this rating, except for tapered, rounded edge gypsum board where edge joints are covered with paper tape and joint compound. As an alternate, nom 3/32 in. thick gypsum veneer plaster may be applied to the entire surface of Classified veneer baseboard. Joints reinforced.
When Steel Framing Members (Items 4A or 4B) are used, sheets installed with long dimensions parallel with joists. Base layer attached to the furring channels using 1 in. long Type S bugle-head steel screws spaced 8 in. OC along butted end joists and 12 in. OC in the field of the board. Butted end joints shall be staggered min 2 ft. within the assembly, and occur midway between the continuous furring channels. Each end of each gypsum board shall be supported by a single length of furring channel equal to the width of the gypsum board plus 6 in. on each end. The two furring channels shall be spaced approximately 3-1/2 in. OC, and be attached to underside of the joist with one RSIC-1 or Genie clip at each end of the channel. Butted base layer end joints to be offset a min of 24 in. in adjacent courses. Outer layer attached to the furring channels using 1-5/8 in. long Type S bugle-head steel screws spaced 8 in. OC at butted joints and 12 in. OC in the field. Butted end joints to be offset a min of 6 in. from base layer end joints. Butted side joints of outer layer to be offset min 1/8 in. from butted side joints of base layer.
When Steel Framing Members (Item 4C) are used, base layer of nom 5/8 in. thick, 4 ft wide gypsum board is installed with long dimensions perpendicular to furring channels. Gypsum board secured to furring channels with nom 1 in. long Type S bugle-head steel screws spaced 8 in. OC in the field of the board. Gypsum board butted end joints shall be staggered minimum 72