entegra
integrated energy engineering
262 Dickinson Drive | Reading | PA | 19605
610-750-9129 | www.entegraeng.com

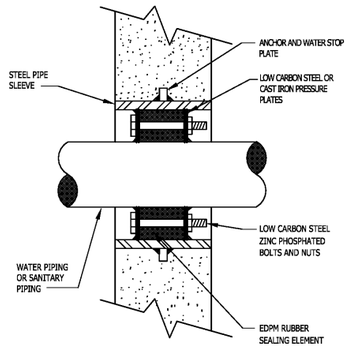

1 PIPE PENETRATIONS THRU-WALL UNDERGROUND
NOT TO SCALE

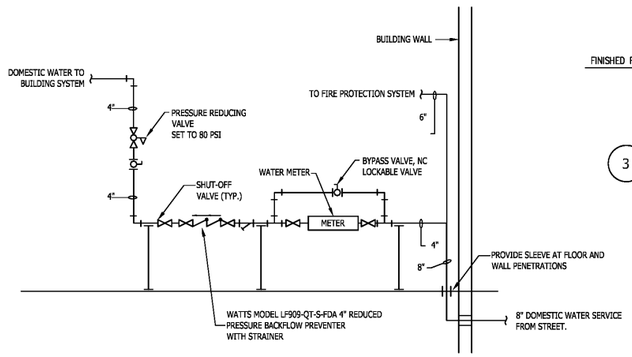

2 DOMESTIC WATER SERVICE ENTRANCE ASSEMBLY DETAIL
NOT TO SCALE

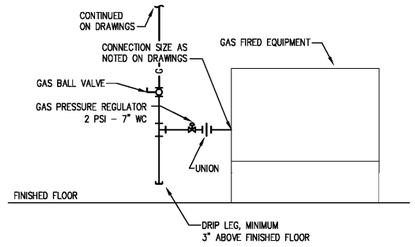

3 GAS CONNECTION TO INDOOR EQUIPMENT DETAIL
NOT TO SCALE

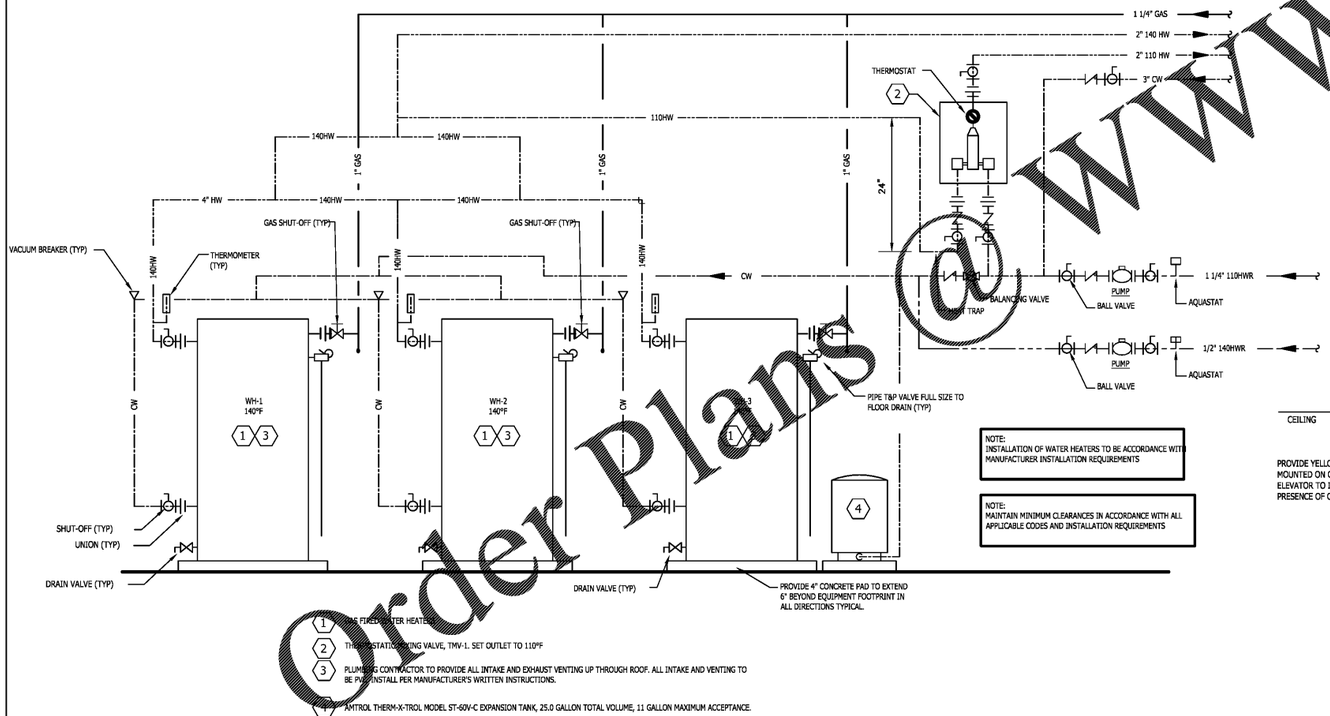

5 WATER HEATER DETAIL
SCALE: NOT TO SCALE

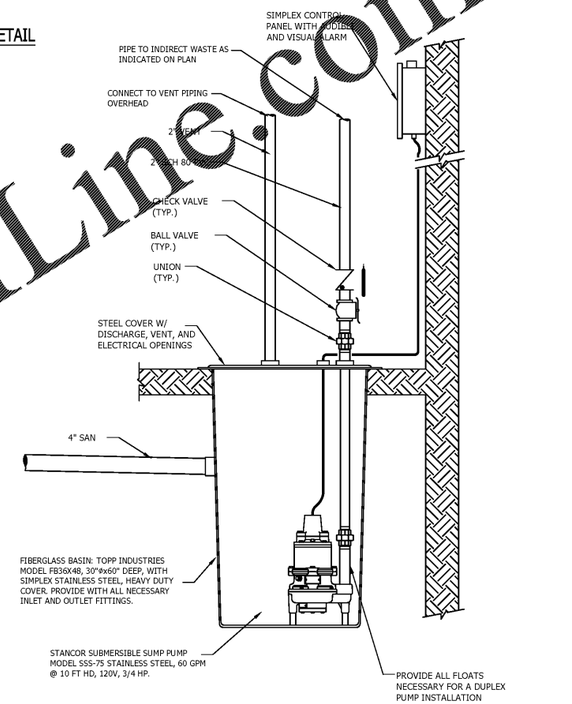

7 POOL SUMP PUMP DETAIL
SCALE: NOT TO SCALE

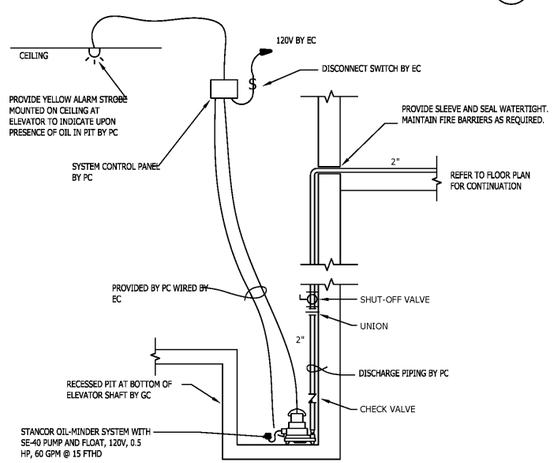

6 ELEVATOR SUMP PUMP DETAIL
SCALE: NOT TO SCALE

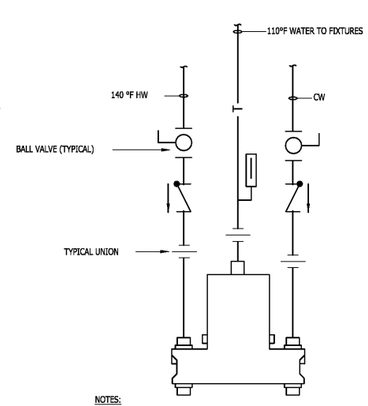

NOTES:
1. PROVIDE TEMPERATURE GAUGE ON TEMPERED OUTLET.

4 THERMOSTATIC MIXING VALVE DETAIL
NOT TO SCALE

Order Plans @ WWW.LDILine.com

No.	Description	Date

DISCLAIMER:
Meister-Cox Architects PC, is providing, by agreement with certain parties, materials stored electronically. The parties recognize that data, plans, specifications, reports, documents or other work products created and transmitted as electronic media (including but not necessarily limited to word processing documents, drawings, models and digital data) is susceptible, either intentional or unintentional, due to, among other causes, transmission, conversion, media degradation, software error or human alteration, to unauthorized use or change. Documents are provided to the parties for informational purposes only and are not suitable for reliance or recording document. Any reliance thereon it is deemed to be unreasonable. Only those documents bearing the original or stamped hard copies of the Architect's instruments of Service are the only true documents of record.

MEISTER-COX ARCHITECTS
INFO@MEISTER-COX.COM
PHONE: 610-375-1331 FAX: 610-375-4555
1522 PENN AVENUE WYOMISSING, PA 19610
WWW.MEISTER-COX.COM

SEAL:

PLUMBING DETAILS

HOLIDAY INN EXPRESS & SUITES
INTERSECTION OF HAYNES PLACE & LAMM RD.
WILSON, NC 27893

STATUS:	FOR BID
PROJ. DATE:	06/06/2019
PROJ. NO.	19-116
PRINTED:	06/06/2019
DRAWN BY:	jlm/brm/jpk
CHECKED BY:	brm
SHEET NO.	P8.1
SCALE:	AS NOTED