entegra
integrated energy engineering
262 Dickinson Drive | Reading | PA | 19605
610-750-9129 | www.entegraeng.com

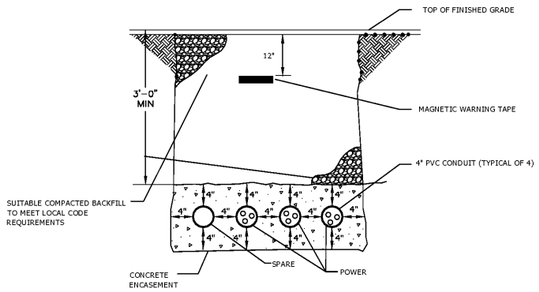

NOTE: ELECTRICAL CONTRACTOR RESPONSIBLE FOR CONCRETE, TRENCHING, AND BACKFILLING

1 DUCT BANK DETAIL
SCALE: N.T.S.

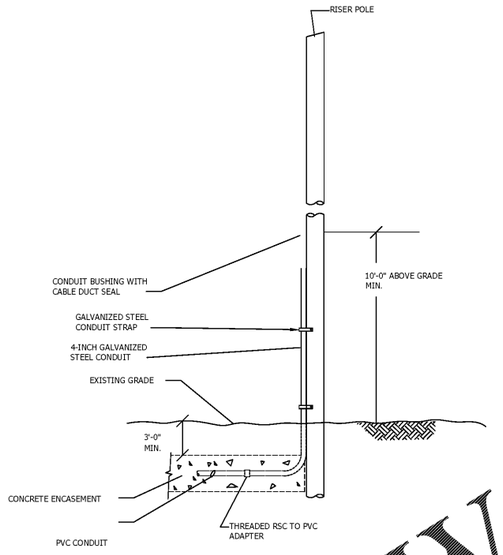

2 RISER POLE DETAIL
SCALE: N.T.S.

NOTE:

1) GROUND RIGID STEEL CONDUIT AS REQUIRED PER NEC.

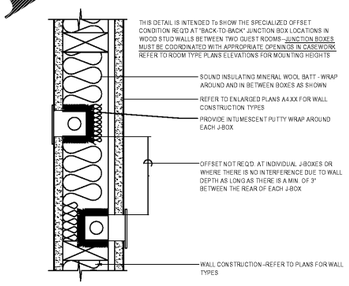

5 BACK-TO-BACK J. BOX OFFSET REQUIREMENTS
SCALE: N.T.S.

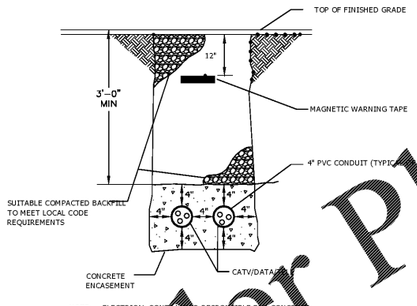

NOTE: ELECTRICAL CONTRACTOR RESPONSIBLE FOR CONCRETE, TRENCHING, AND BACKFILLING

3 DUCT BANK DETAIL
SCALE: N.T.S.

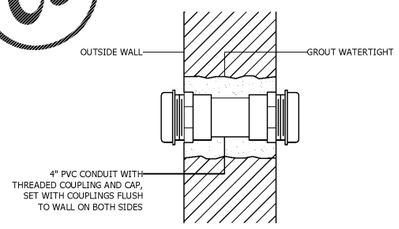

4 UNDERGROUND CONDUIT PENETRATION
SCALE: N.T.S.

Order Plans @ WWW.LDILine.com

No.	Description	Date

DISCLAIMER:
Meister-Cox Architects PC, is providing, by agreement with certain parties, materials stored electronically. The parties recognize that data, plans, specifications, reports, documents or other work products exchanged or transmitted as electronic media (including but not necessarily limited to AIA documents) may be subject to undetectable alteration, either intentional or unintentional, due to, among other causes, transmission, conversion, media degradation, software error or human alteration. Accordingly, all such documents are provided to the parties for informational purposes only and solely for their convenience and at their sole risk. Any reliance thereon is deemed to be unreasonable. The parties agree that the sealed and signed stamped hard copies of the Architect's instruments of Service are the only true documents of record.

MEISTER-COX ARCHITECTS
INFO@MEISTER-COX.COM
PHONE: 610-375-1331 FAX: 610-375-4555
1522 PENN AVENUE WYOMISSING, PA 19610
WWW.MEISTER-COX.COM

SEAL:

ELECTRICAL DETAILS

HOLIDAY INN EXPRESS & SUITES
INTERSECTION OF HAYNES PLACE & LAMM RD.
WILSON, NC 27893

STATUS:	FOR BID
PROJ. DATE:	06/06/2019
PROJ. NO.	19-116
PRINTED:	06/06/2019
DRAWN BY:	jlm/brm/jpk
CHECKED BY:	brm
SHEET NO.	E8.2
SCALE:	AS NOTED