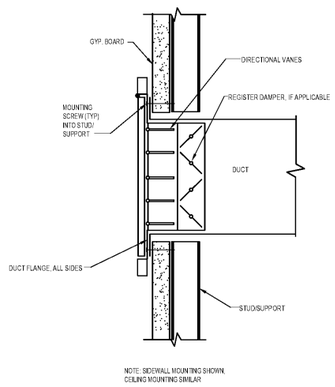

1 M-201 **WALL MOUNTED AIR DEVICE DETAIL**
NOT TO SCALE



2 M-201 **COMBINATION LOUVER DETAIL**
NOT TO SCALE

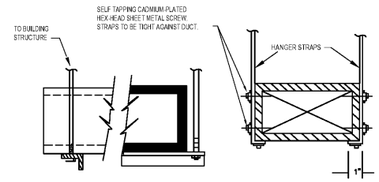

HANGER SIZES FOR RECTANGULAR DUCTS			
MAX. SIDE	HANGER	SUPPORT ANGLE HORIZONTAL	SPACING MAXIMUM
30"	1" x 18" GAUGE STRAP	NONE REQUIRED	10'-0"
36"	1/4" ROUND ROD	1-1/2" x 1-1/2" x 1/8"	8'-0"
48"	1/4" ROUND ROD	2" x 2" x 1/8"	8'-0"
60"	5/16" ROUND ROD	2" x 2" x 1/8"	8'-0"
84"	3/8" ROUND ROD	2" x 2" x 1/8"	8'-0"

3 M-201 **RECTANGULAR DUCT HANGER DETAIL**
NOT TO SCALE



4 M-201 **TYPICAL BRANCH TAKE-OFF DETAIL**
NOT TO SCALE



5 M-201 **ROUND DUCT HANGER DETAIL**
NOT TO SCALE

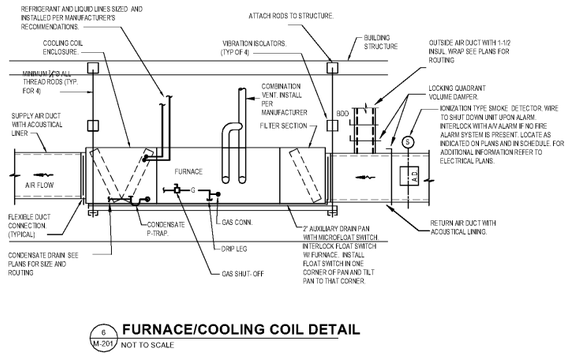

6 M-201 **FURNACE/COOLING COIL DETAIL**
NOT TO SCALE

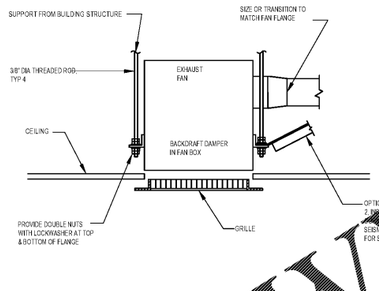

7 M-201 **CEILING EXHAUST FAN**
NOT TO SCALE

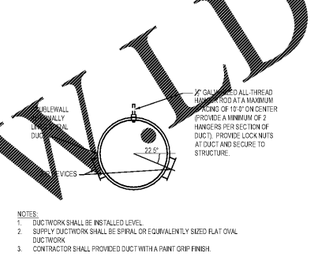

8 M-201 **DUCT MOUNTED DIFFUSER DETAIL**
NOT TO SCALE

Order Plans @ WWW.LDILine.com

ODa
overcash demmitt
2010 south tryon st. suite 1a
charlotte north carolina 28203
office.704.332.1615
web.www.odarch.com

NORTH CAROLINA PROFESSIONAL ENGINEER SEAL 046819 MARVIN R. DILLARD
6/28/2019

WAVE ENGINEERING
1800 E. MAINT ST., SUITE 110
CHARLOTTE NC 28203
704.332.1615
INFO@WAVEENGINEERING.COM
NC CORP. LICENSE #P-1927
WAVE PROJECT: # 19112

Hustle House

ODA Project No. 183324

Charlotte, NC

FOR CONSTRUCTION

06.28.2019

REVISIONS		
No.	Description	Date

MECHANICAL DETAILS

M-201

Copyright 2017 Overcash Demmitt Architects