LIGHT FIXTURE SCHEDULE

TYPE	MANUFACTURER	CATALOG #	LUMENS/LAMPS	DRIVER/BALLASTS	WATTS	VOLTAGE	DESCRIPTION
L1	GOTHAM CREE HE WILLIAMS	EVO 35/15 6AR M LSS MVOLT S-DL 6/24L 35K UNV L60 L15/G3S-CS-M DIM UNV	1500 LUMENS, LED, 3500K	0-10V DIMMING DRIVER	19W	MVOLT	6" RECESSED LED DOWNLIGHT. CLEAR REFLECTOR WITH SEMI-SPECULAR FINISH. ARCHITECT SHALL VERIFY TRIM COLOR & FINISH PRIOR TO ORDERING.
L2	SELECTED BY OWNER	TO BE DETERMINED			60W	120V	UL LISTED DECORATIVE PENDANT FIXTURE. FIXTURE SELECTED BY OWNER AND INSTALLED BY THE CONTRACTOR. PROVIDE STRUT AND ALL THREAD FOR MOUNTING TO SUSPENSION HEIGHT AS DETERMINED BY TENENT/ARCHITECT.
L3	GOTHAM CREE HE WILLIAMS	EVO CYL 35/20 6AR M LSS MVOLT EQUAL EQUAL	2000 LUMENS, LED, 3500K	0-10V DIMMING DRIVER	23.2W	MVOLT	6" SUSPENDED LED CYLINDER DOWNLIGHT. CLEAR REFLECTOR WITH SEMI-SPECULAR FINISH. ARCHITECT SHALL VERIFY TRIM COLOR & FINISH PRIOR TO ORDERING.
L4	GOTHAM CREE HE WILLIAMS	EVO 35/10 6AR M LSS MVOLT WL EQUAL EQUAL	1000 LUMENS, LED, 3500K	0-10V DIMMING DRIVER	15W	MVOLT	6" RECESSED LED DOWNLIGHT. CLEAR REFLECTOR WITH SEMI-SPECULAR FINISH. ARCHITECT SHALL VERIFY TRIM COLOR & FINISH PRIOR TO ORDERING. WET LOCATION RATED.
L5	SELECTED BY OWNER	TO BE DETERMINED			60W	120V	UL LISTED DECORATIVE PENDANT FIXTURE. FIXTURE SELECTED BY OWNER AND INSTALLED BY THE CONTRACTOR. PROVIDE STRUT AND ALL THREAD FOR MOUNTING TO SUSPENSION HEIGHT AS DETERMINED BY TENENT/ARCHITECT.
L6	WAC LIGHTING	MODEL 1603 BLACK (SILO X29 SHADED HEAD) (TRACK) PER RESPECTIVE MANUFACTURE TRACK LIMITER (WATTAGE PER PLAN)		ELECTRONIC PHASE DIMMING	22W	120V	BLACK ADJUSTABLE LED TRACK HEAD. LINE VOLTAGE AND DIMMING. VERIFY OPTIONS AND LAMP BEAM ANGLE WITH SPECIFIC ITEMS BEING HIGHLIGHTED (OTHER GENERAL ILLUMINATION - BLACK SINGLE CKT TRACK, LENGTH PER PLAN.
	LITHONIA MULE COMPASS	QM LED SERIES SQRXU SERIES CC SERIES	LED 2-5.4W/WEDGE	ELECTRONIC	1.5W/FACE 14W	MVOLT	WALL MOUNTED COMBO EMERG/LED EXIT SIGN WITH POLYCARBONATE HOUSING WITH SELF-CONTAINED POWERPACK FOR 90MIN OPERATION. NICAD BATTERY. BLACK HOUSING. RED LETTERS. (VERIFY COLOR WITH ARCH/INTERIORS)
	LITHONIA MULE COMPASS	LHQM SERIES MX SERIES CE SERIES	LED	ELECTRONIC	2.5W/FACE	120V	LED EXIT SIGN WITH SELF-CONTAINED POWER PACK FOR 90MIN OPERATION. BLACK HOUSING, NICAD BATTERY & RED LETTERS. (VERIFY COLOR WITH ARCH/INTERIORS)
	LITHONIA MULE COMPASS	ELM2 SERIES SQ LED SERIES CU2 SERIES	2-2.5W LED	ELECTRONIC	10W	120V	WALL MOUNTED SELF-CONTAINED EMERGENCY LIGHT POLYCARBONATE HOUSING WITH SELF-CONTAINED POWER PACK FOR 90MIN. OPERATION. BLACK (VERIFY COLOR WITH ARCH/INTERIORS) HOUSING.
	SIGNTEX MULE	MUE SERIES 6B 2HT EQUAL	TWO LAMPS INCLUDED		10W	120V	EXTERIOR EMERGENCY LIGHT WITH BATTERY BACKUP, TWO LAMPS AND UL WET LABEL, VERTTEX FINISH. 90 MINUTE EMERGENCY BATTERY BACKUP (VERIFY COLOR WITH ARCH/INTERIORS) 2" MULLION MOUNT W/REMOTE BATTERY.

FIXTURE NOTES:

1. SUBSTITUTIONS MUST BE EQUAL IN CONSTRUCTION, FINISH, ENERGY USAGE AND PHOTOMETRY. ALL SUBSTITUTIONS SHALL BE SUBMITTED TO THE ENGINEER, WITH CUTSHEETS AND PHOTOMETRY. THE ENGINEER MUST RECEIVE THESE WITH TIME ALLOWED TO REVIEW AND ISSUE A WRITTEN APPROVAL BACK TO THE SUBMITTING PARTY TEN(10) DAYS PRIOR TO BID. SUBSTITUTE FIXTURES SHALL BE LISTED SEPARATELY AND UNIT PRICED AT TIME OF BID, SO THAT THE ENGINEER AND OWNER CAN MAKE AN INFORMED DECISION. NO SUBSTITUTIONS WILL BE CONSIDERED AFTER THE 10 DAY PRIOR BID PROCESS ENDED.
2. SEE ARCHITECTURAL REFLECTED CEILING PLAN FOR EXACT FIXTURE LOCATIONS.
3. ALIGN ALL HORIZONTAL LUMINAIRES SO THAT THE LIGHT SOURCES ARE ALIGNED IN THE SAME DIRECTION.
4. SUSPEND TWO OPPOSITE CORNERS WITH WIRE TO STRUCTURE. DO NOT ALLOW GRID ALONE TO SUPPORT FIXTURE.
5. WHERE FIXTURE IS INDICATED AS EMERGENCY PROVIDE AN 1100 LUMEN INVERTER BATTERY PACK AND CONNECT AS INDICATED ON DETAIL THIS SHEET.
6. FIXTURE FLANGES AND TRIMS SHALL MATCH CEILING.

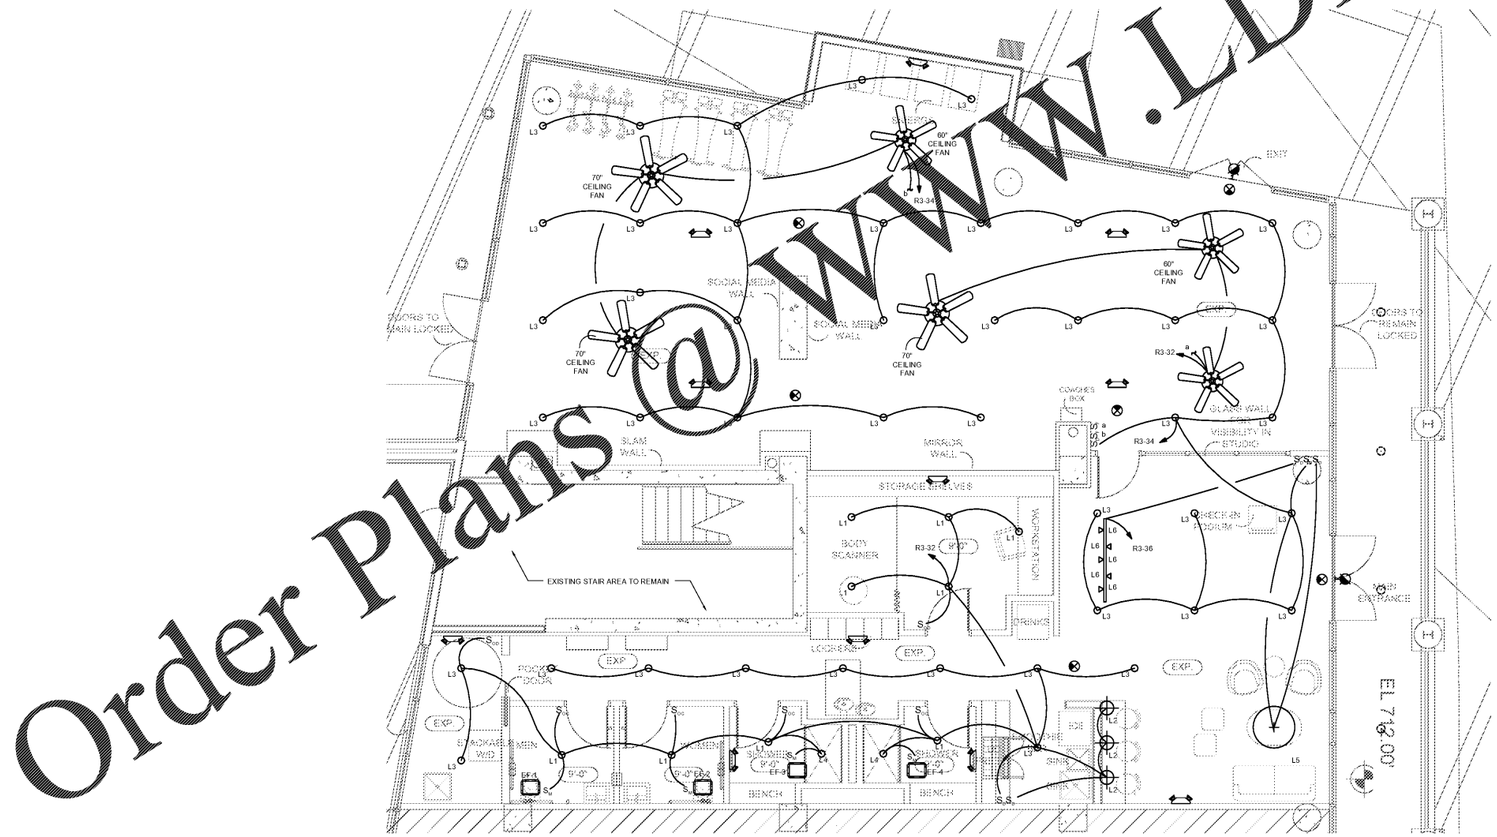

1 E-101 LIGHTING PLAN
SCALE: 1/4" = 1'-0"

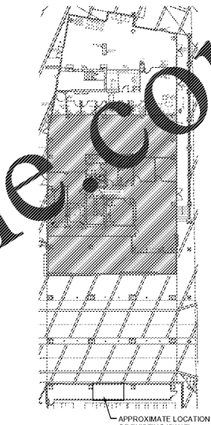

1 E-001 KEY PLAN
SCALE: 1" = 30'-0"

GENERAL NOTES THIS SHEET

1. ALL EMERGENCY/EGRESS FIXTURES SHALL BE CONNECTED TO LOCAL CIRCUIT SERVING RESPECTIVE AREA AND AHEAD OF ALL CONTROLS.
2. THE ELECTRICAL CONTRACTOR IS RESPONSIBLE FOR PROVIDING 0-10V CONDUCTORS FROM DIMMER SWITCHES TO ALL 0-10V LIGHTING AS REQUIRED.

ODa
overcash demmitt
2010 south tryon st. suite 1a
charlotte north carolina 28203
office.704.332.1615
web.www.odarch.com

NORTH CAROLINA REGISTERED LANDSCAPE ARCHITECT 087734 ENGINEER MICHAEL J. SMITH 12/8/2019

WAVE ENGINEERING
1325 S. MINT ST., SUITE 110
CHARLOTTE NC, 28203
704.900.6284
INFO@WAVE-ENGINEERING.COM
NC CORP. LICENSE #P-1627
WAVE PROJECT #181102

Hustle House

ODA Project No. 183324

Charlotte, NC

FOR CONSTRUCTION

06.28.2019

REVISIONS		
No.	Description	Date

LIGHTING PLAN & SCHEDULE

E-101

Copyright 2017 Overcash Demmitt Architects

Order Plans @ WWW.LDILine.com