




**SANITARY SEWER CLEANOUT**

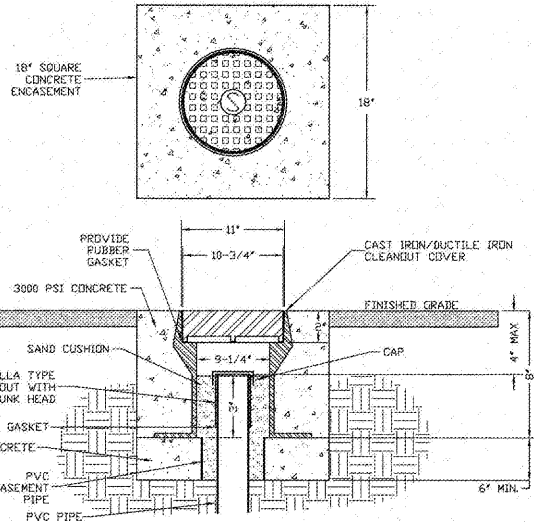

**CLEANOUT COVER ASSEMBLY TRAFFIC AREA**

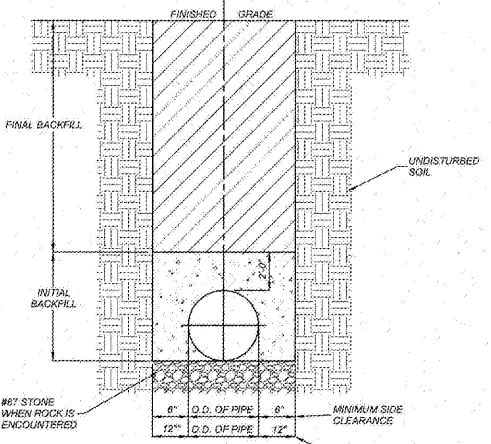

**TRENCH BOTTOM DIMENSIONS & BACKFILLING REQUIREMENTS FOR DUCTILE IRON AND REINFORCED CONCRETE PIPE**

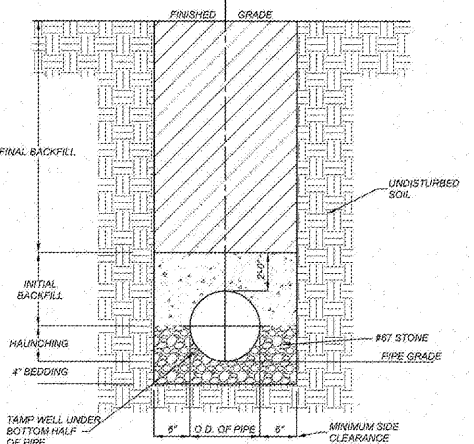

**TYPICAL TRENCH BOTTOM DIMENSIONS FOR SDR 35 PVC GRAVITY PIPE**

**TRENCH BOTTOM DIMENSIONS & BACKFILLING REQUIREMENTS FOR PVC GRAVITY SEWER MAIN**

**SANITARY SEWER TRENCH DETAILS**

- NOTES:**
1. TRENCHES REQUIRING SHORING AND BRACING, DIMENSIONS SHALL BE TAKEN FROM THE INSIDE FACE OF THE SHORING AND BRACING.
  2. NO ROCKS OR BOULDERS 4" OR LARGER TO BE USED IN INITIAL BACKFILL.
  3. ALL BACKFILL MATERIAL SHALL BE WELL GRADED GRANULAR MATERIAL COMPACTED TO 95% STANDARD PROCTOR MAXIMUM DRY DENSITY.
  4. BACKFILL SHALL BE TAMPED IN 6" LIFTS IN TRAFFIC AREAS, 8" 10" IN NON-TRAFFIC AREAS.
  5. 6" IN CASSEMENT 4" TOPSOIL, AND 1" CLEAR SELECT FILL IS REQUIRED.
  6. NO BOULDERS 8" IN DIAMETER OR GREATER ALLOWED.

- NOTES:**
1. FOR TRENCHES REQUIRING SHORING AND BRACING, DIMENSIONS SHALL BE TAKEN FROM THE FACE OF THE SHORING AND BRACING.
  2. NO ROCKS OR BOULDERS 4" OR LARGER TO BE USED IN INITIAL BACKFILL.
  3. ALL BACKFILL MATERIAL SHALL BE WELL GRADED GRANULAR MATERIAL COMPACTED TO 95% STANDARD PROCTOR MAXIMUM DRY DENSITY.
  4. BACKFILL SHALL BE TAMPED IN 6" LIFTS IN TRAFFIC AREAS, 8" 10" IN NON-TRAFFIC AREAS.

Order Plans @ www.LDILine.com

NO.	DATE	DESCRIPTION	BY

**COMMERCIAL SITE DESIGN**

8912 CREDMOR ROAD  
RALEIGH, NORTH CAROLINA 27615  
(919) 846-6021 FAX: (919) 848-3741  
WWW.CSDESIGN.COM

**CLIENT/OWNER:**  
COOK OUT  
15 LAURA LANE, SUITE 300  
THOMASVILLE, NC 27380  
TELEPHONE: (336) 215-7025  
FAX: (336) 474-1849

**COOKOUT FRESH HAMBURGERS**  
2557 COBBS FORD ROAD  
PRATTVILLE, ALABAMA  
**DETAILS**



PROJECT NO.	OUT-1913
FILENAME	OUT1913-DTL3
DRAWN BY	DDH
SCALE	N.T.S.
DATE	06-07-2019
SHEET NO.	<b>C-7</b>