


- WORK NOTES
- ① MAINTAIN ALL MANUFACTURERS RECOMMENDED CLEARANCES. MAINTAIN 10'-0" FROM EXHAUSTS AND PLUMBING VENTS.
  - ② MAINTAIN ALL MANUFACTURERS RECOMMENDED CLEARANCES. MAINTAIN 10'-0" O.A. INTAKES
  - ③ REFRIGERATION EQUIPMENT PROVIDED BY OTHERS.
  - ④ EXHAUST VENT CAPS. MAINTAIN 10'-0" FROM O.A. INTAKES.
  - ⑤ ROOF ACCESS.



VRETTOS PAPPAS CONSULTING ENGINEERS, P.A.  
 PO Box 31041, Charlotte, NC 28221  
 2515 Calleson Plazette Drive, Ste 100, Charlotte, NC 28217  
 704.372.7555 www.vpe.com


**COOK-OUT**  
 2557 COBBS FORD RD PRATTVILLE, AL 36066

Mk	Date	Description
		Revisions

**MECHANICAL  
 ROOF PLAN AND  
 NOTES**

Date 06/13/19  
 Drawn By SRP  
 Check By NMP  
 Job No. 19-037  
 Sheet

**M3**

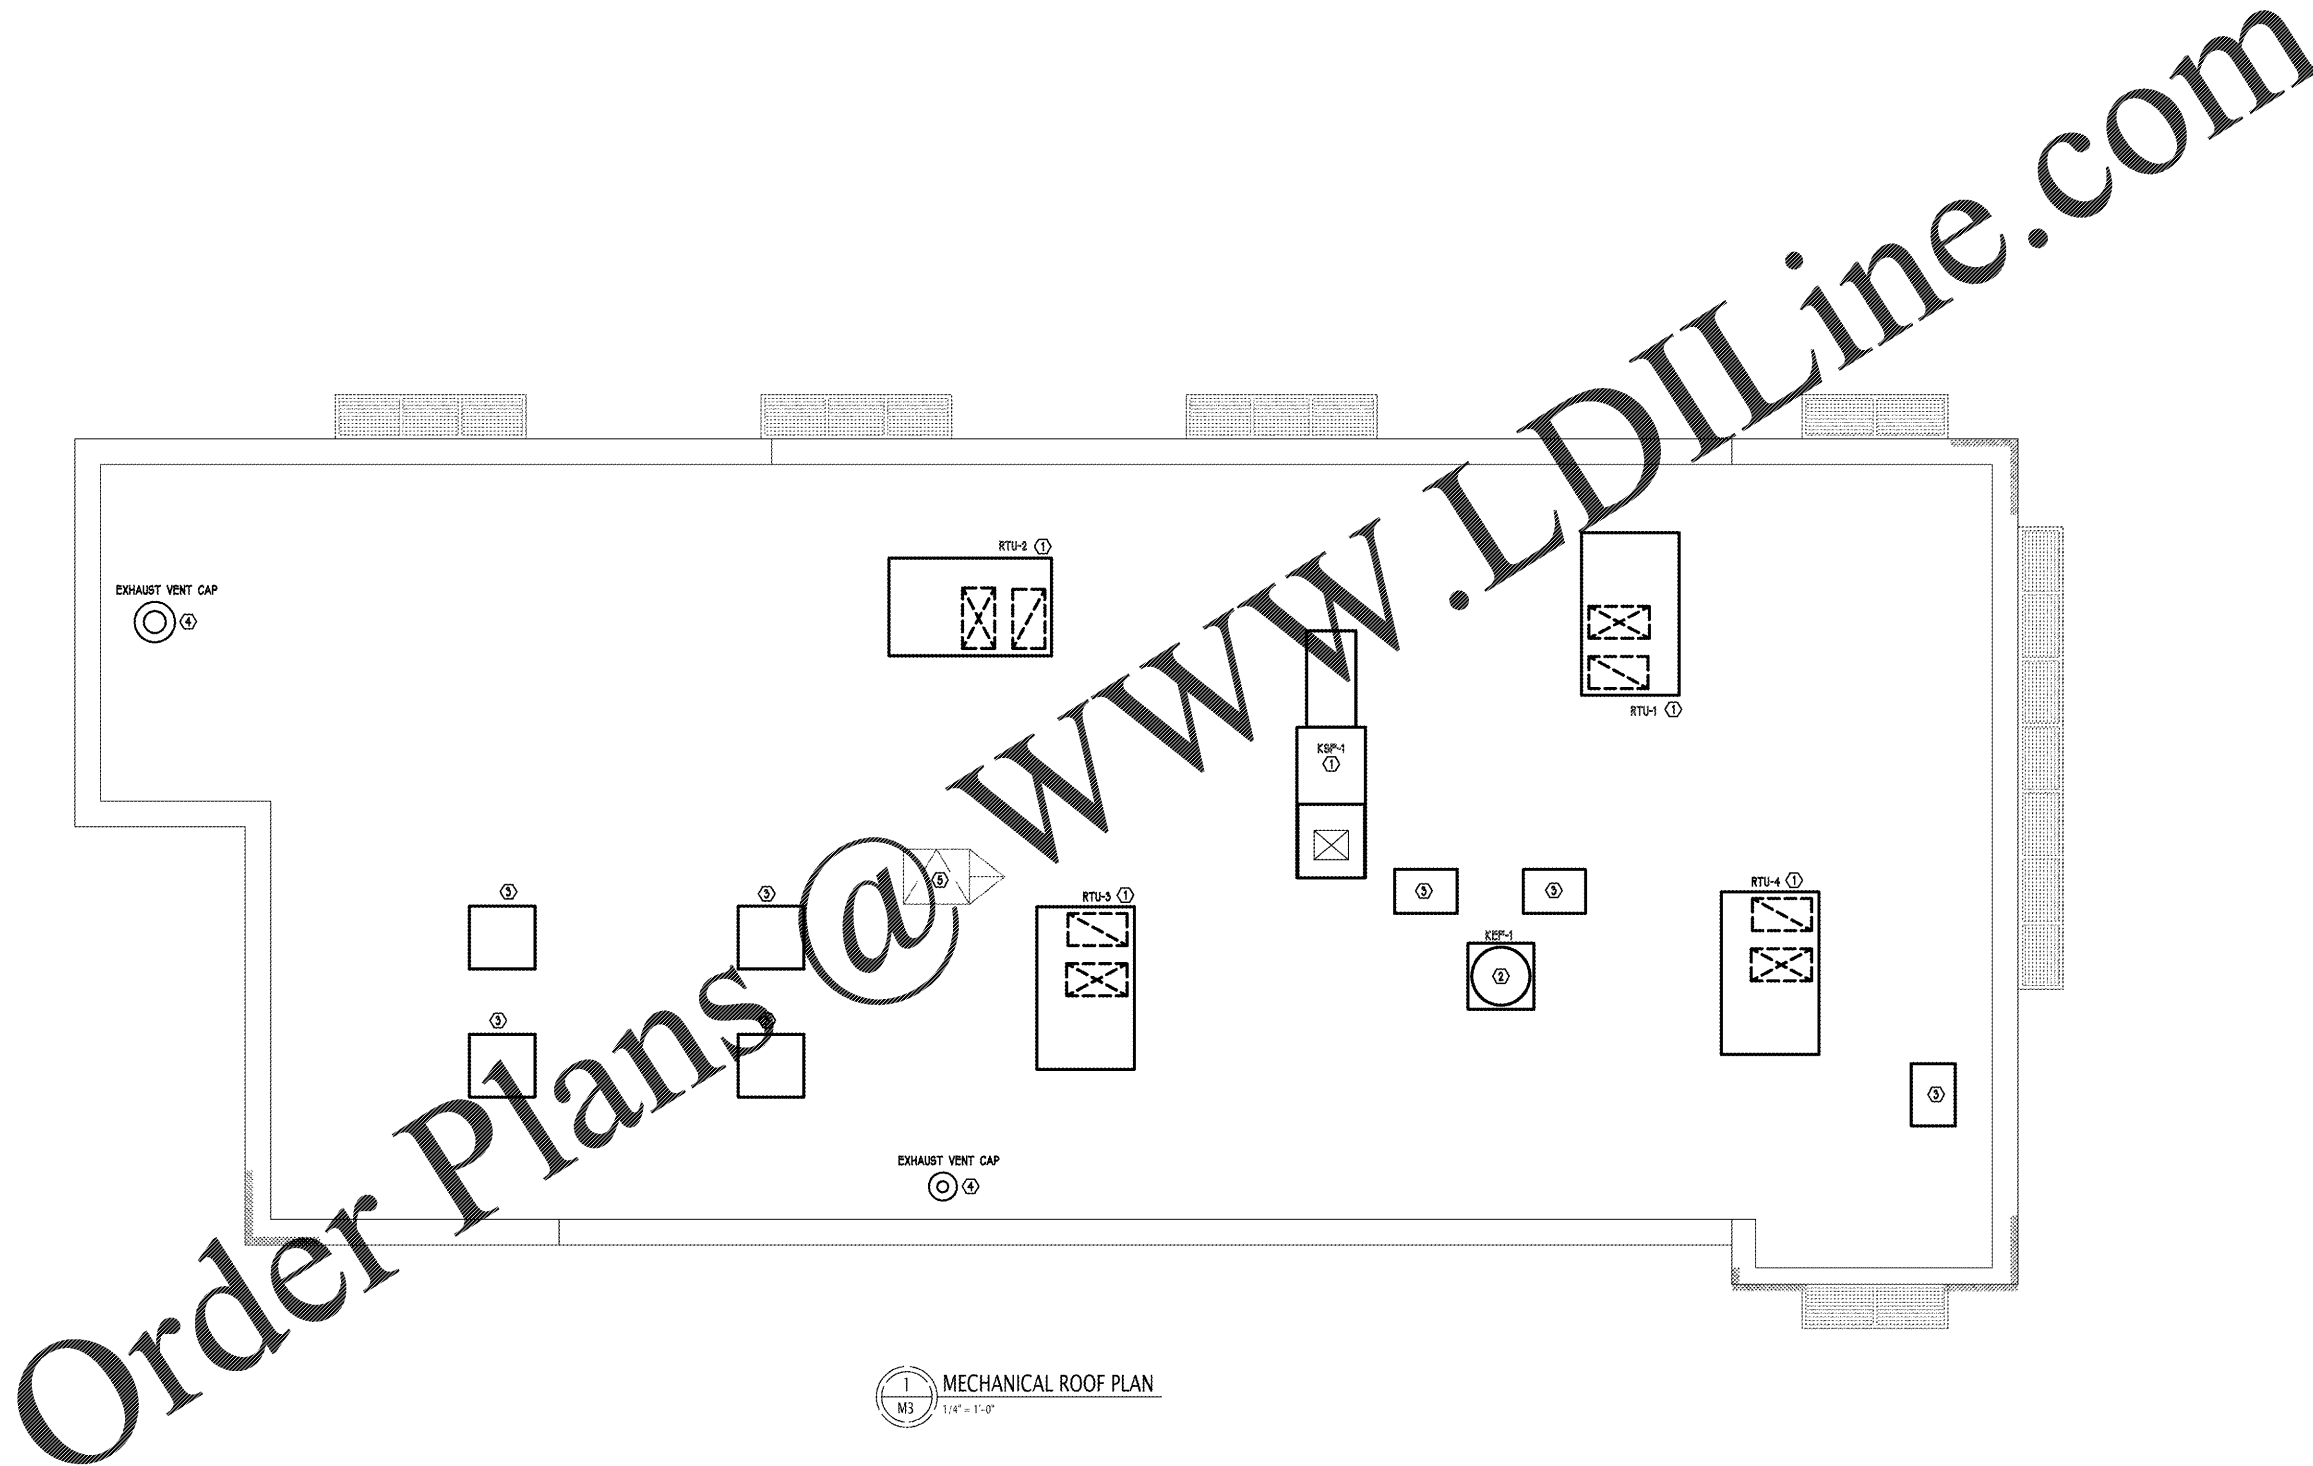

1 MECHANICAL ROOF PLAN  
 M3 1/4" = 1'-0"