NOTE:
ALL CONDUITS/CIRCUITRY SHALL BE CONCEALED IN THE CONCRETE SLABS. BEHIND WALLS, OR IN CHASES.

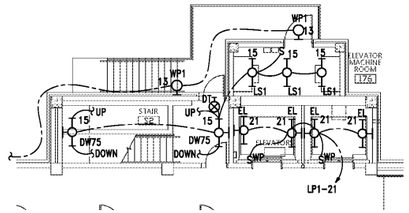

2 E2.1 PARTIAL 1ST FLOOR - ALTERNATE - LIGHTING
SCALE: 1/8"=1'-0"

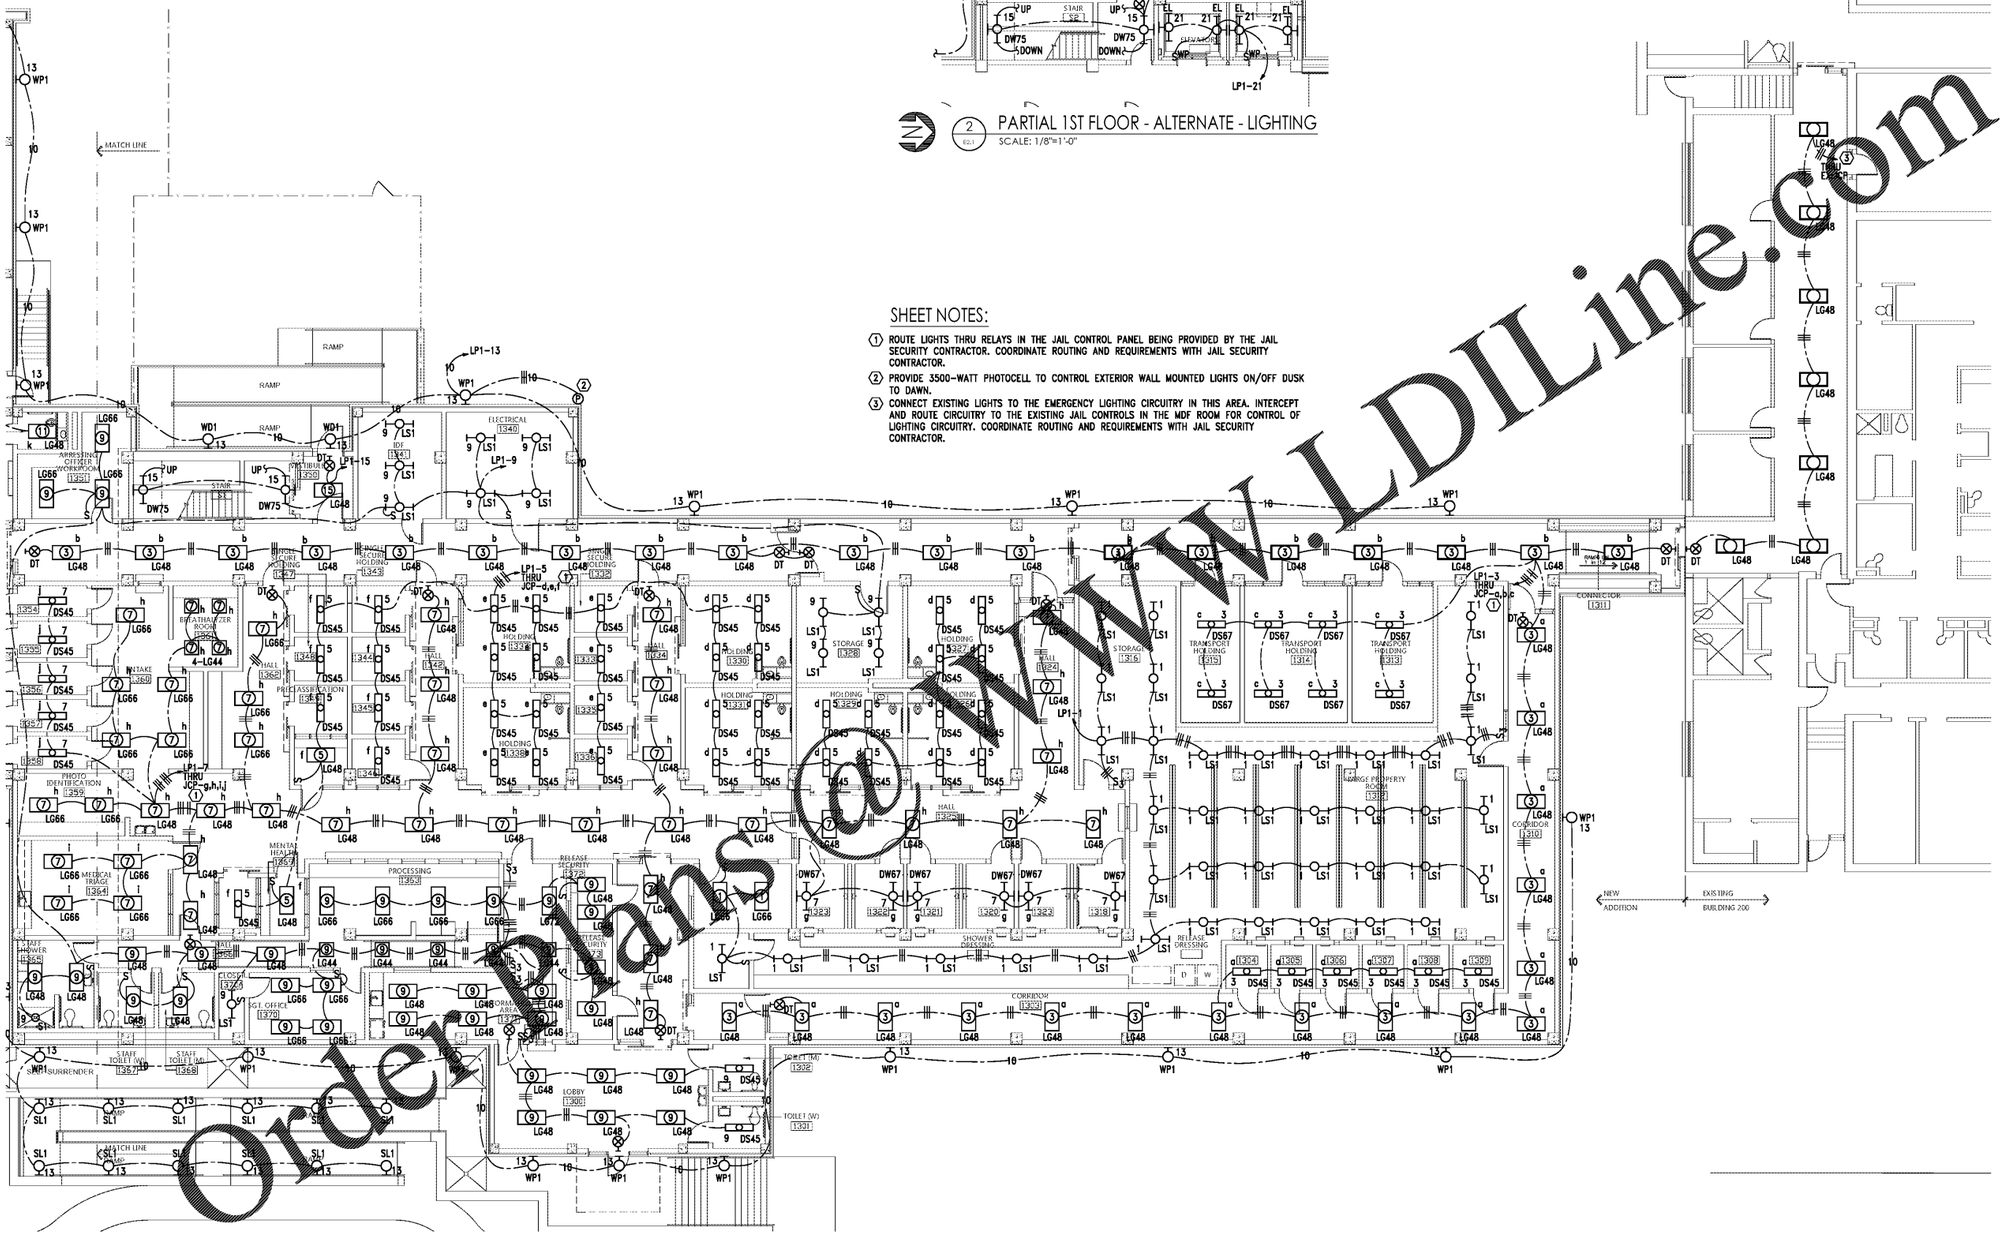

SHEET NOTES:

1. ROUTE LIGHTS THRU RELAYS IN THE JAIL CONTROL PANEL BEING PROVIDED BY THE JAIL SECURITY CONTRACTOR. COORDINATE ROUTING AND REQUIREMENTS WITH JAIL SECURITY CONTRACTOR.
2. PROVIDE 3500-WATT PHOTOCELL TO CONTROL EXTERIOR WALL MOUNTED LIGHTS ON/OFF DUSK TO DAWN.
3. CONNECT EXISTING LIGHTS TO THE EMERGENCY LIGHTING CIRCUITRY IN THIS AREA. INTERCEPT AND ROUTE CIRCUITRY TO THE EXISTING JAIL CONTROLS IN THE MDF ROOM FOR CONTROL OF LIGHTING CIRCUITRY. COORDINATE ROUTING AND REQUIREMENTS WITH JAIL SECURITY CONTRACTOR.

1 E2.1 1ST FLOOR PLAN - BASE BID - LIGHTING
SCALE: 1/8"=1'-0"

1/8" = 1'-0
8' 0 8 16 FT
GRAPHIC SCALE

Gunn & Associates, P.C.
Consulting Engineers
3102 Highway 14
Millbrook, AL 36054
Tel: 334.285.1273
500 Southland Drive Suite 250
Hoover, AL 35226
GA#18-192

PH&J architects inc.
Montgomery, Alabama

CIP-2017-001
UPGRADES TO THE MOBILE COUNTY METRO JAIL
For The MOBILE COUNTY COMMISSION
MOBILE, ALABAMA

ALABAMA REGISTERED PROFESSIONAL ENGINEER NO. 26988 04-02-19 KENNETH RAY GUNN JR.

DRAWN J.C.T.	CHECK K.R.G.
DATE April 2, 2019 RTA	
REVISED	
REVISED	

SHEET TITLE
SALLY PORT - 1ST FLOOR PLAN - BASE BID - LIGHTING

JOB NO.
PH&J 1801-GV

SEQUENCE NO. 140 OF 175

E2.1

© PH&J ARCHITECTS, INC.
ALL RIGHTS RESERVED

Order Plans @ WWW.LDILine.com