



APARTMENT UNIT LIGHTING FIXTURE SCHEDULE										
MARK	MFG. & CAT#	DESCRIPTION	LAMPS NO.	LAMP TYPE	INPUT WATTS	TOTAL LUMENS	LUMENS/WATT	COLOR TEMP	MAX WATT/LAMP HOLDER	REMARKS
UA	PROGRESS LIGHTING P6022-28	7.25" FLUSH MOUNT LED WET LOCATION LISTED	1	LED	17	1050	67	3000K	N/A	KITCHEN
UB	PROGRESS LIGHTING P6022-28	7.25" FLUSH MOUNT LED WET LOCATION LISTED	1	LED	17	1050	67	3000K	N/A	DINING ROOM
UC	PROGRESS LIGHTING P6022-28	7.25" FLUSH MOUNT LED WET LOCATION LISTED	1	LED	17	1050	67	3000K	N/A	CLOSET/HALLWAY/BATH CEILING
UD	ARTERIORS 49182	HAMPTON VANITY	3	LED	27	2281	84.5	3000K	80E12	BATHROOM WALL SCONCE
UE	PROGRESS LIGHTING P6022-28	7.25" FLUSH MOUNT LED WET LOCATION LISTED	1	LED	17	1050	67	3000K	N/A	FOYER
UF	CONCORD 82CNT4ST-ES-LED	52" CEILING FAN WHITE FINISH	1	LED	18	1000	55.6	3000K	N/A	CEILING FAN W/UGHT KIT
UG	PROGRESS LIGHTING P6842-82	6" UP/DOWN CYLINDER ALUMINUM	2	LED	18	1821	109	3000K	100/A19	PORCH 10.75" SQUARE
UI	TECH LIGHTING 707DMATIC-W-S-LED027	MATI C18 MINI PENDANT WHITE GLASS	1	LED	8	450	75	2700K	N/A	ISLAND PENDANTS

BUILDING LIGHTING FIXTURE SCHEDULE										
MARK	MFG. & CAT#	DESCRIPTION	LAMPS NO.	LAMP TYPE	INPUT WATTS	TOTAL LUMENS	LUMENS/WATT	COLOR TEMP	MAX WATT/LAMP HOLDER	REMARKS
BA	PROGRESS LIGHTING P6022-28	CORRIDOR SURFACE MOUNT 7.25" LED FIXTURE	1	LED	17	1050	67	3000K	N/A	CORRIDORS - WHITE FINISH WET LOCATION LISTED
BB	ACCESS LIGHTING 20388MG	NYZ WET LOCATION WALL FIXTURE	2	G11	18	1821	109	3000K	100/A19	ENTRANCE SCONCE
BC	BROWNLEE LIGHTING 1440-8N-8LED-30K	INTERIOR WALL SCONCE	1	LED	8	438	73	3000K	N/A	CORRIDOR SCONCE ADA COMPLIANT
BD	BROWNLEE LIGHTING 2038-12-812LED-30K	12" CEILING UTILITY LED FIXTURE	1	LED	12	1422	120	3000K	N/A	CLOSETS
BE	BROWNLEE LIGHTING 7027-C37LED-30K-888C	WALL PACK WITH BATTERY WET LISTED	1	LED	37	3837	104	3000K	N/A	NOTE 1
BF	ROYAL PACIFIC 4310WH	4" LED STRIP LIGHT	1	LED	36	2800	74	4000K	N/A	STAIRWAY LIGHTING
BG	ROYAL PACIFIC 4310WH	4" LED STRIP LIGHT	1	LED	36	2800	74	4000K	N/A	GARAGE
BH	BROWNLEE LIGHTING 2038-19-C4LED-30K	19" CEILING UTILITY LED FIXTURE	1	LED	48	5116	107	3000K	N/A	ELEC. ROOM
BI	BROWNLEE LIGHTING 7027-C37LED-30K-888C	WALL PACK WITH BATTERY WET LISTED	1	LED	37	3837	104	3000K	N/A	MOUNT ABOVE SIGNAGE SEE ARCHITECTURAL ELEVATIONS
BJ	PHILIPS LIGHTOLIER 848830K10	SLIM SURFACE 4" SQUARE LED	1	LED	14.7	1000	68	3000K	N/A	ELEVATOR THRESHOLD WHITE TRIM
BK	BROWNLEE LIGHTING 2038-19-C4LED-30K	19" CEILING/WALL UTILITY LED FIXTURE	1	LED	12	1422	120	3600K	N/A	ELEVATOR PIT/ TOP-OF-SHAFT
BL	BROWNLEE LIGHTING 2038-19-C4LED-30K	19" CEILING/WALL UTILITY LED FIXTURE	1	LED	12	1422	120	3600K	N/A	ELEVATOR PIT/ TOP-OF-SHAFT
BM	NEW ORLEANS GAS & ELECTRIC LIGHTS	FRENCH QUARTER ON YOKE HANGER BRACKET	1	LED	12	1422	120	2700K	N/A	SELECTED BY OWNER
BN	7300 EDISON INDUSTRIAL FLUTE WALL LAMP	RETRO RUSTIC IRON WALL SCONCE PLATE LAMP	1	LED	12	1422	120	2700K	N/A	SELECTED BY OWNER
BO	WAC LIGHTING 8031-8-15 VAC-85-280-88R	IN-GROUND UPLIGHT	1	LED	14.5	250	17.2	2700K	N/A	
X	DUAL LITE EYE-4-R-W	EXIT SIGN WITH BATTERY WHITE WITH RED LETTERS	1	LED	2W	N/A	N/A	N/A	N/A	BREEZEWAY - DAMP LISTED (NOTE 1)
XA	DUAL LITE EV-4-02L	ARCHITECTURAL LED 2-HEAD EMERGENCY LIGHT	2	LED	2W	290	72.5	4000K	N/A	INTERIOR - W/ REMOTE CAPACITY (NOTE 1)
XB	DUAL LITE EV-4-0-02L	ARCHITECTURAL LED 2-HEAD EMERGENCY LIGHT	2	LED	2W	290	72.5	4000K	N/A	DAMP LISTED - W/ REMOTE CAPACITY (NOTE 1)
XC	DUAL LITE EVO-0-W	OUTDOOR LED REMOTE DUAL-HEAD EMERGENCY LIGHT	2	LED	1W	180	80	4000K	N/A	WET LOCATIONS NOTE 2 CONNECT W/ EMERGENCY LIGHT

NOTES: (1) ALL EXIT SIGNS, EMERGENCY LIGHTS AND FIXTURES WITH EMERGENCY BALLASTS SHALL BE CONNECTED TO THE UNSUPPLIED SIDE OF THE CIRCUIT BREAKING NORMAL FIXTURES IN THE SAME ROOM OR AREA.  
 (2) MOUNT REMOTE HEAD ABOVE EXTERIOR OF DOOR.

**ABBREVIATIONS**

AFF	ABOVE FINISHED FLOOR
C	CONDUIT
CR	CEILING RECESSED MOUNTED
CS	CEILING SURFACE MOUNTED
CT	DEVICE MOUNTED ABOVE COUNTERTOP
DS	DISCONNECT SWITCH
DN	DOWN
FDS	FUSED DISCONNECT SWITCH
G	GRADE MOUNTED
GFI	GROUND FAULT CIRCUIT INTERRUPTER
GND	GROUND
IG	ISOLATED GROUND
JB	JUNCTION BOX
NIC	NOT IN CONTRACT
NTS	NOT TO SCALE
P	POLE
PD	PENDANT MOUNTED
PNL	PANELBOARD
Q	QUADRUPLEX
U	UNIVERSAL MOUNTING
W	DEVICE MOUNTED AT 48"
WP	WEATHERPROOF COVERPLATE
WR	WALL RECESSED
WS	WALL SURFACE MOUNTED

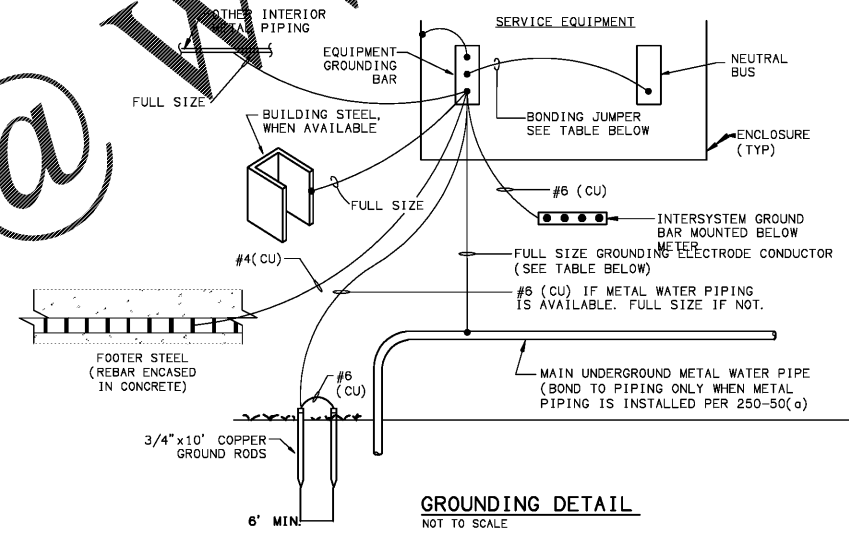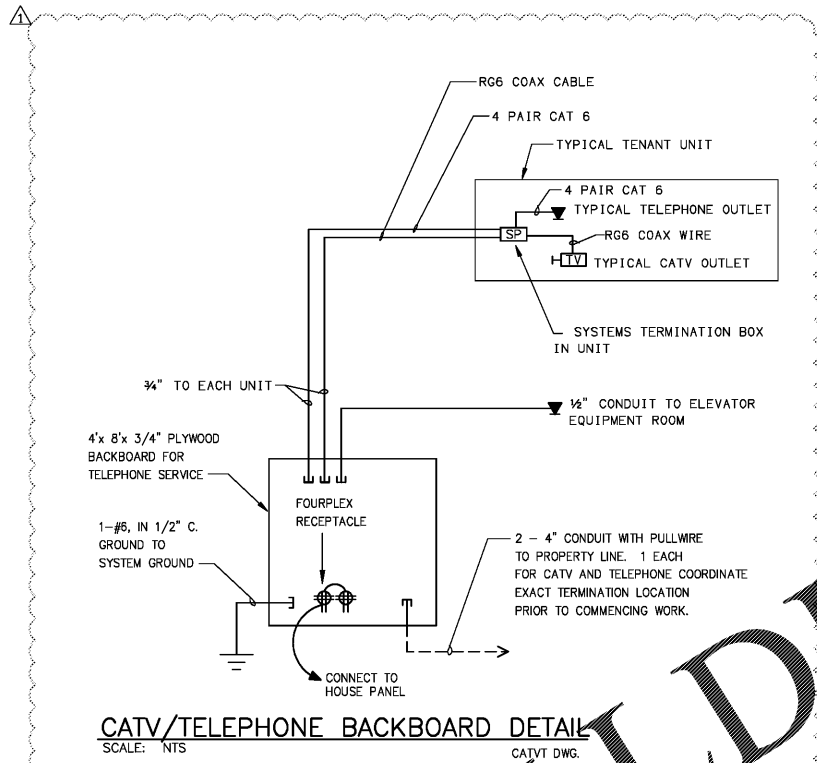

SERVICE SIZE	GROUNDING ELECTRODE CONDUCTOR		BONDING JUMPER	
	COPPER	ALUM	COPPER	ALUM
100	#8	-	#8	-
150	#6	#4	#6	#4
200	#4	#2	#4	#2
300	#2	#1/0	#2	#1/0
400	#1/0	#3/0	#1/0	#3/0
500	#1/0	#3/0	#1/0	#3/0
600	#2/0	#4/0	#2/0	#4/0
700	#2/0	#4/0	#2/0	#4/0
800	#2/0	#4/0	#2/0	#4/0
1000	#3/0	250MCM	#3/0	250MCM
1200	#3/0	250MCM	#4/0	250MCM
1600	#3/0	250MCM	300MCM	400MCM

**TESTING**  
 PROVIDE THE OWNER AND ENGINEER WITH A GROUNDING TEST REPORT INDICATING THE MAXIMUM OHMS ACHIEVED AT EACH GROUND ELECTRODE SYSTEM AT EACH BUILDING AND THE CONDITIONS UNDER WHICH THE TEST WAS MADE. A MAXIMUM OF 25 OHMS IS REQUIRED OR A MINIMUM OF THREE 10' GROUND RODS.

**ELECTRICAL LEGEND**

- [Symbol] FLUORESCENT FIXTURE, CEILING MOUNTED
- [Symbol] LIGHTING FIXTURE, CEILING MOUNTED
- [Symbol] LIGHTING FIXTURE, WALL MOUNTED
- [Symbol] LIGHT TRACK WITH FIXTURES
- [Symbol] CEILING EXIT LIGHT: SHADED QUADRANTS INDICATE LETTERED FACE(S)
- [Symbol] WALL EXIT LIGHT: SHADED QUADRANTS INDICATE LETTERED FACE(S)
- [Symbol] EMERGENCY LIGHT WITH BATTERY PACK AND ADJUSTABLE HEADS
- [Symbol] DIMMER, MOUNTED @ 48" AFF
- [Symbol] SINGLE POLE SWITCH, MOUNTED @ 48" AFF
- [Symbol] SINGLE POLE SWITCH W/ OCCUPANCY SENSOR, MOUNTED @ 48" AFF
- [Symbol] SINGLE POLE SWITCH W/ OCCUPANCY SENSOR, MOUNTED @ 48" AFF
- [Symbol] THREE-WAY SWITCH, MOUNTED @ 48" AFF
- [Symbol] CEILING MOUNTED OCCUPANCY SENSOR
- [Symbol] PUSHBUTTON MOUNTED @ 48" AFF
- [Symbol] FLOOR BOX FOR PHONE, ELECTRICAL DEVICES, ETC.
- [Symbol] DUPLEX 20A, 125V, 2P, 3W, GROUNDING RECEPTACLE, MOUNTED @ 18" AFF
- [Symbol] DUPLEX 20A, 125V, 2P, 3W, SWITCHED RECEPTACLE, MOUNTED @ 18" AFF
- [Symbol] DUPLEX 20A, 125V, 2P, 3W, GROUNDING RECEPTACLE, MOUNTED @ 18" AFF PERMANENTLY MARKED FOR USE WITH AUTOMATIC OUTLET CONTROL SYSTEMS, ONE CONTROLLED FACE SPLIT CIRCUIT HOT TAB (HUBBELL DR20C1WHI OR EQUIVALENT).
- [Symbol] DUPLEX 20A, 125V, 2P, 3W, GROUNDING RECEPTACLE, CEILING MOUNTED
- [Symbol] QUAD 20A, 125V, 2P, 3W, GROUNDING RECEPTACLE, MOUNTED @ 18" AFF
- [Symbol] GROUND FAULT INTERRUPTER, 20A DUPLEX, MOUNTED @ 18" AFF
- [Symbol] GROUND FAULT INTERRUPTER, 20A DUPLEX, MOUNTED ABOVE COUNTER
- [Symbol] SINGLE 250V NON-LOCKING TYPE RECEPTACLE
- [Symbol] DUPLEX 20A, 125V, 2P, 3W, GROUNDING RECEPTACLE WITH BUILT-IN USB CHARGERS.
- [Symbol] TELEPHONE OUTLET, MOUNTED @ 18" AFF
- [Symbol] TELEPHONE OUTLET, MOUNTED @ 48" AFF
- [Symbol] DATA OUTLET, MOUNTED @ 18" AFF
- [Symbol] TELEPHONE/DATA OUTLET, MOUNTED @ 18" AFF
- [Symbol] TELEVISION OUTLET, MOUNTED @ 18" AFF
- [Symbol] DISCONNECT SWITCH, SIZE/POLES/FUSE
- [Symbol] JUNCTION BOX, CEILING MOUNTED
- [Symbol] JUNCTION BOX, WALL MOUNTED
- [Symbol] PADDLE FAN
- [Symbol] EXHAUST FAN CONNECTION, CEILING MOUNTED (FAN BY DIV. 15)
- [Symbol] EXHAUST FAN CONNECTION, WALL MOUNTED (FAN BY DIV. 15)
- [Symbol] FIRE ALARM CONTROL PANEL
- [Symbol] FIRE ALARM ANNUCIATOR PANEL
- [Symbol] SMOKE DETECTOR, CEILING MOUNTED
- [Symbol] SMOKE DETECTOR, WALL MOUNTED
- [Symbol] CEILING MOUNTED CARBON MONOXIDE SENSOR.
- [Symbol] COMBINATION CARBON MONOXIDE SENSOR/SMOKE DETECTOR.
- [Symbol] THERMOCHECKER, CEILING MOUNTED,
- [Symbol] DUCT SMOKE DETECTOR, INTERCONNECT WITH FIRE ALARM.
- [Symbol] MANUAL PULL STATION, WALL MOUNTED AT 48" AFF.
- [Symbol] FLOW SWITCH
- [Symbol] TAMPER SWITCH
- [Symbol] DRY PIPE SYSTEM PRESSURE SWITCH
- [Symbol] FIRE ALARM COMBINATION AUDIBLE/VISUAL DEVICE, WALL MOUNTED @ 80" AFF
- [Symbol] FIRE ALARM VISUAL DEVICE, WALL MOUNTED @ 80" AFF
- [Symbol] FIRE ALARM AUDIBLE DEVICE, WALL MOUNTED @ 80" AFF
- [Symbol] FUTURE FIRE ALARM VISUAL DEVICE, WALL MOUNTED @ 80" AFF
- [Symbol] PREWIRED J-BOX WITH BLANK COVERPLATE FOR VISUAL DEVICE ON FIRST FLOOR.
- [Symbol] FIRE DEPARTMENT LOCK BOX, MOUNTING HEIGHT PER FIRE DEPARTMENT
- [Symbol] FIRE ALARM SPEAKER/STROBE, WALL MOUNTED @ 80" AFF
- [Symbol] FIRE ALARM VOICE EVACUATION PANEL
- [Symbol] CONTROLLED ACCESS

Order Plans @

WWW.LDILLING.COM

Common North, Prospect, KY

Architect: Norton Commons Architects & Associates, A4000796

8/18/2019

Project # 18025

Professional Engineer

Michael Sodame

18196

Professional Engineer

Bristol Development Group

381 Maloney Station Rd, Suite 204

Franklin, TN 37067

Lyric at Norton Commons

Prospect, Kentucky

charlan • brock associates

architects • planners

1770 fennell street

maitland florida 32751-7208

407.660.8900 • 407.875.9948

www.cbaarchitects.com

ELECTRICAL SCHEDULES AND DETAILS

date: 06-04-2019

job no: 3789.15

drawn by: MLD

reviewed by: MLD

file: 18025-E-SCHEDS

issue history:

07-03-2019

E6.01