


LEGEND	
	PUSH BUTTON BUZZER (EXTERIOR)
	PUSH BUTTON BELL (INTERIOR)
	BUZZER (EXTERIOR) / BELL (INTERIOR)
	CHIME
	NJ - 3RD SHIFT DRIVEWAY CHIME
	ALARM SYSTEM PANEL
	ALARM SYSTEM KEYPAD
	PETROLEUM ALARM
	DOOR CONTACT
	MOTION DETECTOR
	PANIC BUTTON
	PANIC BUTTON WITH LEAD
	3RD SHIFT CHIME - MOTION DETECTOR
	3RD SHIFT CHIME - ON/OFF SWITCH
	SECURITY SPEAKER
	DOOR STRIKE POWER SUPPLY
	DOOR STRIKE
	REQUEST TO EXIT
	CAMERA (SHOWING DIRECTION)

- NOTES:**
- DELIVERY DOOR TIMER RELEASE BUTTON MOUNTED IN OFFICE BELOW SECURITY KEYPAD. SECOND SWITCH MOUNTED TO THE RIGHT OF CORE OPENING IN FIRST CABINET.
  - 3RD SHIFT CHIME ON/OFF SWITCH LOCATED IN OFFICE BELOW SECURITY KEYPAD. SECURITY CONTRACTOR SHALL LABEL SWITCHES.
  - SECURITY CONTRACTOR SHALL MOUNT SECURITY PANELS 96" FROM FLOOR. FIELD COORDINATE EXACT LOCATION.
  - REFER TO CONTRACTORS HANDBOOK FOR FURTHER INFORMATION ON PROPER WIRING.
  - SECURITY CONTRACTOR SHALL MOUNT SECURITY SPEAKER ABOVE OFFICE CEILING. SECURED TO WALL OR METAL STUD.
  - EXTERIOR WALL MOUNTED CAMERAS (NOT UNDER CANOPIES) TO BE MOUNTED AT 14 FEET.

**NOTE:**  
ALL SECURITY SYSTEM PANELS, DEVICES, CAMERAS, SPEAKERS, AND ASSOCIATED WIRING SUPPLIED AND INSTALLED BY WAWA SECURITY SYSTEM CONTRACTOR.

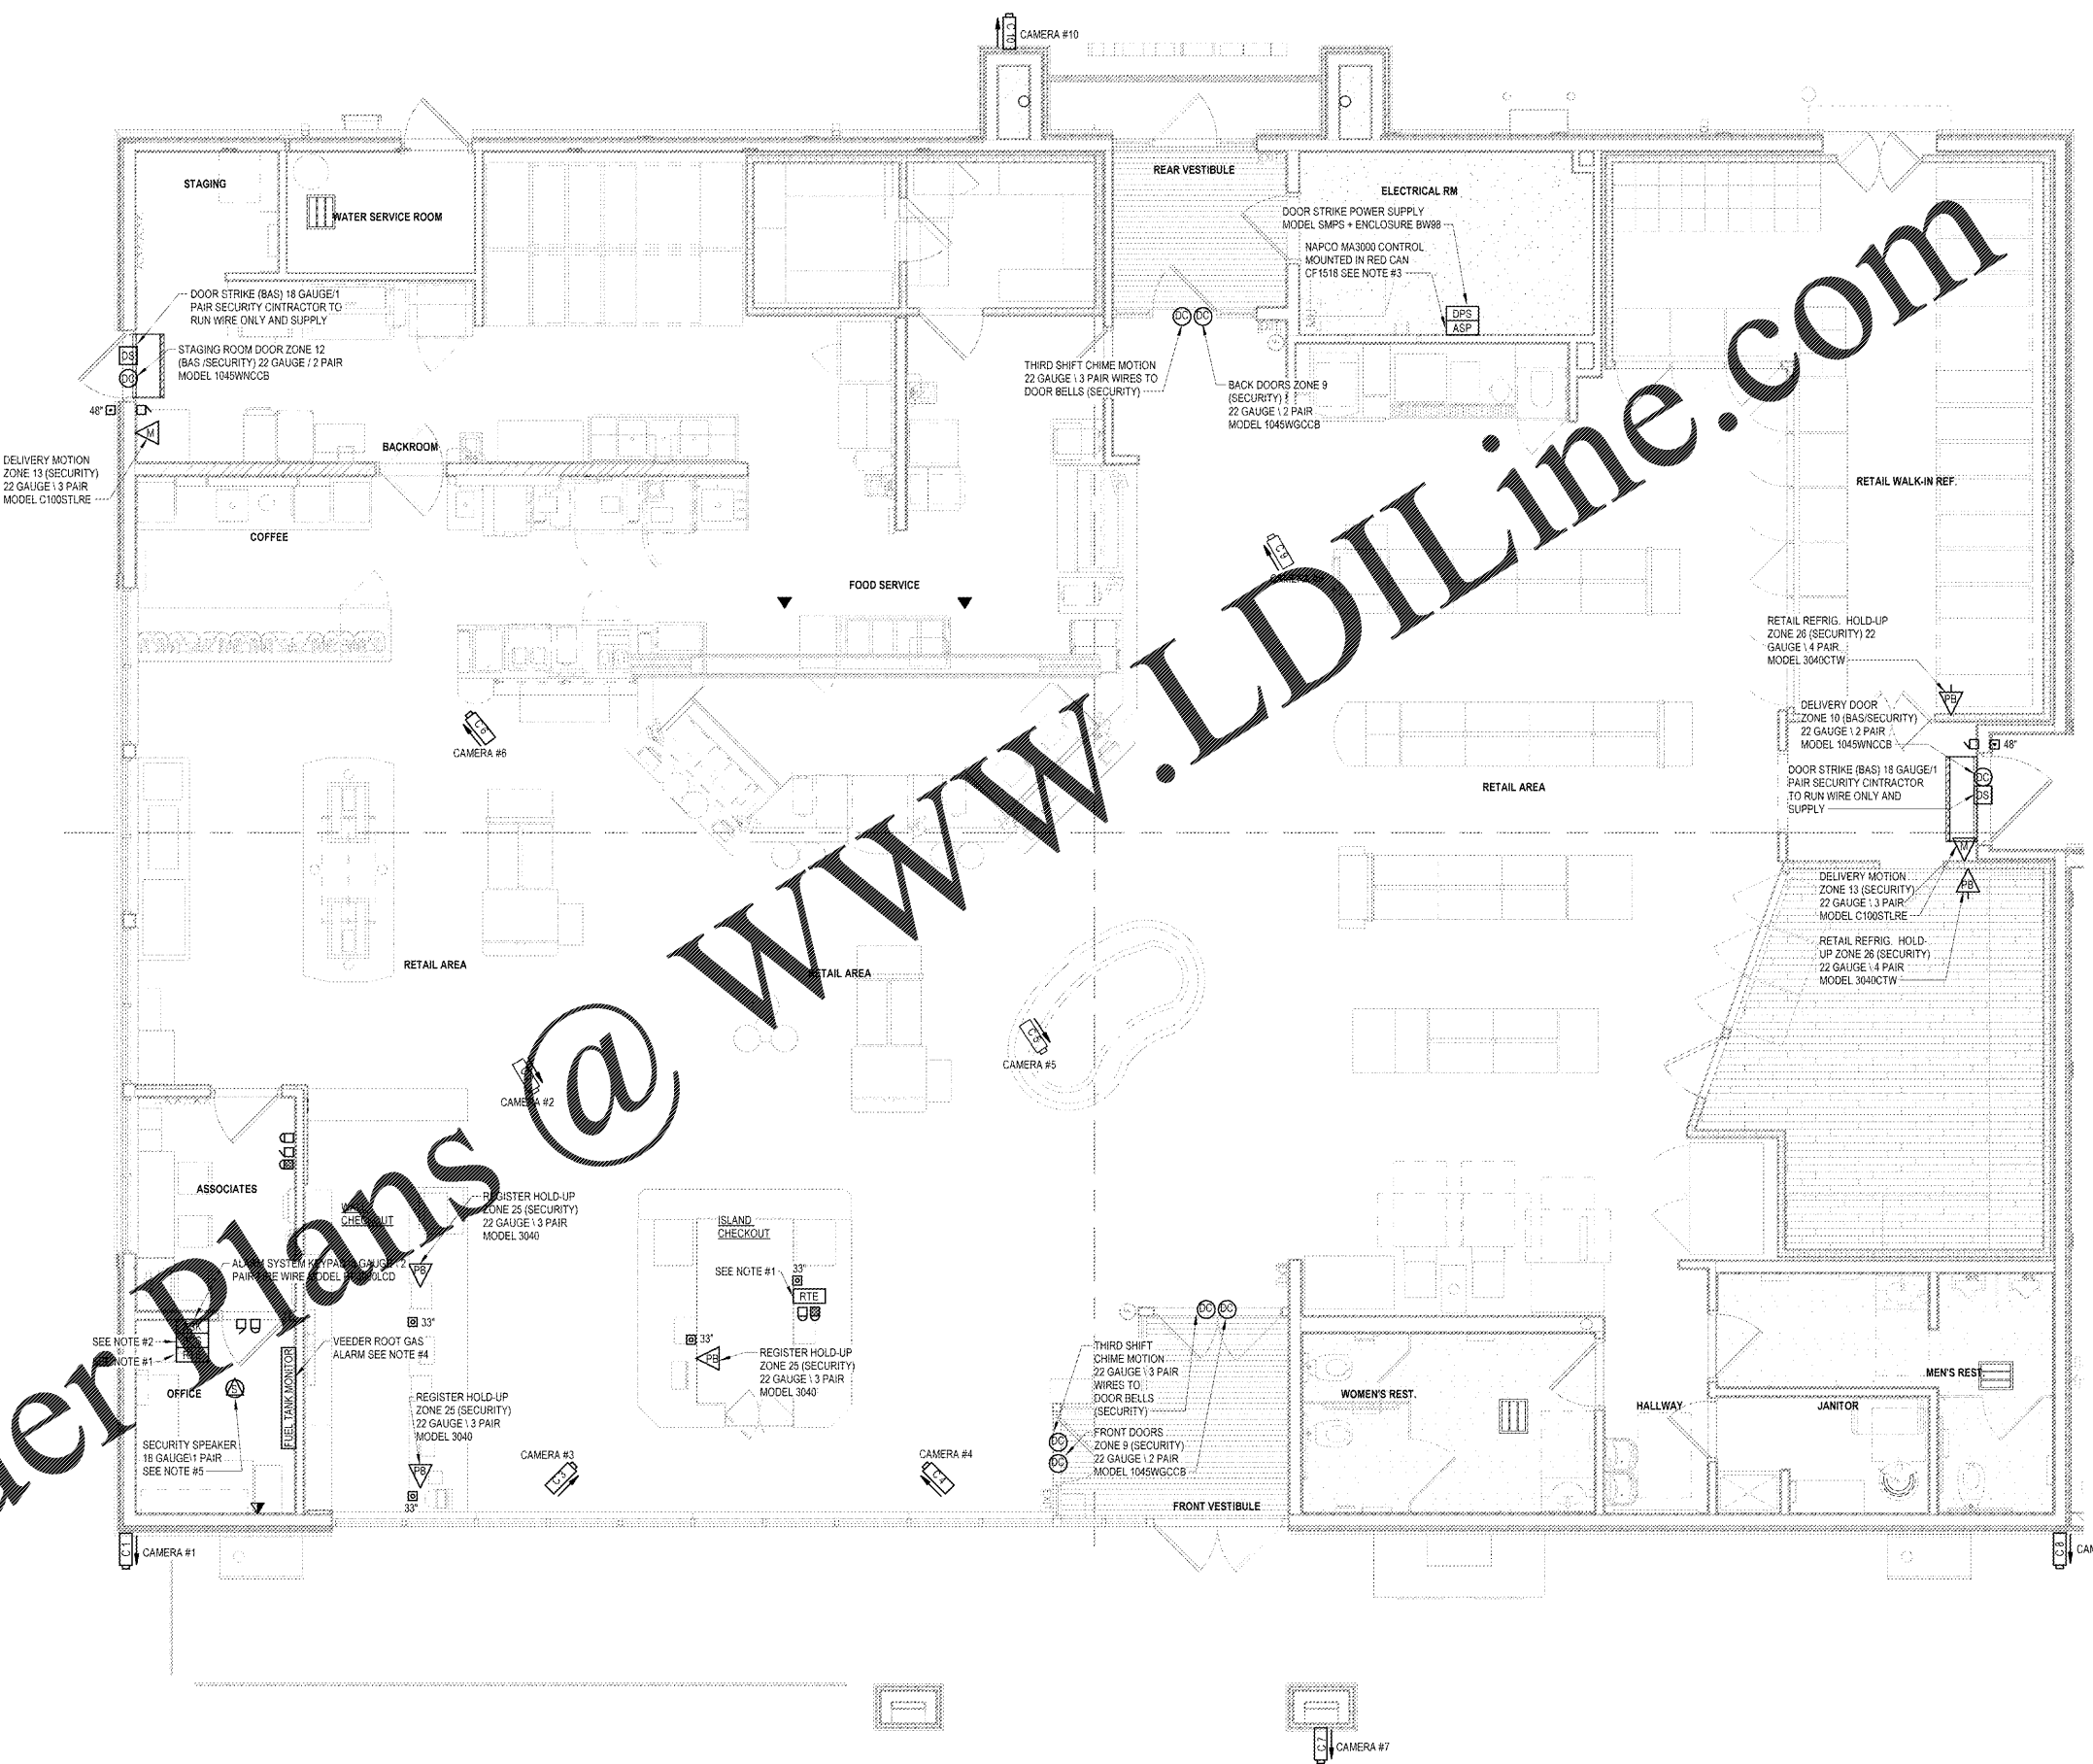

Order Plans @ WWW.LDILine.com

1925 Prospect Ave.  
Orlando, FL 32814  
P (407) 661-9100  
F (407) 661-9101  
www.c-p.com

**Chalaci & Peterson**  
Architects Engineers Planners

CLIENT NAME  
**WAWA**  
280 W. BALTIMORE PIKE  
WAWA, PA 19063

PROJECT NAME  
W50FB-VA 2018 01-MA  
STORE #8668-SUD  
10891 DAVIDSON PLACE  
MANASSAS, VA 20109

Revision Schedule		
No.	Description	Date
1	PERMIT SET	01/04/2019
2	PERMIT COMMENTS	03/15/2019
3	BID SET	06/27/2019

PROJECT NO.  
2170354  
DATE  
01/04/2019  
DRAWN  
MLB  
CHECKED  
JPM

**E10**