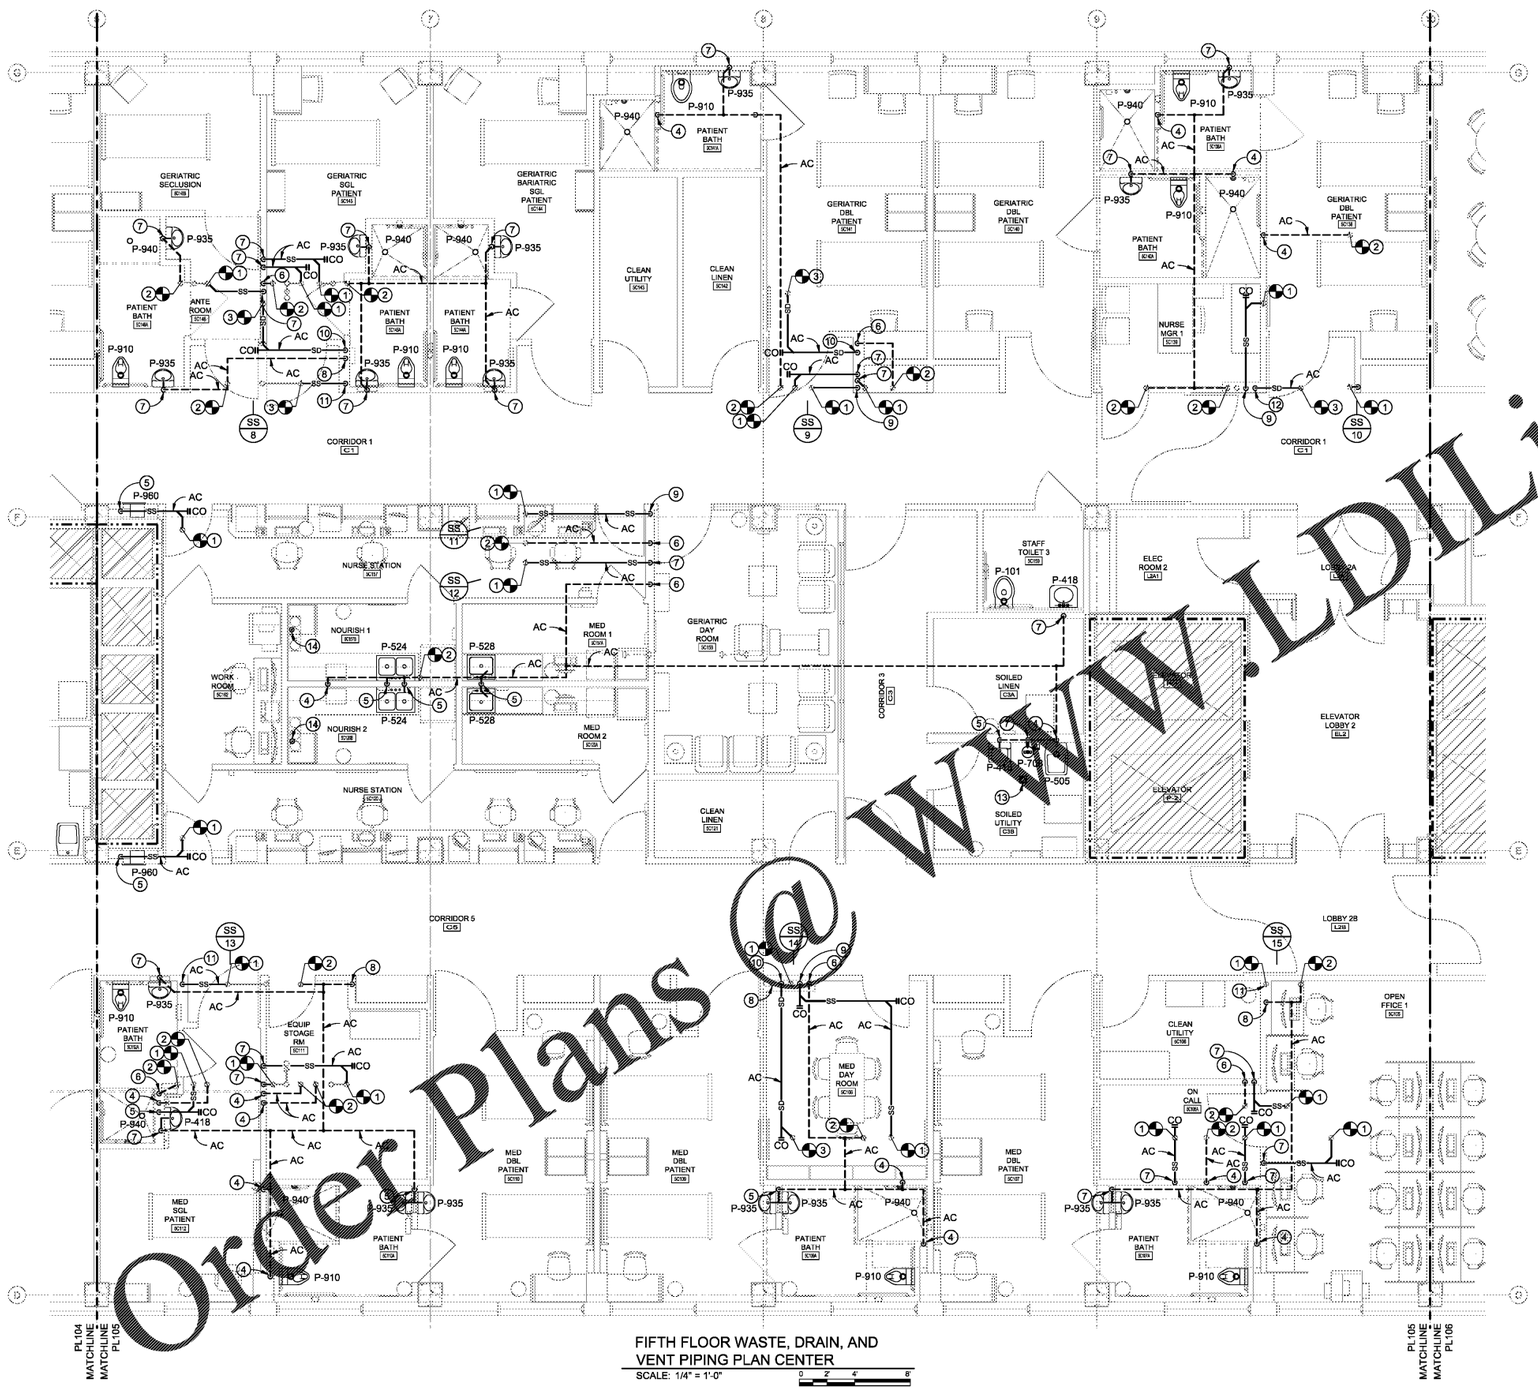

FIFTH FLOOR WASTE, DRAIN, AND VENT PIPING PLAN CENTER
SCALE: 1/4" = 1'-0"

GENERAL NOTES

A. COORDINATE PIPE ROUTING WITH DUCT ROUTING, EQUIPMENT LOCATIONS, ELECTRICAL INSTALLATIONS, AND BUILDING STRUCTURAL MEMBERS. OFFSET PIPING WHERE REQUIRED TO AVOID CONFLICTS. AVOID PENETRATING ANY MAIN STRUCTURAL BEAM. NOTIFY COR AND ARCHITECT OF ANY CONFLICTS.

B. CONTRACTOR SHALL REMOVE AND REPAIR PORTIONS OF FLOORS, CEILINGS AND/OR SLABS AFFECTED BY PLUMBING MODIFICATIONS. REPAIR SURFACES TO MATCH EXISTING UNLESS NOTED OTHERWISE ON ARCHITECTURAL DRAWINGS.

C. CONTRACTOR SHALL INSPECT AND ROD OUT EXISTING SANITARY WASTE AND/OR SEWER PIPING BEFORE MAKING ANY NEW CONNECTIONS. CONTRACTOR SHALL NOTIFY OWNER AND COR OF ALL SANITARY SEWER WHICH IS NOT SATISFACTABLE AND REQUIRE REPLACEMENT.

D. PRIOR TO PERFORMING ANY PLUMBING WORK OR PURCHASING ANY MATERIALS VERIFY EXACT LOCATION, ROUTING, AND PIPE SIZES, ETC. OF ALL EXISTING SANITARY SEWER, VENT, AND STORM DRAINAGE PIPING.

E. PROVIDE CLEANOUT(S) AS REQUIRED BY INTERNATIONAL PLUMBING CODE, LOCAL CODE, AND/OR WHERE HORIZONTAL SANITARY SEWER PIPING CHANGES DIRECTION OVER 45°.

F. NEW 2" SANITARY SEWER PIPING SHALL BE SLOPED A MINIMUM TWO PERCENT, ONE-QUARTER INCH PER FOOT. NEW 3" AND 4" SANITARY SEWER PIPING SHALL BE SLOPED A MINIMUM ONE PERCENT, ONE-EIGHTH INCH PER FOOT.

G. ALL HORIZONTAL STORM DRAINAGE PIPING SHALL BE INSULATED.

H. SEE ARCHITECTURAL PLANS FOR WALL RATINGS.

KEY NOTES

1. CONNECT NEW SANITARY SEWER PIPING TO EXISTING SANITARY SEWER PIPING ABOVE 5TH FLOOR CEILING AT APPROXIMATE LOCATION INDICATED.
2. CONNECT NEW VENT PIPING TO EXISTING VENT PIPING ABOVE 5TH FLOOR CEILING AT APPROXIMATE LOCATION INDICATED.
3. CONNECT NEW STORM DRAINAGE PIPING TO EXISTING STORM DRAINAGE PIPING ABOVE 5TH FLOOR CEILING AT APPROXIMATE LOCATION INDICATED.
4. 2"V-DN.
5. 2"SS-DN.
6. 3"V-DN.
7. 3"SS-DN.
8. 4"V-DN.
9. 4"SS-DN.
10. 4"SD-DN.
11. 6"SS-DN.
12. 6"SD-DN.
13. PROVIDE AND INSTALL 3" FLOOR DRAIN TYPE C/D WITH TRAP PRIMER CONNECTION AND CHEMICALLY RESISTANT ELASTOMER FLOOR DRAIN TRAP SEAL PROTECTION DEVICE.
14. PROVIDE AND INSTALL 2"HUB DRAIN TYPE M, WITH TRAP PRIMER CONNECTION AND CHEMICALLY RESISTANT ELASTOMER FLOOR DRAIN TRAP SEAL PROTECTION DEVICE.

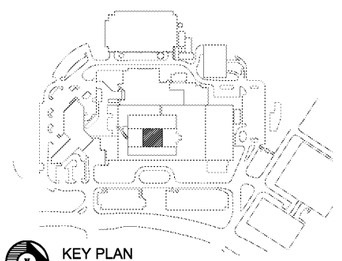

KEY PLAN
SCALE: NONE

Order Plans @ WWW.LDLine.com

Revisions:	Date:

CONSULTANT
CLARKNEXSEN
440 Martin Luther King Jr. Blvd
Macon, GA 31201
478.743.8415 Fax: 478.743.8239
www.clarknexsen.com

ARCHITECT/ENGINEER OF RECORD
TOLAND MIZELL MOLNAR
590 MEANS STREET NW
STE. 200
ATLANTA, GA 30318

STAMP
GEORGIA REGISTERED ARCHITECT ROBERT W. CARLSON

Office of Construction and Facilities Management
VA U.S. Department of Veterans Affairs

Drawing Title	FIFTH FLOOR WASTE, DRAIN, AND VENT PIPING PLAN CENTER
Approved: Project Director	
Phase	FINAL SUBMITTAL
	FULLY SPRINKLERED
Project Title	RENOVATE GERIATRIC-MED-PSYCH INPATIENT 5TH FLOOR
Location	Atlanta VA Medical Center - Atlanta, Ga.
Issue Date	06-07-2019
Checked	GTK
Drawn	DLB
Project Number	508-17-101
Building Number	Bldg C: Main Tower
Drawing Number	PL105

I:\PROJECTS\17000\21491 TMM VA ATLANTA RENOVATE GERIATRIC MED\21491 TMM VA ATLANTA RENOVATE GERIATRIC MED\SHEETS\PV\21491 PL105.DWG

VA FORM 08 - 6231