


GENERAL NOTES


- A. ALL DOMESTIC WATER PIPING SHALL BE INSULATED, IN CEILING, INTERSTITIAL SPACES, AND IN WALLS. DOMESTIC COLD WATER INSULATION SHALL BE VAPOR RETARDER (VAPOR BARRIER).
- B. COORDINATE PIPE ROUTING WITH DUCT ROUTING, EQUIPMENT LOCATIONS, ELECTRICAL INSTALLATIONS, AND BUILDING STRUCTURAL MEMBERS. OFFSET PIPING WHERE REQUIRED TO AVOID CONFLICTS. AVOID PENETRATING ANY MAIN STRUCTURAL BEAM. NOTIFY COR AND ARCHITECT OF ANY CONFLICTS.
- C. CONTRACTOR SHALL REMOVE AND REPAIR PORTIONS OF FLOORS, CEILINGS AND/OR SLABS AFFECTED BY PLUMBING MODIFICATIONS. REPAIR SURFACES TO MATCH EXISTING UNLESS OTHERWISE OTHERWISE ON ARCHITECTURAL DRAWINGS.
- D. SEE ARCHITECTURAL PLANS FOR WALL RATINGS.

KEY NOTES

- 1. CONNECT NEW DOMESTIC COLD WATER SUPPLY PIPING TO EXISTING DOMESTIC COLD WATER SUPPLY PIPING ABOVE 5TH FLOOR CEILING AT APPROXIMATE LOCATION INDICATED.
- 2. CONNECT NEW DOMESTIC HOT WATER SUPPLY PIPING TO EXISTING DOMESTIC HOT WATER SUPPLY PIPING ABOVE 5TH FLOOR CEILING AT APPROXIMATE LOCATION INDICATED.
- 3. DOMESTIC WATER PIPING OFFSET UNDER BEAM.
- 4. 1" DCWS-DN.
- 5. 1" DHWS-DN.
- 6. 1-1/4" DCWS-DN.
- 7. 1-1/4" DHWS-DN.
- 8. 2" DCWS-DN.
- 9. 2-1/2" DCWS-DN.
- 10. CONTRACTOR SHALL PROVIDE 3'-0" CLEAR DRIP PAN UNDER THESE PIPES OR DOUBLE CONTAINMENT PIPING IN ELECTRICAL ROOM.

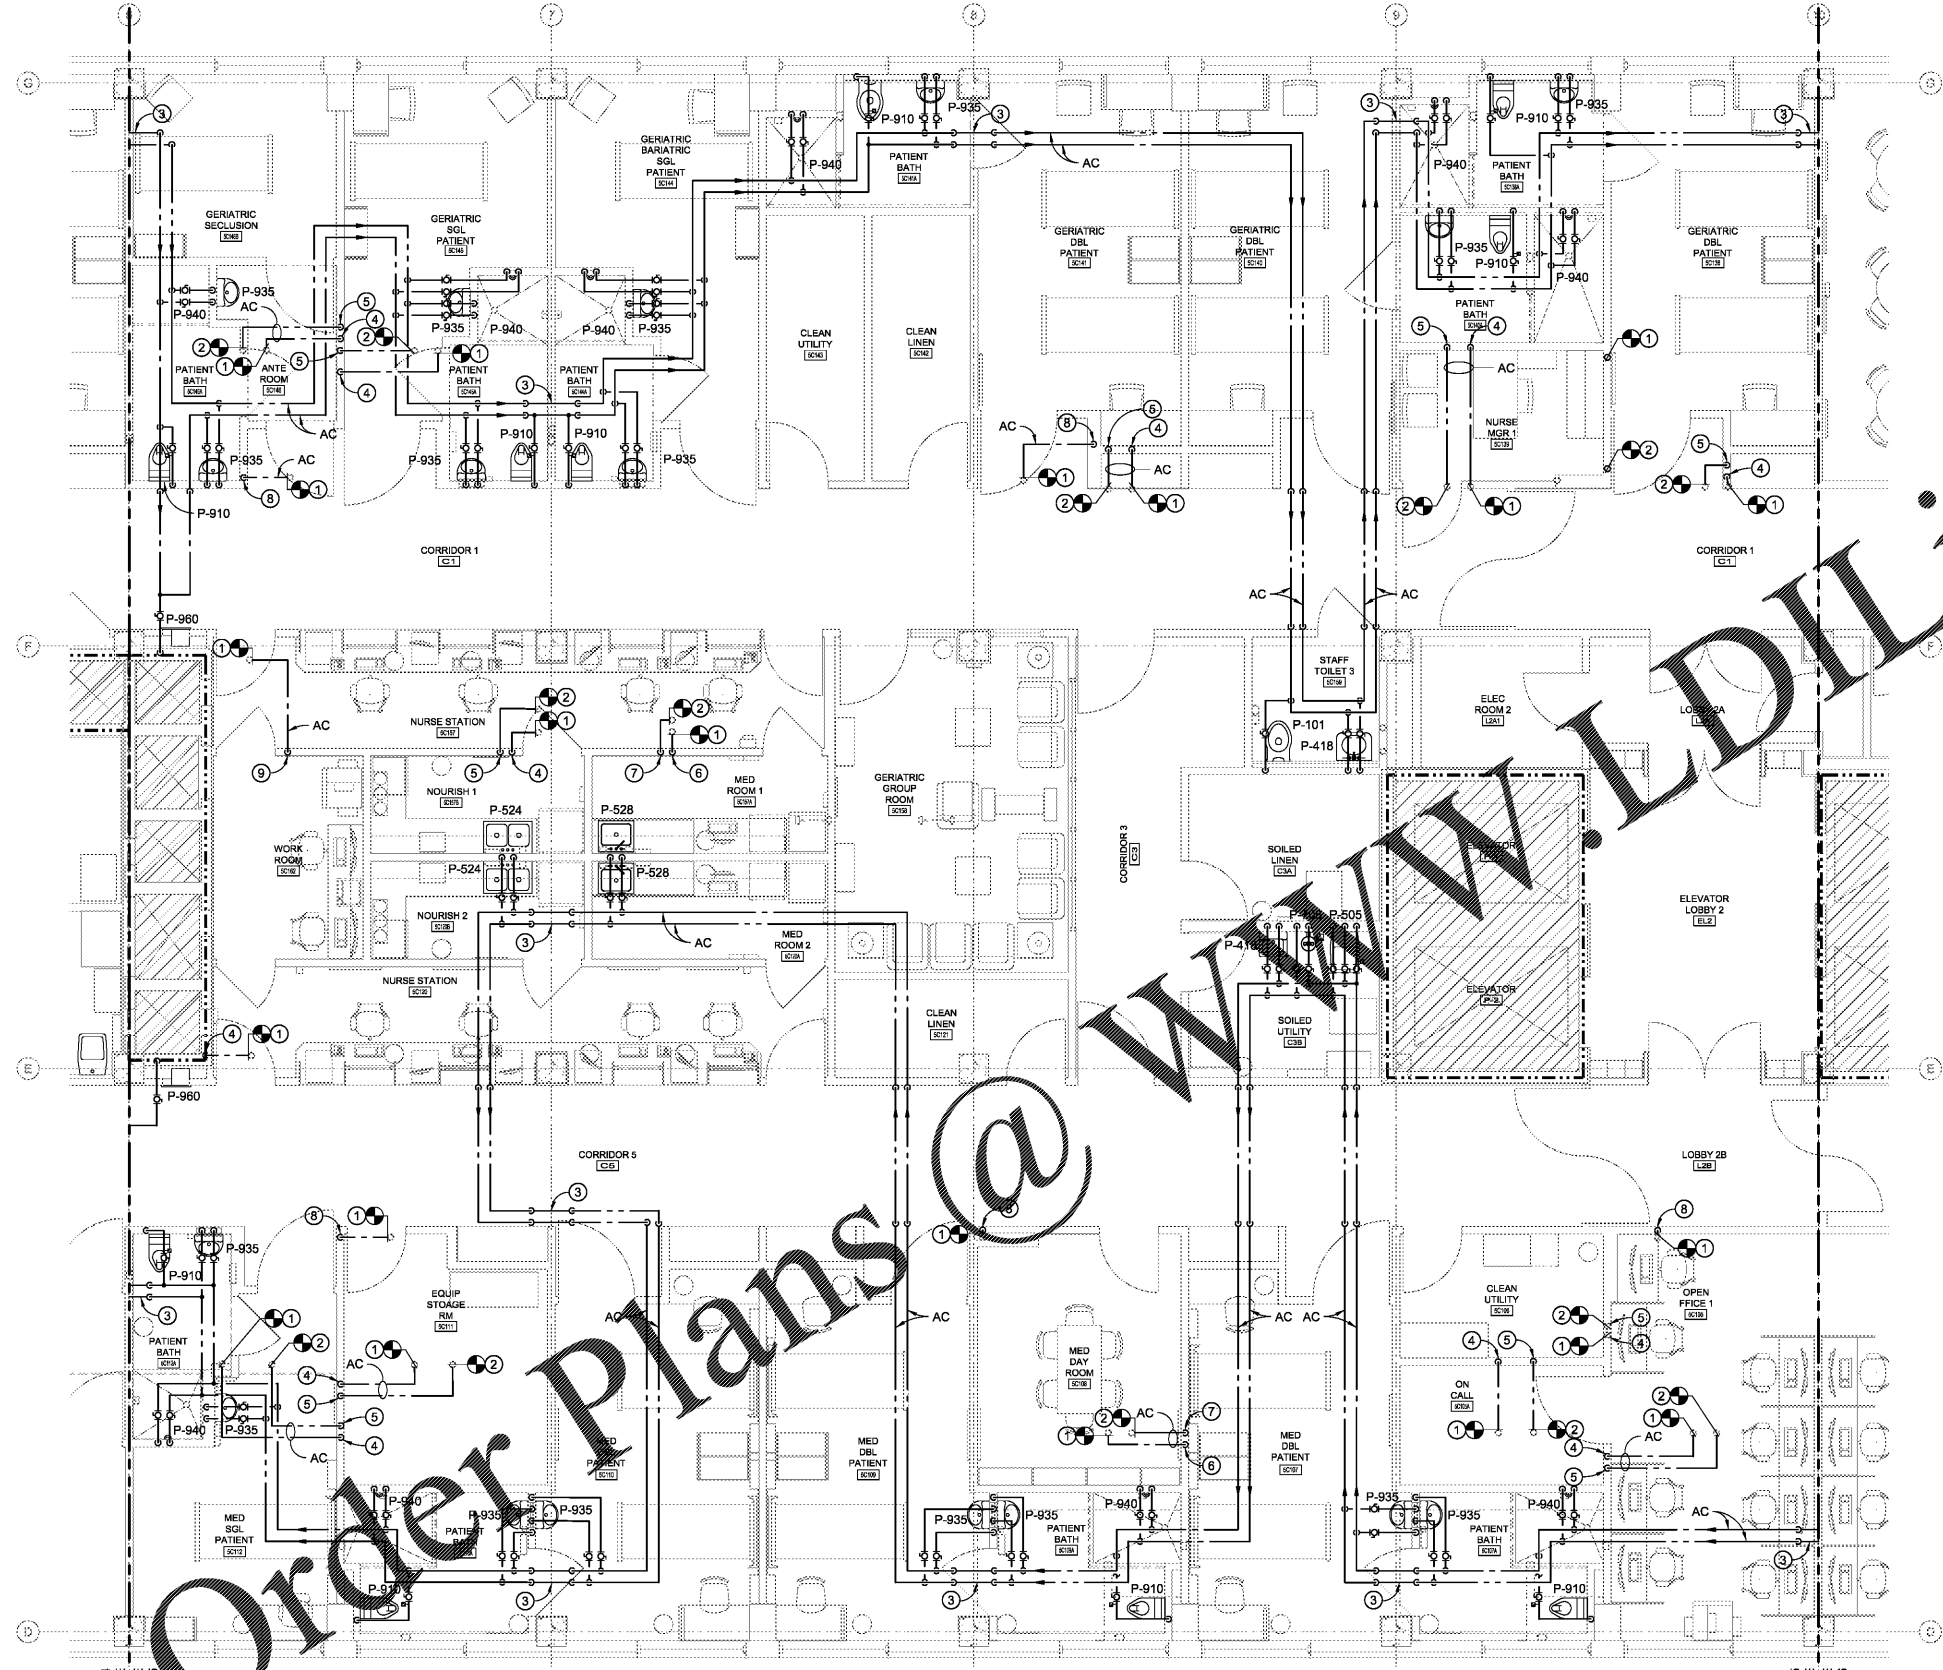


FIFTH FLOOR DOMESTIC WATER DISTRIBUTION PLAN CENTER
 SCALE: 1/4" = 1'-0"

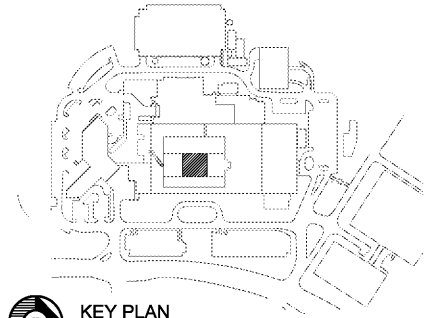

Revisions:	Date:

CONSULTANT
CLARKNEXSEN
 440 Martin Luther King Jr. Blvd
 Macon, GA 31201
 478.743.8415 Fax: 478.743.8239
 www.clarknexsen.com

ARCHITECT/ENGINEER OF RECORD
TOLAND MIZELL MOLNAR
 990 MEANS STREET NW
 STE. 200
 ATLANTA, GA 30318



Office of Construction and Facilities Management
 VA U.S. Department of Veterans Affairs

Drawing Title
FIFTH FLOOR DOMESTIC WATER DISTRIBUTION PLAN CENTER
 Approved: Project Director

Phase
FINAL SUBMITTAL
FULLY SPRINKLERED

Project Title
RENOVATE GERIATRIC-MED-PSYCH INPATIENT 5TH FLOOR
 Location
Atlanta VA Medical Center - Atlanta, Ga.
 Issue Date
 06-07-2019
 Checked
 GTK
 Drawn
 DLB

Project Number
508-17-101
 Building Number
Bldg C: Main Tower
 Drawing Number
PP105