






**GENERAL NOTES**


A. THE AUTHORITY HAVING JURISDICTION AND OTHER OCCUPANTS SHALL BE NOTIFIED WHEN A FIRE ALARM OUTAGES INCLUDING FIRE ALARM IMPAIRMENT ASSOCIATED WITH FIRE SPRINKLER SYSTEM OUTAGES OCCURS.

**DEMOLITION KEY NOTES**


1. REMOVE EXISTING SPRINKLER HEADS, ASSOCIATED PIPING DROPS, BRANCHLINES, AND FIRE MAINS BACK TO EXISTING ZONE CONTROL ASSEMBLY IN AREA INDICATED BY HATCHING.
2. EXISTING FIRE HOSE CONNECTION TO REMAIN.

**FIRE PROTECTION LEGEND**

-  AREA TO BE DEMOLISHED
-  UPRIGHT SPRINKLER HEAD
-  PENDENT SPRINKLER HEAD
-  ORDINARY HAZARD GROUP 1
-  ORDINARY HAZARD GROUP 2

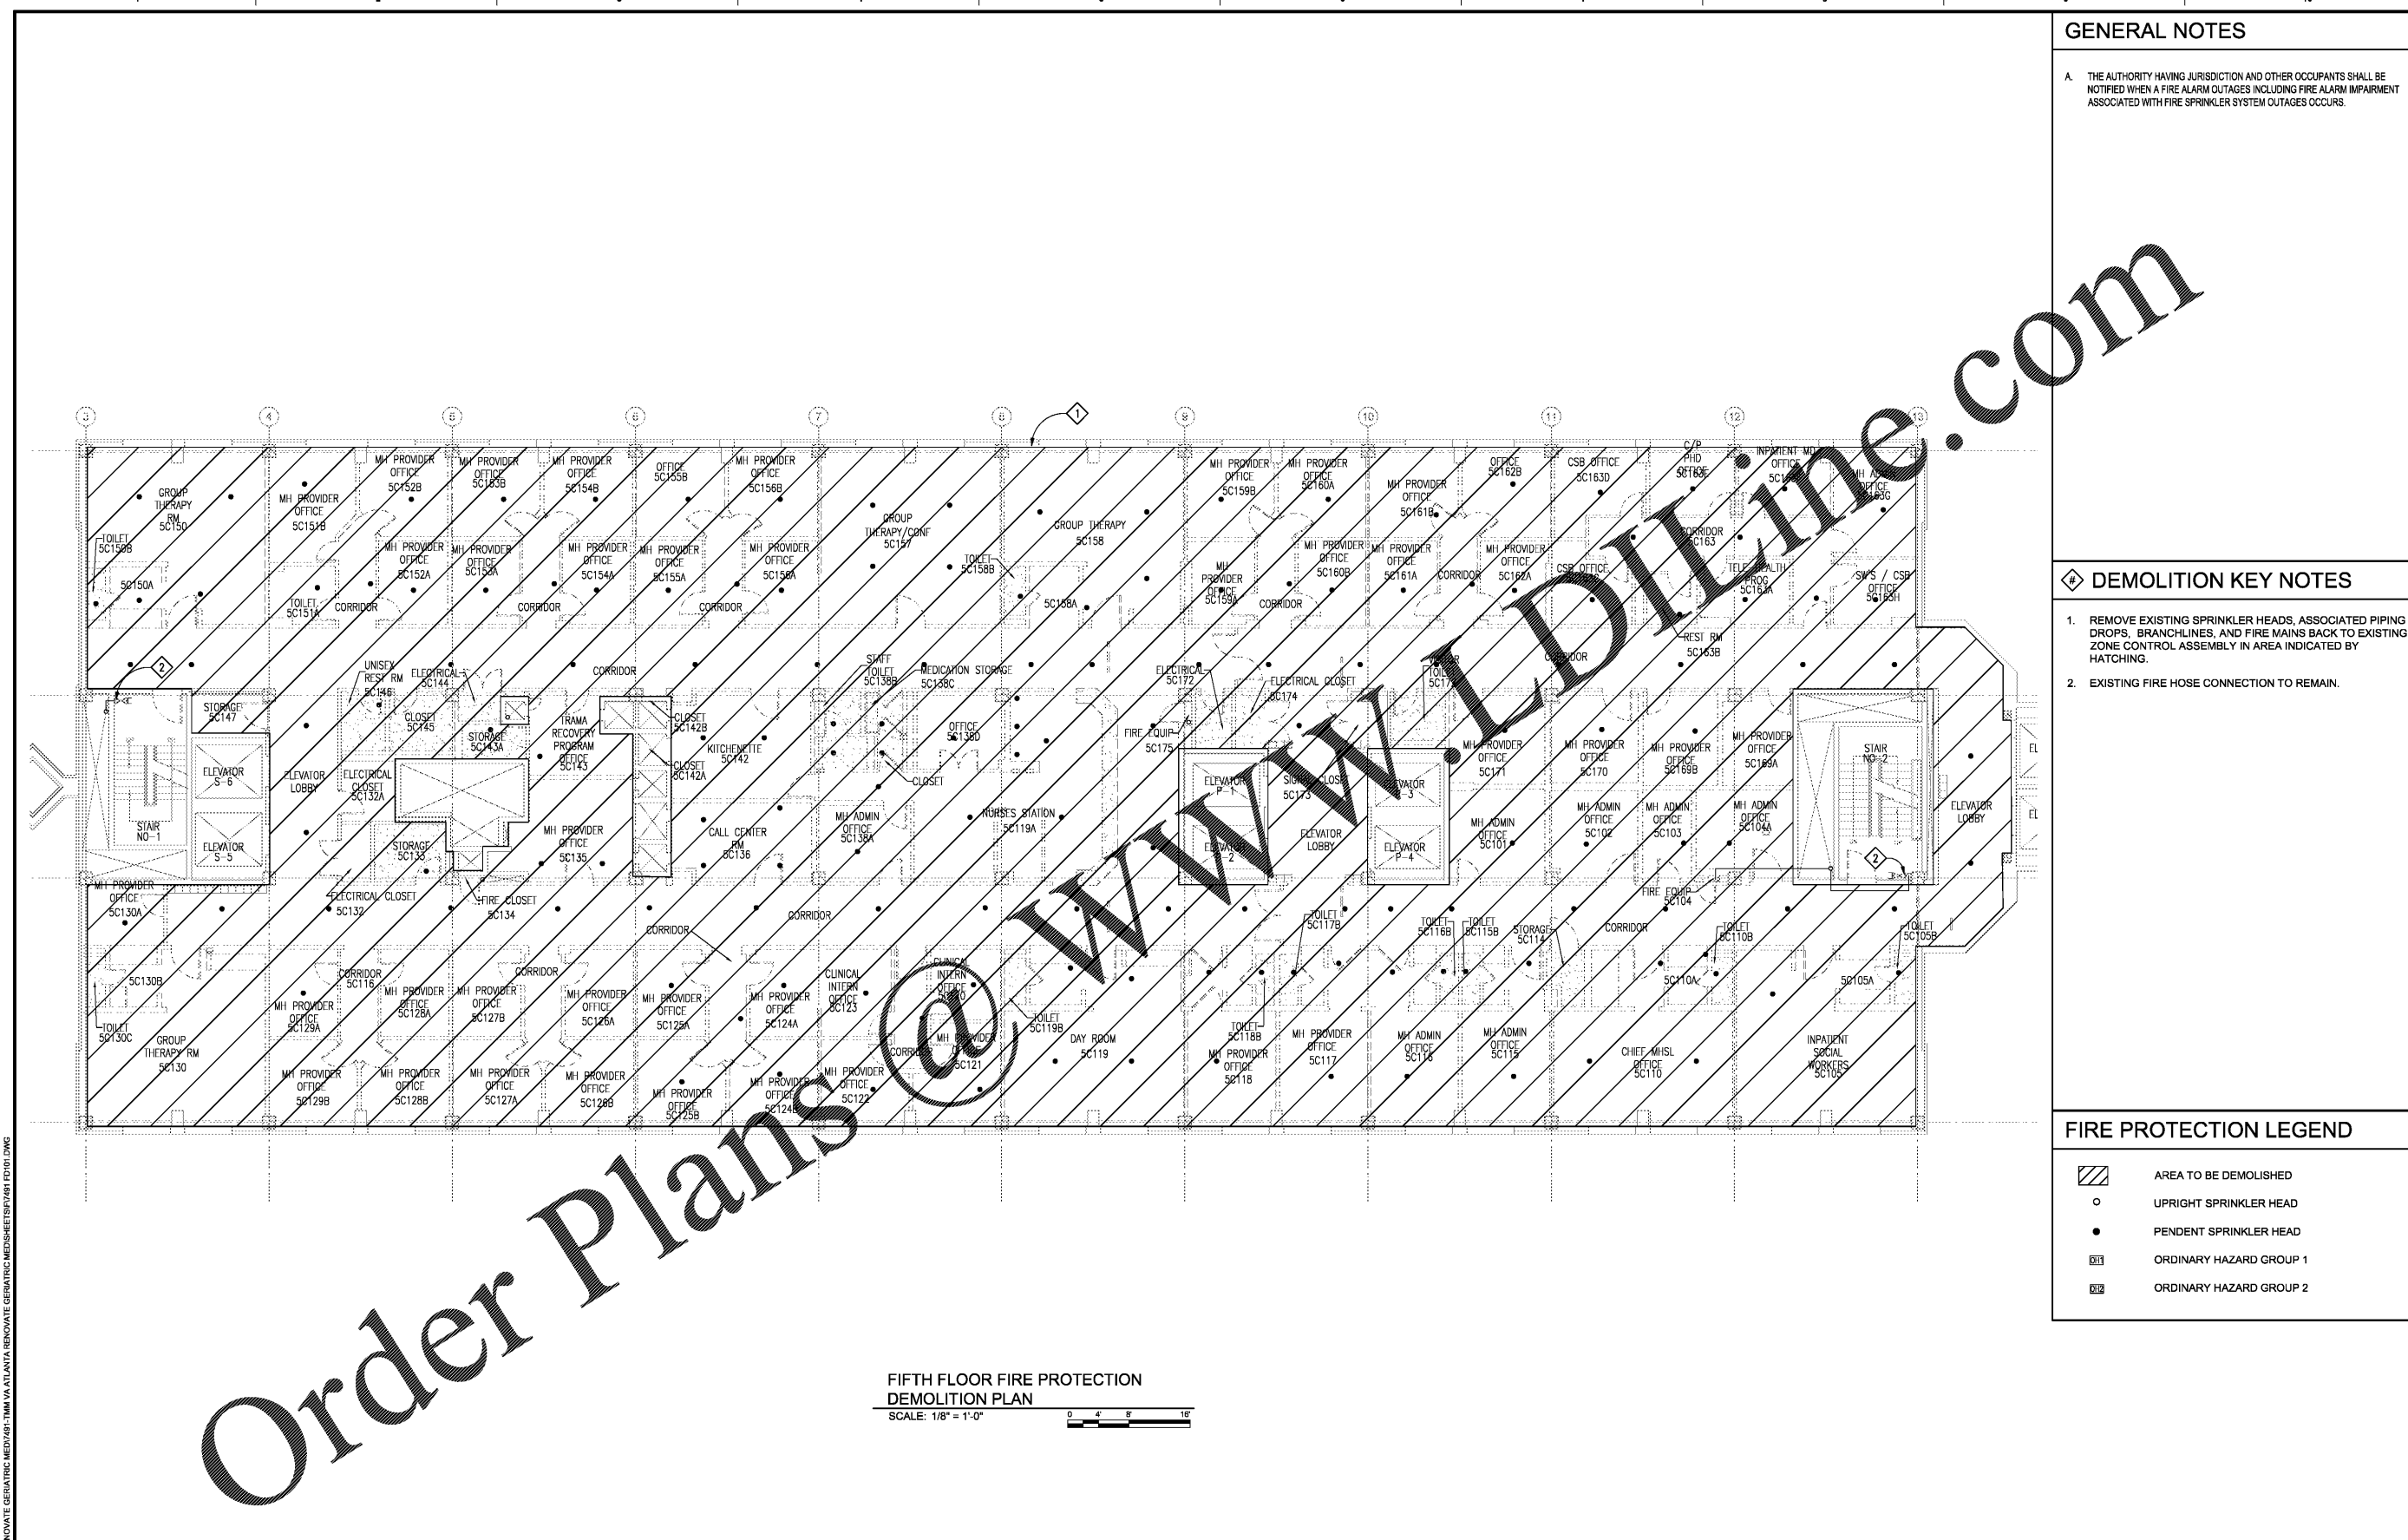

**FIFTH FLOOR FIRE PROTECTION DEMOLITION PLAN**  
SCALE: 1/8" = 1'-0"



Order Plans

Revisions:	Date:

**CONSULTANT**


**CLARKNEXSEN**

440 Martin Luther King Jr. Blvd  
Macon, GA 31201  
478.743.8415 Fax: 478.743.8239  
www.clarknexsen.com

**ARCHITECT/ENGINEER OF RECORD**

**TOLAND MIZELL MOLNAR**

590 MEANS STREET NW  
STE. 200  
ATLANTA, GA 30318



Office of Construction and Facilities Management

**VA** U.S. Department of Veterans Affairs

**Drawing Title**

FIFTH FLOOR FIRE PROTECTION DEMOLITION PLAN

Approved: Project Director

**Phase**

FINAL SUBMITTAL

FULLY SPRINKLERED

**Project Title**

RENOVATE GERIATRIC-MED-PSYCH INPATIENT 5TH FLOOR

**Location**

Atlanta VA Medical Center - Atlanta, Ga.

Issue Date: 08-07-2019

Checked: WW

Drawn: PW

**Project Number**

508-17-101

**Building Number**

Bldg C: Main Tower

**Drawing Number**

FD101

PROJECTS/2008/200-11M.VA.ATLANTA.RENOVATE.GERIATRIC.MED.PSYCH.FD101.DWG