CODED NOTES: ⟨#⟩

1. RTU-1: 42 MCA, 208V-3PH. RUN (3) #6, #10G IN 1" CONDUIT FROM 50A/3P BREAKER THRU FACTORY SUPPLIED DISCONNECT TO UNIT. MAKE FINAL CONNECTION.
2. RTU-2: 53 MCAA, 208V-3PH. RUN (3) #4, #10G IN 1" CONDUIT FROM 60A/3P BREAKER THRU FACTORY SUPPLIED DISCONNECT TO UNIT. MAKE FINAL CONNECTION.
3. NOT USED.
4. EF-1: 3/4 HP, 120V. PULL (2) #12, #12G IN 3/4" CONDUIT THROUGH HOOD MASTER CONTROL PANEL FOR CONTROL. SEE SHEET E2.1 FOR COORDINATION.
5. EF-2: FRACTIONAL HP, 120V. ROUTE CIRCUIT TO KITCHEN LIGHTING CIRCUIT TO OPERATE WHENEVER RESTAURANT IS IN USE.
6. WALK-IN FREEZER CONDENSING UNIT: 3.6 KW, 208V-3PH. PROVIDE (3) #10, #12G IN 3/4" CONDUIT FROM 20A/3P BREAKER THROUGH UNIT MOUNTED 30A/3P NON-FUSED NEMA 3R DISC. SWITCH TO UNIT. MAKE FINAL CONNECTION.
7. WALK IN COOLER CONDENSING UNIT: 5.4 KW, 208V-3PH. PROVIDE (3) #12, #12G IN 3/4" CONDUIT FROM 20A/3P BREAKER THROUGH UNIT MOUNTED 30A/3P NON-FUSED NEMA 3R DISC. SWITCH TO UNIT. MAKE FINAL CONNECTION.
8. DRIVE-THRU BEVERAGE STATION ICE MAKER CONDENSING UNIT: 1.4 KW, 208V-1PH. PROVIDE (2) #12, #12G IN 3/4" CONDUIT FROM 20A/2P BREAKER THROUGH 30A/2P NON-FUSED NEMA 3R DISC SWITCH TO UNIT. MAKE FINAL CONNECTION.

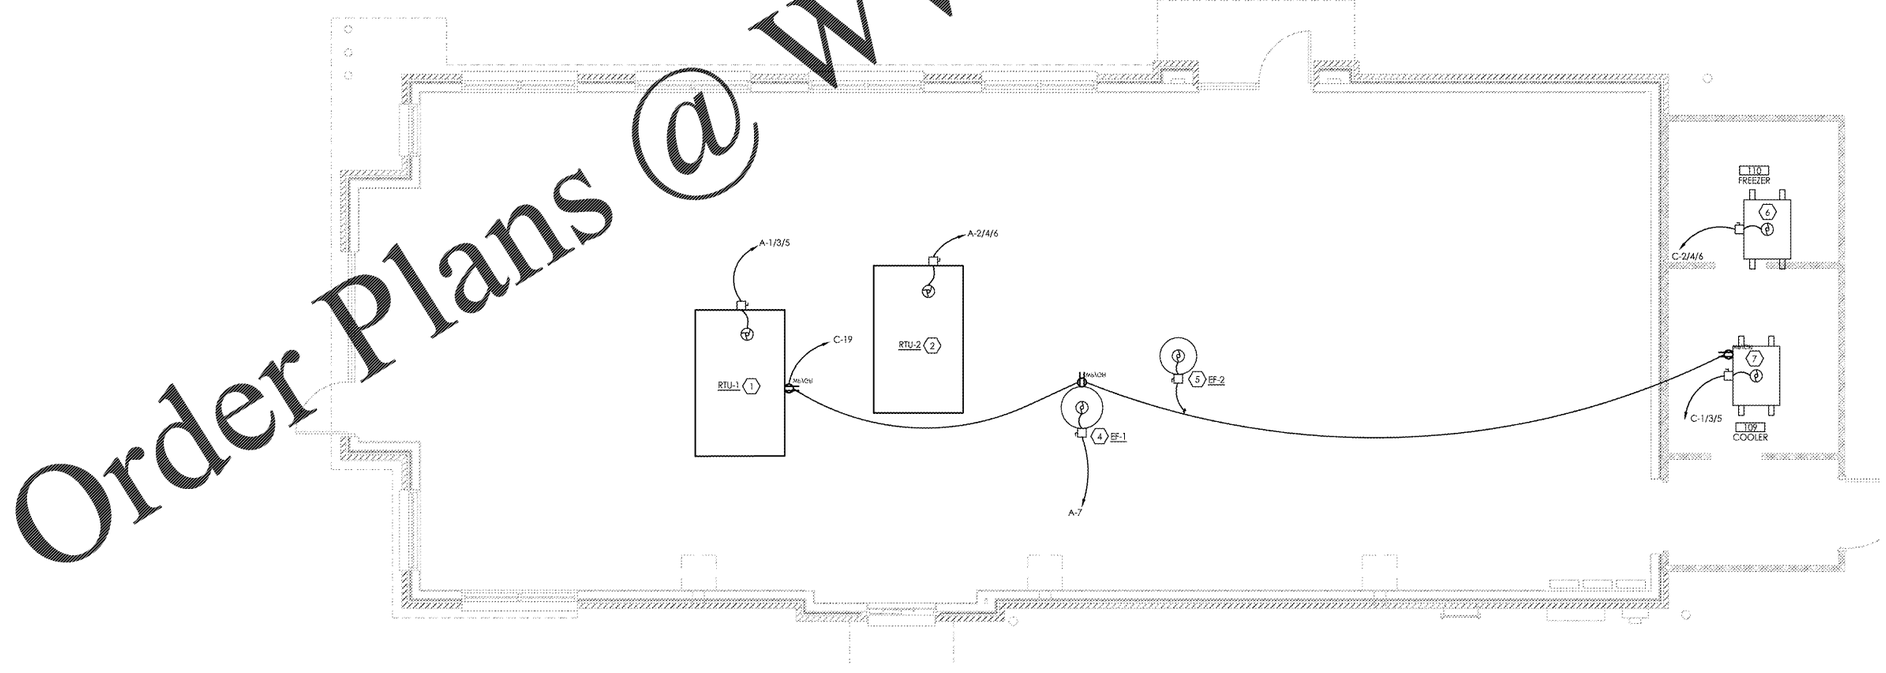

1 ROOF PLAN - ELECTRICAL
1/4" = 1'-0"

Order Plans @ WWW.LDILine.com

NOT FOR CONSTRUCTION, FOR REFERENCE ONLY

r e d
architecture + planning
174 east long street
suite 300
columbus, ohio 43215
tel: 614.487.8770
fax: 614.487.8777

PROPRIETARY INFORMATION NOTICE:
THESE PROTOTYPICAL DOCUMENTS MAY REQUIRE REVISIONS TO CONFORM TO LOCAL, STATE, AND FEDERAL CODES, ORDINANCES OR OTHER CONDITIONS. THE DESIGN CONCEPTS EMBODIED IN THESE DOCUMENTS ARE SPECIFICALLY FOR THIS PROJECT. INFORMATION CONTAINED HEREIN REMAINS THE SOLE PROPERTY OF ARBY'S RESTAURANT GROUP, IS CONFIDENTIAL AND PROPRIETARY AND IS NOT TO BE COPIED, REPRODUCED, DISCLOSED OR OTHERWISE TRANSFERRED TO OTHER PARTIES IN ANY FORM WHATSOEVER WITHOUT THE EXPRESS WRITTEN CONSENT OF ARBY'S RESTAURANT GROUP.

Arby's

Copyright©2019 by Arby's Restaurant Group

ARBY'S RESTAURANT
INSPIRE WORKSMART 2400
2385 LEN PATTERSON RD
FORT MILL, SC 29708
FOR
BRUMIT RESTAURANT GROUP, LLC
40 SEMINOLE STREET, ASHEVILLE, NC 28803

PROJECT NUMBER: ARF149

ISSUE	DATE
OWNER REVIEW	AUG 7, 2019

ROOF PLAN ELECTRICAL

SHEET: E3.1

8/1/2019 3:13 PM