1. VERIFY ALL HVAC & KITCHEN EQUIPMENT PRIOR TO ROUGH IN.
2. ALL TELEPHONE/DATA/TV CABLES AND WIRES, AND TERMINATES ALL REQUIRED CABLE AND JACKS WILL BE INSTALLED BY THIRD PARTY.
3. POWER SUPPLY FOR COMPUTER, CASH REGISTER (81, & 86, OR 87A, & 81) SHALL BE ON THE SAME CIRCUIT BREAKER, W/ISOLATED GROUND & ORANGE RECEPTACLE.
4. ALL CIRCUITRY SHOWN WITHOUT TICKS SHALL HAVE (2) WIRES PLUS EQUIPMENT GROUNDING CONDUCTOR.
5. ALL MULTI-WIRE BRANCH CIRCUITS SHALL HAVE SEPARATE NEUTRALS TO MEET THE REQUIREMENTS OF 2014 NEC 210.4(B).
6. TRANSFORMERS SHALL BE MOUNTED ABOVE CEILING BELOW TRUSSES WITH LOW VOLTAGE WIRING FEEDING TO ALL EXTERIOR LIGHTS.

POWER PLAN GENERAL NOTES 2

NOT TO SCALE E-100

1. ALL CIRCUITRY/CONDUIT FOR FRONT LINE EQUIPMENT TO BE ROUTED IN CASEWORK TO J-BOX IN WALL AND CONCEAL IN WALL.
2. PROVIDE SEALS AND EXPANSION COUPLINGS ON ALL CONDUITS ENTERING / LEAVING AREA OF TEMPERATURE DIFFERENCE.
3. PROVIDE (2) 1-1/2" CONDUITS WITH PULL STRINGS FROM CASH REGISTER TO MANAGER STATION. SEE P.O.S. AND SERVICE LINE ELEVATIONS, SHEET 3/E-200.
4. SEE 'MANAGER STATION ELEVATION' 1 / E-200 FOR ADDITIONAL OUTLETS AND J-BOXES.
5. ANSUL PULL STATION. REFER TO DETAIL, SHEET 2 / E-400.
6. REFER TO 'LTG AND DOOR HEATER' WIRING DIAGRAM, SHEET 10 / E-400.
7. REFER TO 'COOLER EVAPORATOR COIL' WIRING DIAGRAM, SHEET 8 / E-400.
8. EXISTING SHOW WINDOW RECEPTACLE SHALL BE CONTROLLED VIA SWITCH "c". REFER TO LIGHTING SWITCHBANK SCHEDULE, SHEET 4/E101. RECEPTACLE SHALL BE MOUNTED IN WALL AS CLOSE TO TOP OF STRUCTURAL HEADER AS POSSIBLE. SHOW WINDOW RECEPTACLE INSTALLED UNDER SEPARATE PERMIT.
9. EXISTING W.P. J-BOX FOR SIGNAGE INSTALLED BY LANDLORD UNDER SEPARATE PERMIT. COORDINATE LOCATION WITH ARCHITECT / OWNER / SIGN PACKAGE. SIGN DISCONNECT PROVIDED BY SIGN CONTRACTOR.
10. REFER TO 'FREEZER EVAPORATOR COIL' WIRING DIAGRAM, SHEET 9 / E-400. CONNECTION FOR HEAT TRACE TAPE INCLUDED IN FREEZER EVAPORATOR COIL. HEAT TAPE PROVIDED AND INSTALLED BY ELECTRICIAN.
11. ROUTE HOMERUN THROUGH LIGHTING SWITCHBANK 'A' (SWITCH AS NOTED IN LOWER CASE). REFER TO SCHEDULE, SHEET 4/E-101, FOR MORE INFORMATION.
12. CONNECT TO VEGETABLE DISPLAY LIGHTING PROVIDED WITH WALK-IN COOLER.
13. NOT USED.
14. HOOD CONTROL PANEL/ANSUL SYSTEM CABINET. MOUNT CABINET DIRECTLY BELOW T-BAR CEILING.
15. PROVIDE 2-GANG J-BOX @ 48" AFF FOR HOOD CONTROL SWITCHES. REFER TO M-400, M-401.
16. CONDUIT STUB UP LOCATION IN STAINLESS STEEL POWER PANEL FOR ISLAND KITCHEN EQUIPMENT CONNECTION. REFER TO DETAIL 2/A-109. COORDINATE LOCATION WITH ARCHITECT / OWNER.
17. ROUTE CABLING / CIRCUITRY THROUGH CONDUIT IN SLAB (KEYED NOTE #16).
18. UTILIZE SEAL TIGHT CONDUIT FOR ALL WIRING INCLUDED ALONG LOW WALL PANEL.
19. ALL DEVICES UNDER HOOD TO BE PROVIDED AND INSTALLED WITH SHUNT TRIP CIRCUIT BREAKER AND WATERPROOFING BOX (RED DOT #CKSUV). REFER TO COOKLINE ELECTRICAL ELEVATIONS, SHEET 6/E-200.
20. SIMPLEX RECEPTACLE TO BE CONNECTED TO BACK-OF-HOUSE LIGHTING CIRCUITRY/CONTROL. CONTRACTOR TO PROVIDE PIGTAIL FROM CIRCULATION PUMP.
21. PROVIDE WEATHERPROOF GFI RECEPTACLE FOR HEAT TAPE. COORDINATE FINAL LOCATION WITH REFRIGERATION INSTALLER.
22. ELECTRIC GRILL '23B': FEED WITH 2 #8, #10 GROUND, 3/4" CONDUIT. REFER TO DETAIL, SHEET 4 / E-200.
23. NOT USED.
24. FURNISH AND INSTALL (3) HUBBELL GFRTBF20 FACELESS GFCI (OR EQUIVALENT) (1) FOR EACH CIRCUIT FEEDING EQUIPMENT BENEATH THE KITCHEN HOOD WHICH UTILIZES SIMPLEX 120V RECEPTACLES KITCHEN HOOD. INSTALL IN ACCESSIBLE LOCATION IN THIS GENERAL AREA, OR AS DIRECTED BY THE OWNER, ARCHITECT OR ENGINEER. PROVIDE ADDITIONAL OUTLETS AS REQUIRED TO FEED ALL SUCH LOADS BENEATH HOOD. FASTEN A PLASTIC LABEL STATING CIRCUIT AND EQUIPMENT SERVED FOR EACH OUTLET.
25. PROVIDE WP (USE RED DOT #CKSUV).
26. CONTRACTOR TO ENSURE THAT ELECTRICAL OUTLET SHOWN FALLS BENEATH TABLE TOP. REFER TO ARCHITECTURAL FURNITURE PLAN FOR EXACT LOCATION.
27. NOT USED.
28. SEE DRINK STATION ELEVATIONS, SHEET 5/E-200.
29. NOT USED.
30. SEE 3/E-200 FOR SERVICE LINE ELEVATIONS.
31. NOT USED.
32. SEE DINING ROOM MONITOR ELEVATION, SHEET 8/E-200.
33. NOT USED.
34. REFER TO SHEET 9/E-200 FOR INSTALLATION OF C02 MONITOR.
35. SEE SWITCH BANK ELEVATIONS , SHEET 7/E-200.
36. EXISTING TELEPHONE BACKBOARD INSTALL UNDER SEPARATE PERMIT (BY LANDLORD). TO BE RELOCATED TO ABOVE MANAGER'S AREA. REFER TO ELEVATION DETAIL #1 ON SHEET E-200. EXTEND EXISTING CONDUIT OVERHEAD TO SAME LOCATION PRIOR TO ANY COMMUNICATION CABLE INSTALLATION.
37. FLY LIGHT RECEPTACLE SHALL BE INSTALLED WITH A RECESSED CLOCK OUTLET. TYP OF 2 LOCATIONS.
38. SEE SECURITY KEY PAD ELEVATION 1/E200.
39. CONNECT HEAT LAMPS TO COUNTER-MOUNTED SWITCH PROVIDED AND INSTALLED BY CONTRACTOR. REFER TO PLAN FOR LOCATIONS AND QUANTITIES.

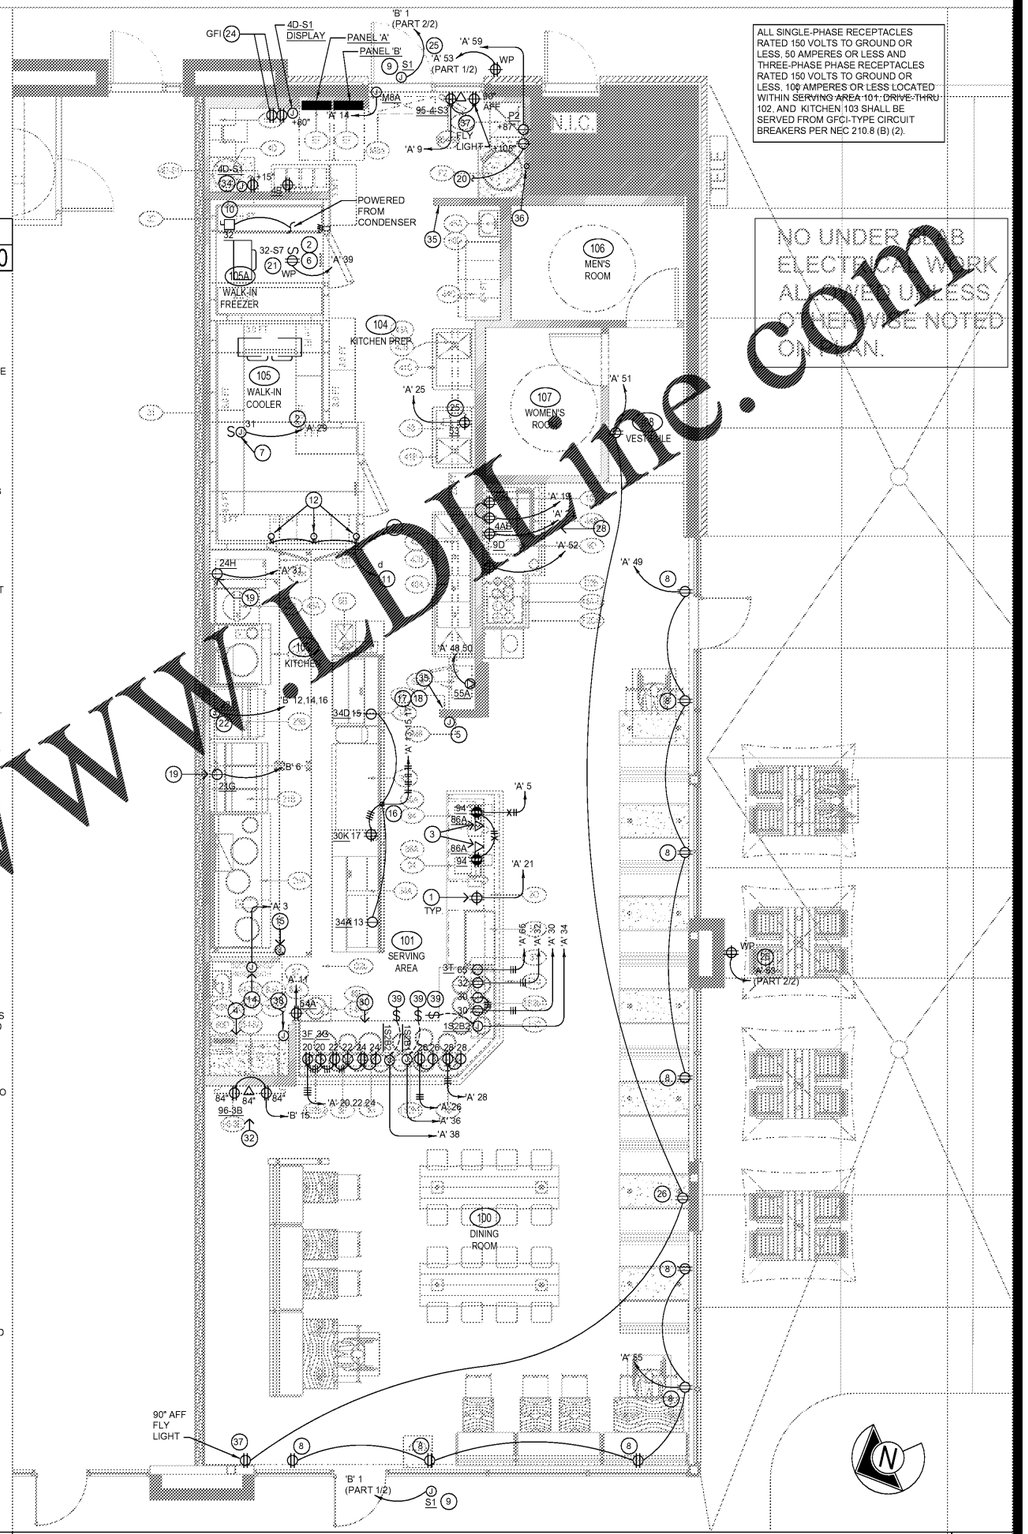

POWER PLAN KEYED NOTES 3

NOT TO SCALE E-100

POWER FLOOR PLAN 1

Scale: 1/4"=1'-0" E-100

Order Plans @ WWW.LDLine.com

PANDA EXPRESS CHINESE KITCHEN

PANDA RESTAURANT GROUP INC.
1683 Walnut Grove Ave.
Rosemead, California
91770
Telephone: 626.799.9898
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:

ISSUE DATE:

1	05.29.19 ISSUE FOR PERMIT
2	08.08.19 ISSUE FOR BID

DRAWN BY: JEL

PANDA PROJECT #: - S4-20-D7060
C&P PROJECT #: - 2190238

Cuhaci & Peterson Architects Engineers Planners
1925 Prospect Ave. Orlando, FL 32814
P (407) 661-9100
F (407) 661-9101
www.c-p.com
Florida Corporate Certificate #AA C000539

08.08.2019

PANDA EXPRESS
TRUE WARM AND WELCOME
3460 SANDY PLAINS RD, NE SUITE 210
MARIETTA, GA 30066

E-100
POWER FLOOR PLAN