


KITCHEN EXHAUST SYSTEM DIAGRAM | 3

NOT TO SCALE | E-401

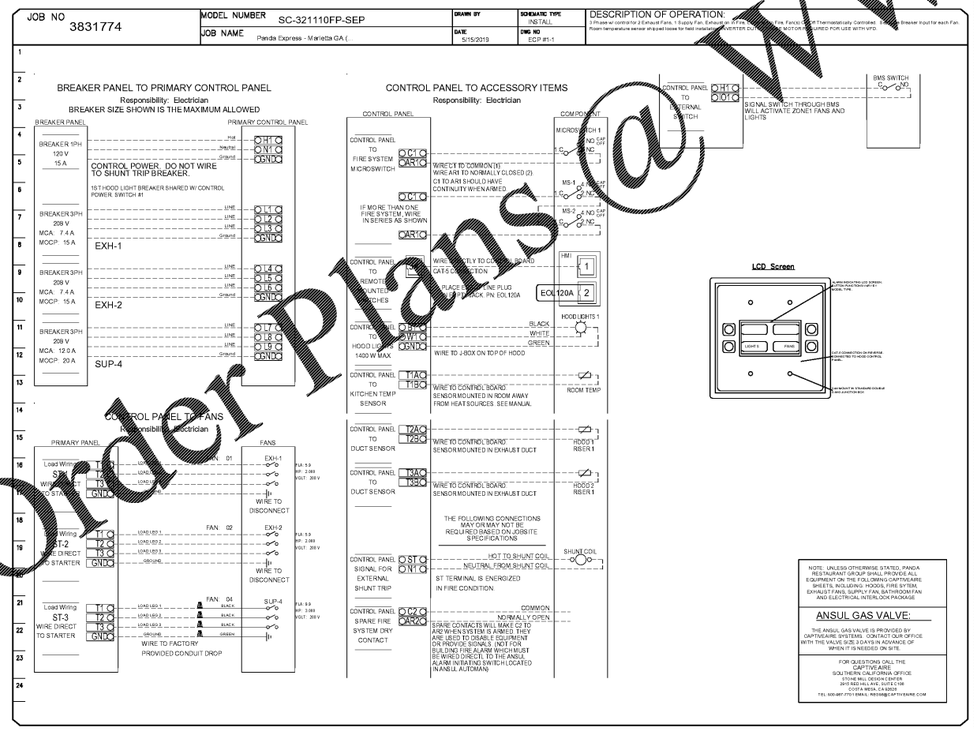


NOTE: LIQUID TIGHT FLEX TO UNITS AND DISCONNECTS NOT SHOWN FOR CLARITY.

NOTE: REFER TO DETAILS, SHEET A-108, FOR ADDITIONAL INFORMATION.

EQUIPMENT DISCONNECT SWITCH SUPPORT | 2

NOT TO SCALE | E-401

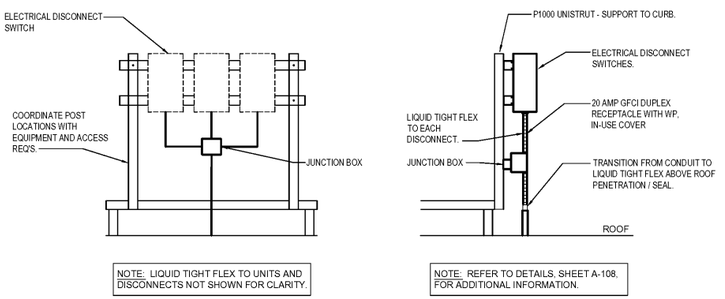NOTE USED | 1

NOT TO SCALE | E-401

Order Plans @ WWW.LDILine.com

PANDA RESTAURANT GROUP INC.
1683 Walnut Grove Ave.
Rosemead, California
91770
Telephone: 626.799.9898
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:

ISSUE DATE:

| | |
|---|---|
| 1 | 05.29.19 ISSUE FOR PERMIT |
| 2 | 08.08.19 ISSUE FOR BID |

DRAWN BY: JEL

PANDA PROJECT #: - S4-20-D7060

C&P PROJECT #: - 2190238

Cuhaci & Peterson
Architects Engineers Planners
1925 Prospect Ave. Orlando, FL 32814
P (407) 661-9100
F (407) 661-9101
www.cp.com
Florida Corporate Certificate #AA C000526

08.08.2019

PANDA EXPRESS

TRUE WARM AND WELCOME
3460 SANDY PLAINS RD, NE SUITE 210
MARIETTA, GA 30066

# E-401

ELECTRICAL DETAILS, DIAGRAMS