




TRINITY ENGINEERING GROUP INC.

1081 THOMPSON BRIDGE RD
GAINESVILLE, GA 30501
TEL: (770) 535-1044
FAX: (770) 535-0037

CONSULTANT



HLH H. LLOYD HILL ARCHITECTS & ASSOCIATES, INC.

736 GREEN STREET
GAINESVILLE, GA 30501
(770) 534-8404

ARCHITECT

OWNERSHIP OF DOCUMENTS:
DRAWINGS AND SPECIFICATIONS AS INSTRUMENTS OF SERVICE ARE EXCLUSIVE PROPERTY OF TRINITY ENGINEERING GROUP INC. WHETHER THE PROJECT FOR WHICH THEY WERE PREPARED IS EXECUTED & CONSTRUCTED OR NOT, THESE DOCUMENTS ARE NOT TO BE REPRODUCED IN ANY FORM AND ARE NOT TO BE USED BY THE PROJECT OWNER NOR ANY OTHER ENTITY ON OTHER PROJECTS OR FOR ANY EXTENSIONS OR ADDITIONS OR ALTERATIONS TO THE ORIGINAL PROJECT EXCEPT BY WRITTEN AUTHORIZATION & PERMISSION FROM AND AGREEMENT WITH TRINITY ENGINEERING GROUP INC.

NEST FEATHERS
3621 MUNDY MILL ROAD
OAKWOOD, GEORGIA

POWER PLAN - MAIN FLOOR

REVISION / ISSUE



JOB NUMBER
2018-103
DRAWN
--
DATE
07/09/2019
SHEET
E-1.1

KEYNOTES:

1. POKE-THRU FLUSH FLOOR RECEPTACLES, COORDINATE EXACT PLACEMENT OF POKE-THRU WITH OWNER PRIOR TO ROUGH-IN OF DEVICE AND CIRCUITING.
2. REFER TO THE "MECHANICAL-ELECTRICAL EQUIPMENT CONNECTION SCHEDULE" FOR ELECTRICAL CIRCUITING AND OVER-CURRENT PROTECTION OF THE UNIT, COORDINATE EXACT REQUIREMENTS WITH THE SUB-CONTRACTOR PRIOR TO ROUGH-IN.
3. PROVIDE SMOKE DETECTORS FOR ELEVATOR RECALL. COORDINATE WITH ELEVATOR MANUFACTURER.
4. PROVIDE NEW FEEDER BREAKERS WITH THE EXISTING MAIN DISTRIBUTION PANEL FOR NEW ELECTRICAL DISTRIBUTION PANS AS SHOWN ON THE ELECTRICAL RISER DIAGRAM.

GENERAL NOTES:

1. ALL 20A/15A GFI DEVICES WITHIN THE KITCHEN/FOOD PREP AREAS AND MEAT AREAS SHALL BE PROVIDED WITH READILY ACCESSIBLE GROUND FAULT CIRCUIT INTERRUPTION PROTECTION AS PER THE REQUIREMENTS OF THE NEC. 210.8. CIRCUITS SHALL BE ALLOWED TO BE CONNECTED TO A GFCI BREAKER AS LONG AS THE ELECTRICAL PANEL IS WITHIN THE TENANT SPACE.

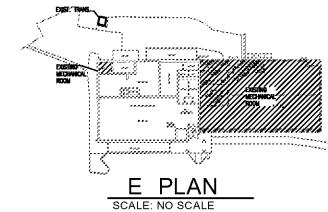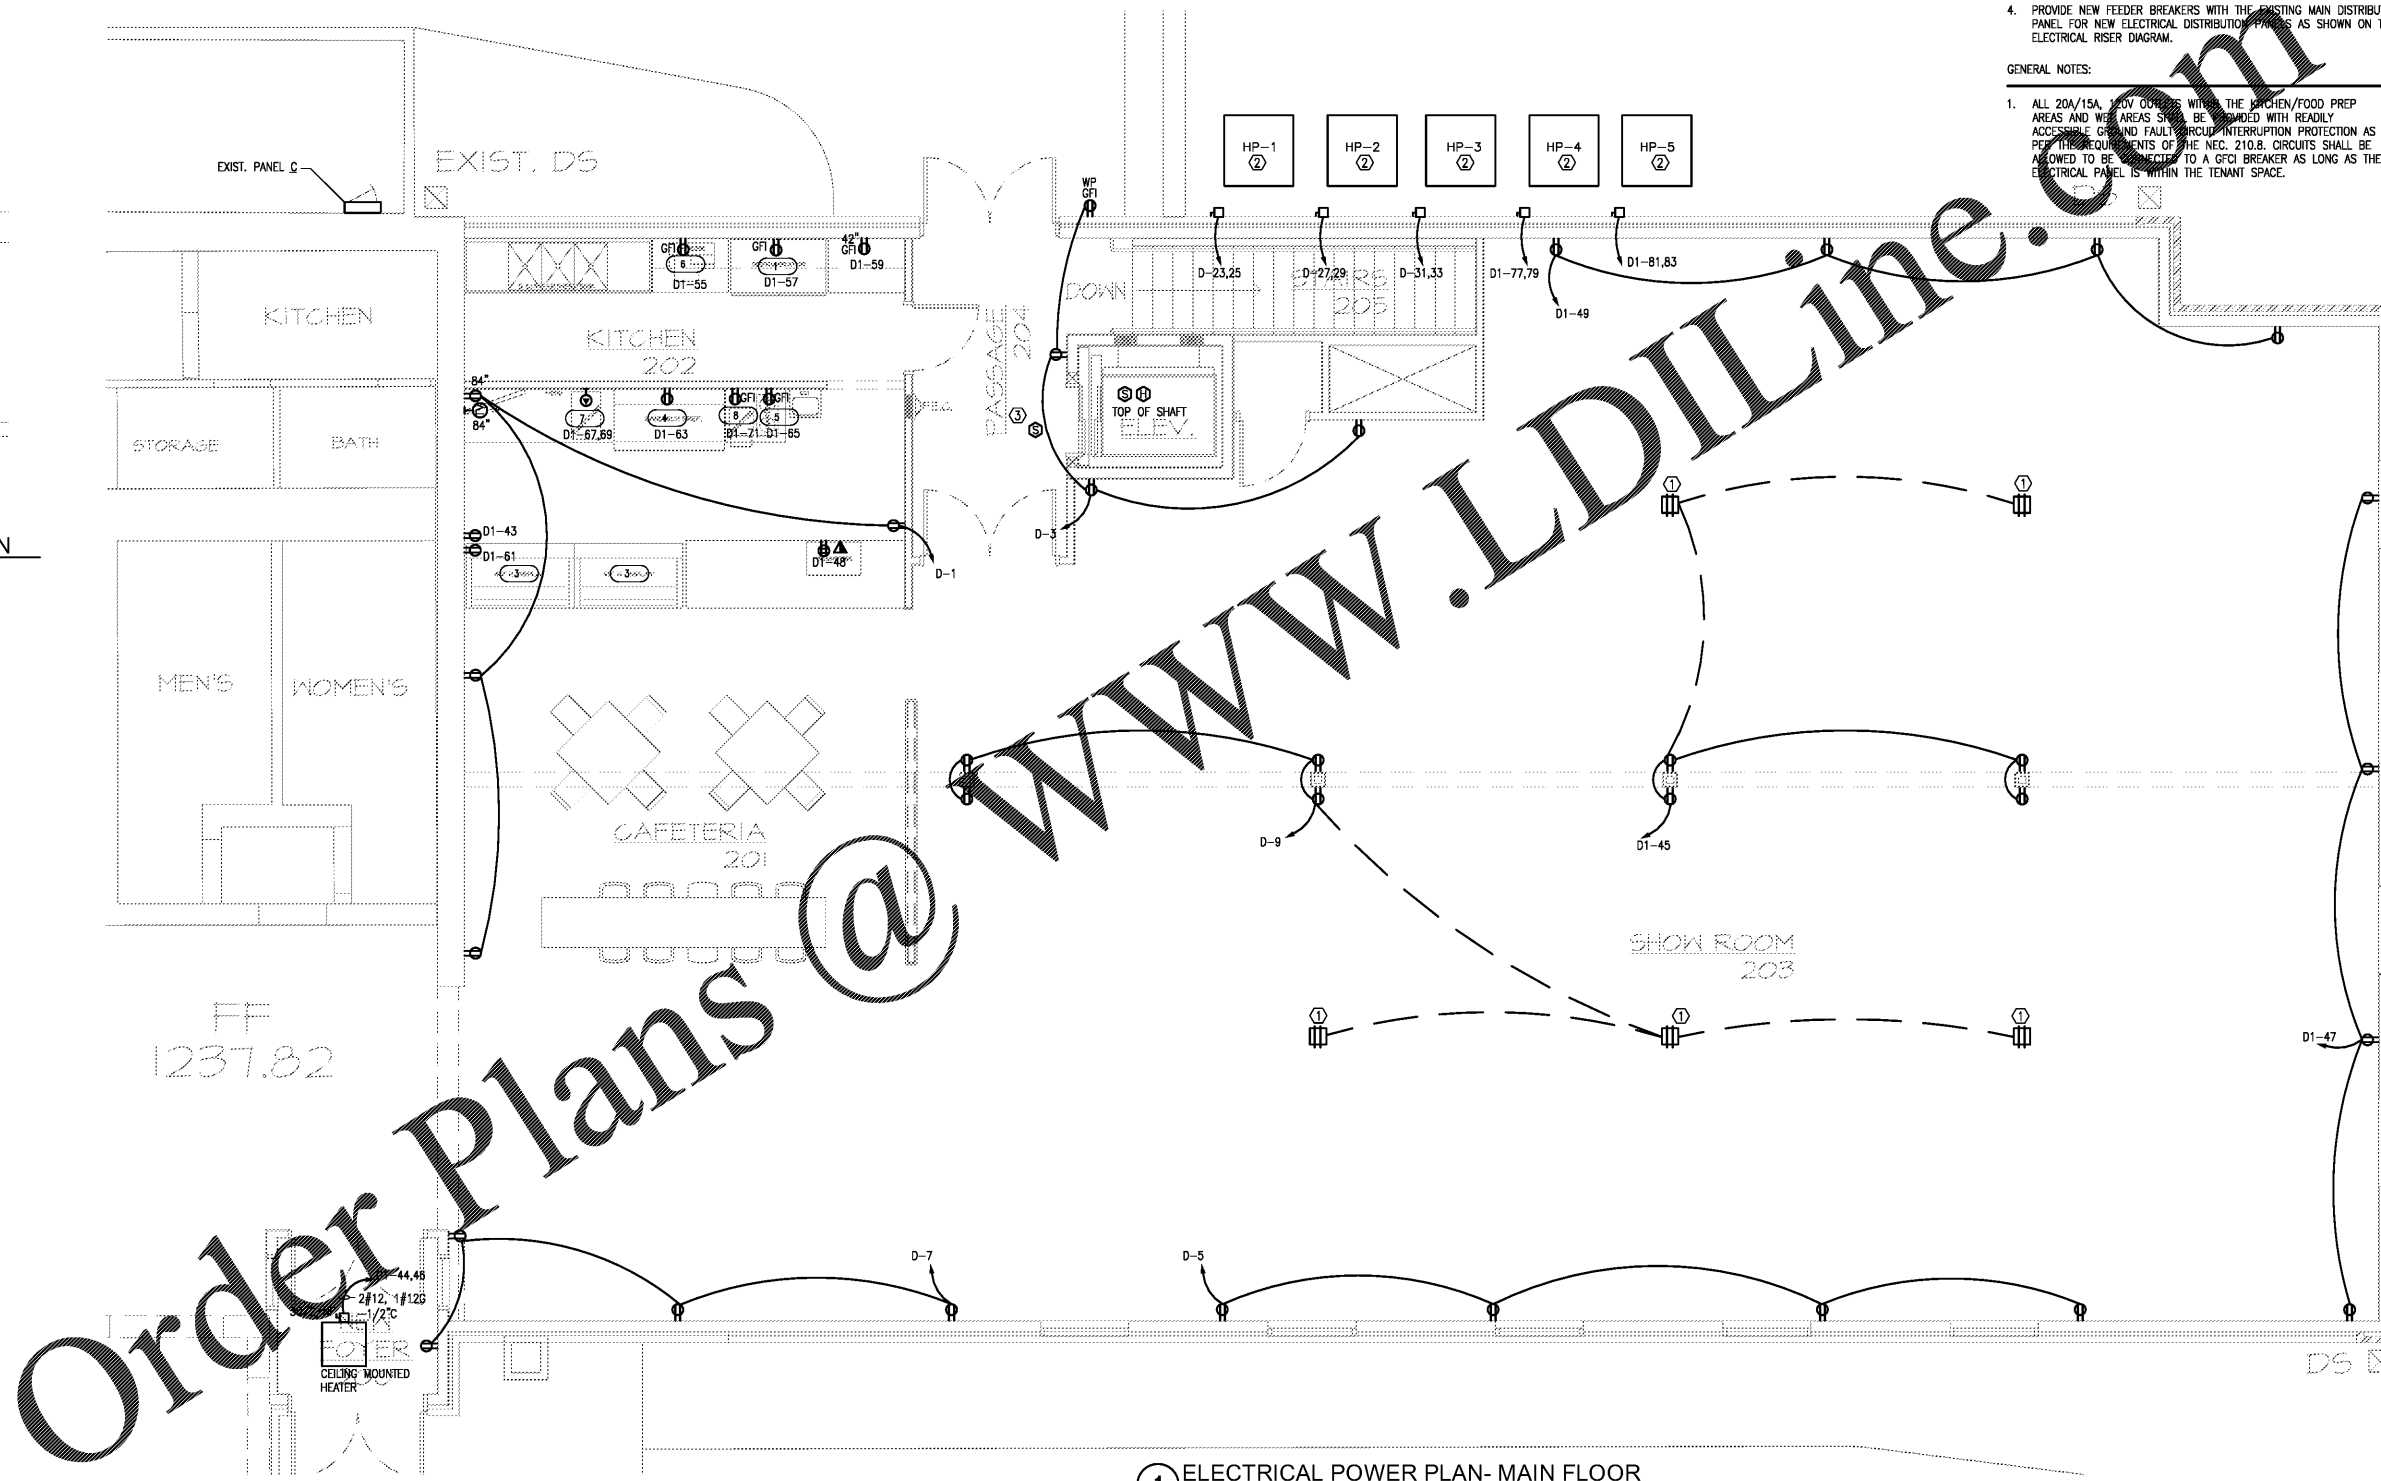

Order Plans @