


4 Wall Section at Dumpster Pad
SCALE: ¾" = 1'-0"

| Dumpster Pad Gate Notes: | | Plan Legend: |
|---|---|---|
| Size: | ONE PAIR , 7'-4" HIGH x APPROXIMATELY 5'-0" WIDE NOMINAL , EACH. ( G.C. TO COORDINATE ) | FTG. "A"; 30" x 3'-8" x 12" DEEP FOOTING, REINFORCE WITH 5 #4 E.W. TOP AND BOTTOM |
| Manufacturer: | FORTIFIED FENCE GROUP 4485 Alicia Lane Cumming, GA 30028 678-447-1420 | W.S.; INDICATES WALL STUD. FILL CELL OF BLOCK VERTICALLY WITH CONCRETE AND REINFORCE WITH 1 #5. PROVIDE DOWELS AT FOOTING AND HOOK IN BOND BEAM ABOVE. BARS MAY BE SLICED AND LAPPED 2'-2" MIN. |
| Model: | DUMPSTER GATE 01 ( 3 RAIL SYSTEM ) WITH WESTERN RED CEDAR PRIVACY SECTIONS WITH STAIN FINISH. ( SEE ELEVATIONS ) | |
| Material: | GALVANIZED STEEL | |
| Finish: | BLACK POWDER COAT | |
| Hardware: | PROVIDE POSTS, HINGES AND LOCKING DEVICES AS REQUIRED TO MEET COMPLETE INSTALLATION. | |




3 Front Elevation
SCALE: ¼" = 1'-0"

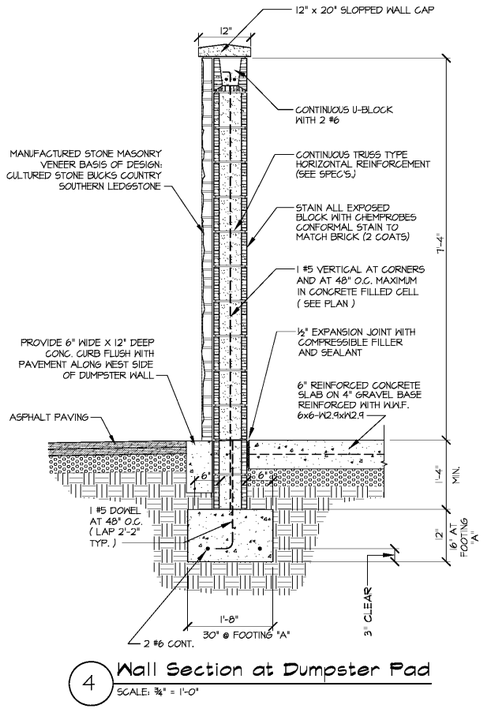


2 Side Elevation
SCALE: ¼" = 1'-0"

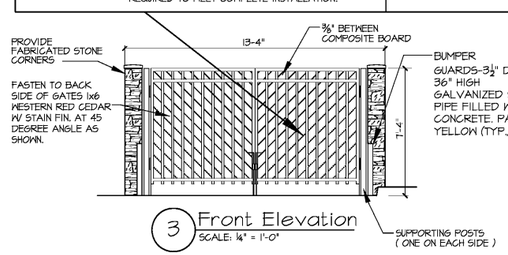


NOTE:
SUPPORTING POSTS AT EACH SIDE OF GATES SHALL BE INSTALLED AND SIZED BY THE MANUFACTURER'S RECOMMENDATIONS. (APPROXIMATELY 5" x 5" SQUARE POSTS)

1 DUMPSTER PAD PLAN
SCALE: ¼" = 1'-0"

| Plan Legend: | |
|---|---|
| FTG. "A"; | 30" x 3'-8" x 12" DEEP FOOTING, REINFORCE WITH 5 #4 E.W. TOP AND BOTTOM |
| W.S.; | INDICATES WALL STUD. FILL CELL OF BLOCK VERTICALLY WITH CONCRETE AND REINFORCE WITH 1 #5, PROVIDE DOWELS AT FOOTING AND HOOK IN BOND BEAM ABOVE. BARS MAY BE SPLICED AND LAPPED 2'-2" MIN. |

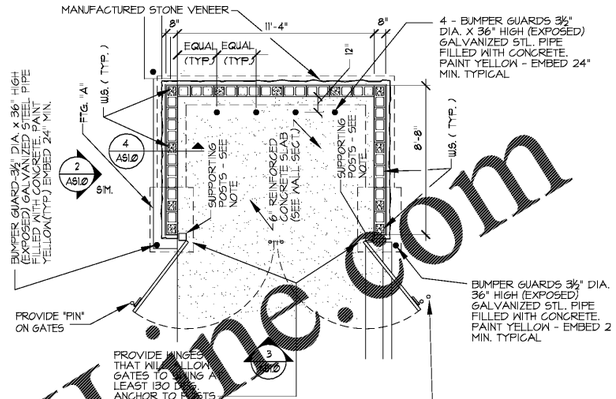


5 / AS2.0 FLAGPOLE FOOTING
SCALE: ¾" = 1'-0"




6 / AS2.0 DRAIN PIPE THRU CURB
SCALE: ¾" = 1'-0"

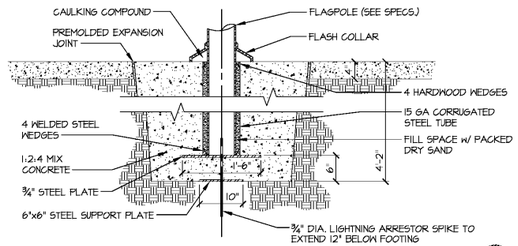


7 / AS2 GROUND SIGN AT ENTRY
SCALE: 1/4" = 1'-0"

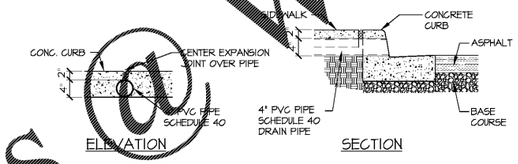


8 / AS2 MAIN SIGN FOUNDATION
SCALE: 3/4" = 1'-0"

SIGN DESIGN NOTES

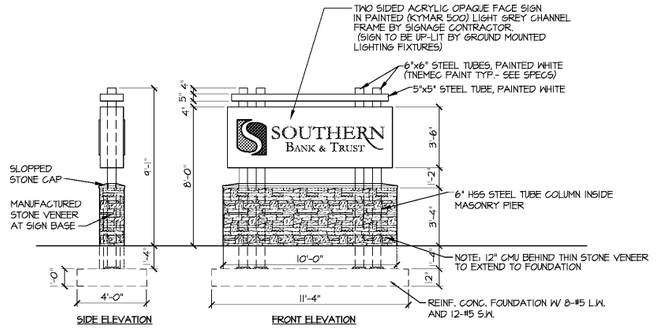1. THE SIGN DESIGN COMPLIES WITH THE CURRENT EDITION OF THE GEORGIA STATE MINIMUM STANDARD BUILDING CODE
2. THE WIND LOAD DESIGN COMPLIES WITH ASCE 7 (MINIMUM DESIGN LOADS FOR BUILDINGS AND OTHER STRUCTURES)
3. BASIC WIND SPEED (MINIMUM 90 MPH 3-SECOND GUST), DESIGN WIND PRESSURE (PSF), EXPOSURE CATEGORY (C)
4. MINIMUM REQUIRED SOIL BEARING CAPACITY (PSF) 2500 PSI; A GEORGIA REGISTERED PROFESSIONAL ENGINEER SHALL CERTIFY THAT THE SOIL BEARING CAPACITY MEETS OR EXCEEDS THE MINIMUM REQUIRED SOIL BEARING CAPACITY AS STATED ON THE DRAWINGS AND THE OWNER/APPLICANT SHALL SUBMIT THIS CERTIFICATION STATEMENT TO THE BUILDING OFFICIAL PRIOR TO THE PLACEMENT OF THE FOUNDATION.

Order Plans @ WWW.LDLine.com

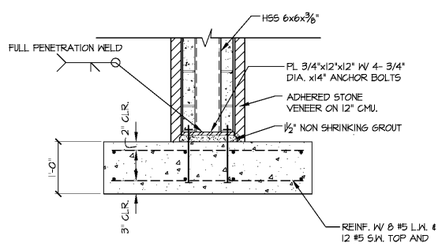HLH
H. LLOYD HILL ARCHITECTS & ASSOCIATES, INC.
736 GREEN STREET
GAINESVILLE, GA 30501
(770) 534-8404
A.I.A.
STATE OF GEORGIA
STEVEN B. HILL
REGISTERED ARCHITECT

New Cornelia Branch
Southern Bank & Trust
Cornelia, Georgia

COPYRIGHT (C) 2019 - H. LLOYD HILL ARCHITECTS AND ASSOCIATES, INC.

| DATE | DESCRIPTION |
|---|---|
| 04-09-2019 | SCHEMATIC DESIGN DRAWINGS |
| 04-30-2019 | DESIGN DEVELOPMENT DRAWINGS |
| 07-25-2019 | CONSTRUCTION / BID DRAWINGS |

PROJ. NO: G1902
FILE NAME: .DWG
DRAWN BY: ---

SHEET TITLE:
SITE DETAILS

SHEET NUMBER:
AS2.0