DOOR AND FRAME SCHEDULE

TAG	DOOR SIZE WD	DOOR SIZE HGT	DOOR MAT.	DOOR ELEV	FRAME MAT.	FRAME ELEV	FIRE RATING	NOTES
01	(2) 3'-0"	7'-0"	WOOD	1/A3.0	WOOD	1/A3.0	--	1
02	(2) 3'-0"	7'-0"	WOOD	1/A3.0	WOOD	1/A3.0	--	2
03	3'-0"	7'-0"	WOOD	A	WOOD	23/A7.0	--	5
04	3'-0"	7'-0"	WOOD	A	WOOD	23/A7.0	--	5
05	3'-0"	7'-0"	WOOD	A	WOOD	24/A7.0	--	5
06	3'-0"	7'-0"	WOOD	A	WOOD	22/A7.0	--	6
07	2'-6"	7'-0"	WOOD	A	WOOD	25/A7.0	--	--
08	2'-4"	7'-0"	WOOD	A	WOOD	25/A7.0	--	--
09	3'-0"	7'-0"	WOOD	A	WOOD	25/A7.0	--	--
10	2'-0"	7'-0"	WOOD	A	HM	std	--	--
11	3'-0"	7'-0"	HM	B	HM	3/A3.0	--	3
12	3'-0"	7'-0"	WOOD	C	HM	std.	--	--
13	3'-0"	7'-0"	WOOD	C	HM	std.	--	--
14	3'-0"	7'-0"	WOOD	A	WOOD	25/A7.0	--	--
15	3'-0"	7'-0"	WOOD	A	WOOD	25/A7.0	--	--
16	3'-0"	7'-0"	WOOD	A	WOOD	25/A7.0	--	--
17	3'-0"	7'-0"	WOOD	C	HM	std.	--	--
18	3'-0"	7'-0"	WOOD	C	HM	std.	--	4
19	2'-6"	7'-0"	WOOD	A	WOOD	25/A7.0	--	--
20	3'-0"	7'-0"	WOOD	A	WOOD	25/A7.0	--	--
21	3'-0"	7'-0"	WOOD	A	WOOD	24/A7.0	--	5
22	3'-0"	7'-0"	WOOD	A	WOOD	24/A7.0	--	5
23	3'-0"	7'-0"	WOOD	A	WOOD	24/A7.0	--	5

KEY TO DOOR SCHEDULE REMARKS

1. BASIS OF DESIGN - PELLA CLAD/WOOD COMMERCIAL OUTSWING DOORS. SEE SPECIFICATIONS.
2. SAME AS ABOVE BUT STANDARD WOOD (NOT CLAD) DOORS. SEE SPECIFICATIONS.
3. EXTERIOR EMBOSSED HOLLOW METAL DOOR
4. DOOR #18 TO BE KEYPAD ACCESS AT BOTH SIDES
5. DOORS TO RECEIVE GLASS TRANSOM- SEE A7.0

** SEE SPECIFICATIONS FOR DOOR HARDWARE**

NOTES:

NOTE 1: PROVIDE 2½" DIAMETER HOLES WITH GROMMET TRIM RINGS AS SHOWN ON PLAN - SEE MILLWORK DRAWINGS ON A7.1.

NOTE 2: PROVIDE ½" GYPSUM BOARD ON ⅞" FURRING CHANNELS ON FACE OF CONCRETE VAULT WALLS. EXTEND 6" ABOVE ADJACENT CEILING.

NOTE 3: PROVIDE ½" GYPSUM BOARD ON 3⅝" STUDS TIGHT TO FACE OF CONCRETE VAULT WALLS EXTEND 6" ABOVE ADJACENT CEILING.

NOTE 4: PROVIDE APPROPRIATE TRANSITION FOR LVT/TILE AND LVT/CARPET TRANSITION. SEND ARCHITECT PRODUCT DATA ON PROPOSED TRANSITION PRIOR TO INSTALLATION.

NOTE 5: PROVIDE RECESSED PEDIMAT AT ENTRANCE SEE DETAIL - SEE SPECS.

NOTE 6: GENERAL CONTRACTOR SHALL ENSURE THAT THE ENTIRE EXTERIOR "ENVELOPE" OF THE BUILDING IS SEALED WITH INSULATION AND WRAPPED WITH AIR/VAPOR BARRIER.

NOTE 7: COORDINATE PLACEMENT AND INSTALLTION OF ALL BANKING EQUIPMENT, ALARM OR SURVEILLANCE EQUIPMENT WITH SUPPLIER OF EQUIPMENT.

NOTE 8: 4" O.D. PIPE FILLED w/ CONC., 2'-8" EXPOSED HEIGHT, EMBEDDED IN CONC. 1'-6" (TYP.) AT CUSTOMER UNITS AND ATM LOCATE AS PER BANK EQUIPMENT VENDOR SHOP DRAWINGS.

NOTE 9: 4" WIDE PAINTED WHITE STRIPES AS SHOWN ON SITE PLAN

NOTE 10: AFTER HOURS DEPOSITORY HEAD AND CHEST- COORDINATE WITH BANK EQUIPMENT VENDORS SHOP DRAWINGS / PRODUCT DATA FOR REQUIREMENTS.

NOTE 11: DRIVE-UP WINDOW AND TRANSACTION DRAWER- COORDINATE WITH BANK EQUIPMENT VENDORS SHOP DRAWINGS / PRODUCT DATA FOR REQUIREMENTS.

NOTE 12: VAULT DOOR AND MODULAR VAULT WALLS- COORDINATE WITH BANK EQUIPMENT VENDORS SHOP DRAWINGS / PRODUCT DATA FOR REQUIREMENTS.

NOTE 13: PROVIDE 4" THICK REINFORCED CONC. EQUIPMENT PAD FOR HVAC UNITS. PAD TO SLOPE AT ¼" PER FOOT AWAY FROM BUILDING TOWARD TRAFFIC LANES

NOTE 14: 2x6 WOOD FRAMING SHALL BE USED AT ALL EXT. WALLS TO ALLOW FOR THE OMISSION OF CONTINUOUS INSULATION OVER THE EXTERIOR SHEATHING. THE INTERIOR WALL HAVE BEEN DESIGNED TO USE 3⅝" METAL STUDS. IF WOOD STUDS ARE ELECTED TO BE USED IN THE INTERIOR, ALL EXPOSED LUMBER IN THE RETURN AIR PLENUM SHALL BE FIRE RATED TREATED.

LEGEND:

- PREFAB. MODULAR VAULT WALLS - COORDINATE WITH BANK EQUIPMENT PROVIDER DETAILS
- NON-RATED 3-5/8" INTERIOR METAL STUD PARTITION WITH ⅝" GYPSUM BOARD EAGH SIDE. STUDS AT 24" O.C. AT ALL INTERIOR PARTITIONS, WALL TO BE MIN. 6" ABOVE HIGHEST ADJACENT CEILING HEIGHT. COORDINATE WITH ROOM FINISH SCHEDULE.
- SAME AS ABOVE BUT w/ SOUND ATTENUATION BLANKETS STOP 6" ABOVE HIGHEST ADJACENT CEILING EXCEPT AT MEN/113, WOMEN/112, TOILET/108, EXEC. OFFICE/107 AND CONFERENCE/122 WHERE PARTITION AND INSULATION SHALL EXTEND TO BTM. SIDE OF ROOF TRUSSES ABOVE. PROVIDE OPENINGS IN WALLS ABOVE CEILING FOR RETURN AIR PLENUM - SEE MECHANICAL.
- E.J. EXPANSION JOINT IN CONCRETE
- C.J. CONTROL JOINT IN CONCRETE
- F.D. FLOOR DRAIN (SLOPE FLOOR TO DRAIN) SEE PLUMBING DRAWINGS
- F.E. FIRE EXTINGUISHER (SEE SPECIFICATIONS)
- A — INDICATES INTERIOR WINDOW / DOOR FRAME ELEVATION. SEE SHEET A7.0.
- 2/A7.0 — INDICATES MILLWORK ELEVATION. SEE SHEET A8.0

GENERAL NOTES:

- DO NOT SCALE DRAWING FOR REFERENCE. NOTIFY ARCHITECT OF ANY DISCREPANCIES OR MISSING DIMENSIONS.
- FLOOR PLAN DIMENSIONS ARE TO FACE OF STUD, FACE OF "MAIN BODY" BRICK OR CONCRETE.... UNLESS NOTED OTHERWISE
- ALL ZIP SYSTEM SHEATHING SHALL BE INSTALLED AND TAPED PER MANUFACTURER'S RECOMMENDATIONS. ALL BEAMS AND OPENING SHALL BE APPROPRIATELY WRAPPED & TAPED - SEE HEAD, JAMB, SILL DETAILS.
- ½" GYP. BD. SUB-CEILING AT BOTTOM OF ROOF TRUSSES SHALL BE MONOLITHIC & ALL SEAMS/VOIDS AT PENETRATIONS SHALL BE TAPED & SEALED IN SUCH A MANNER AS TO NOT ALLOW AIR MOVEMENT OR TRANSFER FROM PLENUM TO TRUSS AREA.
- G. C. SHALL ENSURE THAT THE ENTIRE EXT. "ENVELOPE" OF THE BUILDING IS SEALED WITH INSULATION, SEAL ANY VOIDS OR CAVITIES WITH SPF OR CELL INSULATION.
- THE TERM "PAINTED/FINISHED METAL" APPLIES TO BOTH GALV. STEEL AND/OR ALUMINUM AS APPROVED BY THE ARCHITECT. CONTRACTOR SHALL AVOID THE USE OF DISSIMILAR METALS IN CONTACT WITH ONE ANOTHER AS MUCH AS POSSIBLE AND SHALL PROVIDE FELTS BOND BREAKER TAPE OR OTHER APPLICABLE MATERIAL. SEPARATION WHERE SUCH CONTACT IS UNAVOIDABLE.
- SHOULD ANY CONFLICT EXIST BETWEEN THE DRAWINGS AND THE SPECIFICATIONS, THE GREATER QUALITY AND/OR QUANTITY OF MATERIALS SHALL BE USED FOR BID AND CONSTRUCTION PURPOSES. THE ARCHITECT SHALL BE THE SOLE JUDGE OF THE GREATER QUALITY.
- SEE SHEET A2.2 FOR VAULT DETAILS (DETAILS 6, 7 & 8/A2.2).
- SCHLUTER - DITRA UNDERLAYMENT SHALL BE USED UNDER ALL TILE FLOORS AND OVER FLOOR JOINTS AT TILE FLOORS.
- 2x6 WOOD FRAMING SHALL BE USED AT ALL EXT. WALLS TO ALLOW FOR THE OMISSION OF CONTINUOUS INSULATION OVER THE EXTERIOR SHEATHING. THE INTERIOR WALL HAVE BEEN DESIGNED TO USE 3⅝" METAL STUDS. IF WOOD STUDS ARE ELECTED TO BE USED IN THE INTERIOR, ALL EXPOSED LUMBER IN THE RETURN AIR PLENUM SHALL BE FIRE RATED TREATED.

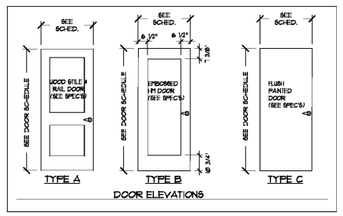

DOOR ELEVATIONS

ROOM FINISH SCHEDULE

TAG	ROOM	FLOOR FINISH	BASE-BOARD	WALL MATERIAL	WALL FINISH	CROWN MOULDING	CEILING MATERIAL	CLG. HEIGHT	NOTE
100	VESTIBULE	TILE	STAIN WOOD	GYP	VINYL WC		T&G WOOD, STAIN	VARIES	--
101	VAULT LOBBY	CARPET	STAIN WOOD	GYP	PAINT		ACT TYPE A	12'-0"	--
102	BANKING LOBBY	TILE	STAIN WOOD	GYP	PAINT		T&G WOOD, STAIN	VARIES	--
103	LOAN LOBBY	CARPET	STAIN WOOD	GYP	PAINT		ACT TYPE A	12'-0"	--
104	OFFICE	CARPET	STAIN WOOD	GYP	PAINT	--	ACT TYPE A	9'-6"	--
105	OFFICE	CARPET	STAIN WOOD	GYP	PAINT	--	ACT TYPE A	9'-6"	--
106	OFFICE	CARPET	STAIN WOOD	GYP	PAINT	--	ACT TYPE A	9'-6"	--
107	EXECUTIVE OFFICE	CARPET	STAIN WOOD	GYP	PAINT	--	ACT TYPE A	9'-6"	--
108	TOILET	TILE	TILE	GYP	VINYL WC	--	ACT TYPE A	9'-0"	--
109	CLOSET	CARPET	PNTD. WOOD	GYP	PAINT	--	ACT TYPE A	9'-0"	--
110	BREAKROOM	LVT	RUBBER	GYP	PAINT	--	ACT TYPE A	9'-0"	--
111	CLOSET	LVT	RUBBER	GYP	PAINT	--	ACT TYPE A	9'-0"	--
112	WOMEN RR	TILE	TILE	GYP	VINYL WC	--	ACT TYPE A	9'-0"	--
113	MEN RR	TILE	TILE	GYP	VINYL WC	--	ACT TYPE A	9'-0"	--
114	PASSAGE	CARPET	RUBBER	GYP	PAINT	--	ACT TYPE A	9'-0"	--
115	WORK ROOM	CARPET	RUBBER	GYP	PAINT	--	ACT TYPE A	9'-0"	--
116	DRIVE-UP TELLERS	CARPET	RUBBER	GYP	PAINT	--	ACT TYPE A	9'-0"	--
117	TELLERS	CARPET	STAIN WOOD	GYP	PAINT	--	ACT TYPE A	9'-0"	--
118	VAULT	CARPET	RUBBER	GYP	PAINT	--	ACT TYPE A	8'-0"	A
119	CB (COUPON BOOTH)	CARPET	STAIN WOOD	GYP	PAINT	--	ACT TYPE A	9'-0"	--
120	CASH ROOM	CARPET	RUBBER	GYP	PAINT	--	ACT TYPE A	9'-0"	--
121	MECH/ELEC.	SEALER	RUBBER	GYP	PAINT	--	GYP. BD. PNTD.	12'-9⅝"	--
122	CONFERENCE	CARPET	STAIN WOOD	GYP	PAINT	--	ACT TYPE A	10'-0"	--
123	OFFICE	CARPET	STAIN WOOD	GYP	PAINT	--	ACT TYPE A	9'-0"	--
124	OFFICE	CARPET	STAIN WOOD	GYP	PAINT	--	ACT TYPE A	9'-0"	--

EXTERIOR WINDOW SCHEDULE

TAG	COMBINATION NO. OF UNITS	MANUFACTURER'S NUMBER	SIZE FRAME WIDTH	SIZE FRAME HEIGHT	TYPE	MATERIAL	NOTES
BASIS OF DESIGN - PELLA (SEE SPECIFICATIONS)							
01	SINGLE	2966	2'-5"	5'-11"	DOUBLE HUNG	AL. CLAD WOOD	
02	PAIR	(two) 2966	4'-10"	5'-11"	DOUBLE HUNG	AL. CLAD WOOD	(AA) STANDARD COMBO.
03	SINGLE	2966	2'-5"	7'-2"	SIDELIGHTS (COMM. OUTSWING)	AL. CLAD WOOD	(BB) 2X4 WOOD COMBO. TO ADJACENT UNIT
04	SINGLE	2941	2'-5"	3'-5"	FIXED CASEMENTS	AL. CLAD WOOD	OVER SIDELIGHTS (2X4-BB COMBO. TO ADJ. UNITS)
05	PAIR	(two) 3650-41	6'-1"	3'-5"	FIXED CASEMENTS	AL. CLAD WOOD	OVER DOORS-CUSTOM WIDTH (AA-STD. COMBINATION)
06	SINGLE	SEE ELEVATIONS FOR SIZES - ALL CUSTOM			CLAD FIXED FRAMES	AL. CLAD WOOD	OVER ENTRY-CUSTOM SIZES 2X4 WOOD (BB) COMBO.
ENTRY SYSTEM AT INTERIOR OF VESTIBULE - BASIS OF DESIGN - PELLA (SEE SPECIFICATIONS)							
07	SINGLE	2986	2'-5"	7'-2"	SIDELIGHTS (COMM. OUTSWING)	WOOD	(BB) 2X4 WOOD COMBO. TO ADJACENT UNIT
08	SINGLE	2941	2'-5"	3'-5"	FIXED CASEMENTS	WOOD	OVER SIDELIGHTS (2X4-BB COMBO. TO ADJ. UNITS)
09	PAIR	(two) 3650-41	6'-1"	3'-5"	FIXED CASEMENTS	WOOD	OVER DOORS-CUSTOM WIDTH (AA-STD. COMBINATION)
10	SINGLE	SEE ELEVATIONS FOR SIZES - ALL CUSTOM			CLAD FIXED FRAMES	AL. CLAD WOOD	OVER ENTRY-CUSTOM SIZES 2X4 WOOD (BB) COMBO.

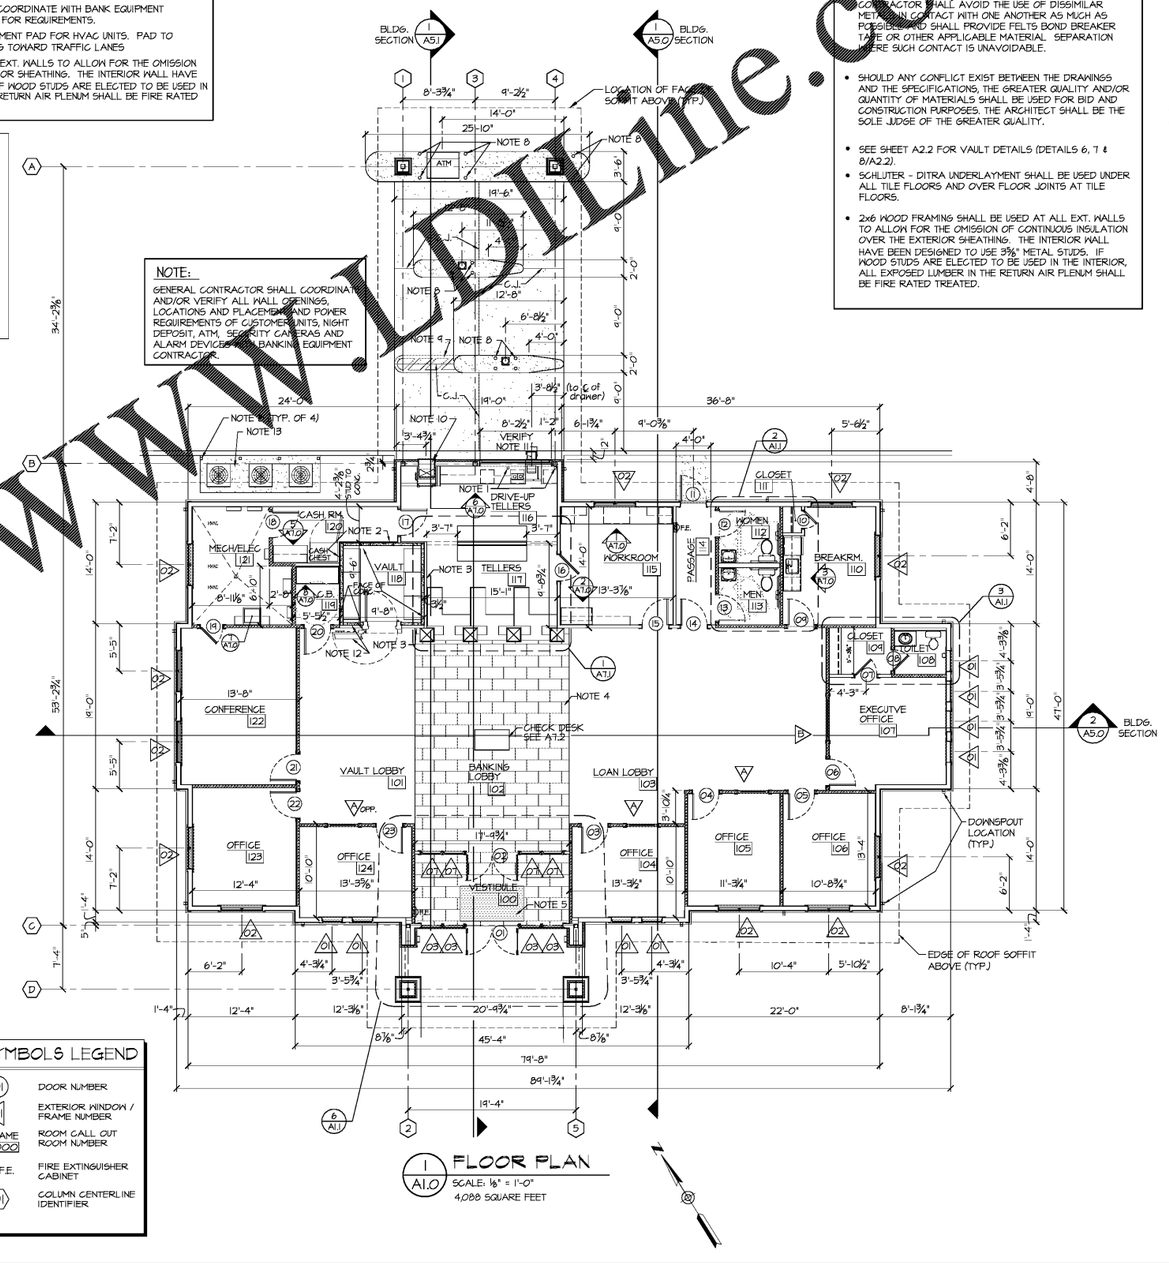

SYMBOLS LEGEND

- 01 — DOOR NUMBER
- 01 — EXTERIOR WINDOW / FRAME NUMBER
- RM NAME 000 — ROOM CALL OUT ROOM NUMBER
- F.E. — FIRE EXTINGUISHER CABINET
- COLUMN CENTERLINE IDENTIFIER

1 A1.0 FLOOR PLAN
SCALE: ⅛" = 1'-0"
4,088 SQUARE FEET

Order Plans @ WWW.DLine.com

HLH
H. LLOYD HILL ARCHITECTS & ASSOCIATES, INC.
736 GREEN STREET
GAINESVILLE, GA 30501
(770) 534-8404

A.I.A.

STATE OF GEORGIA
STEVEN B. HILL
CERTIFICATE NO. 35
REGISTERED ARCHITECT

New Cornelia Branch
Southern Bank & Trust
Cornelia, Georgia

COPYRIGHT (C) 2019 - H. LLOYD HILL ARCHITECTS AND ASSOCIATES, INC.

DATE	DESCRIPTION
04-08-2019	SCHEMATIC DESIGN DRAWINGS
04-30-2019	DESIGN DEVELOPMENT DRAWINGS
07-23-2019	CONSTRUCTION / BID DRAWINGS
...	...
...	...
...	...

PROJ. NO: G1902
FILE NAME: FLOOR
DRAWN BY: ---

SHEET TITLE:
DIMENSIONED FLOOR PLAN

SHEET NUMBER:
A1.0