



AIR FLOW TO DIFFUSERS
RETAIL HEALTH CENTER DIFFUSER 1 - 200 CFM
RETAIL HEALTH CENTER DIFFUSER 1 - 200 CFM
RETAIL HEALTH CENTER DIFFUSER 1 - 200 CFM
TOTAL AIR FLOW = 600 CFM
RETURN GRILLES - 170 EACH
OUTSIDE AIR AT RTU FOR HEALTH CENTERS - 30 CFM


- | KEYED NOTES  |
|--|
| 1 ALL HVAC DIFFUSERS AND GRILLES IN THIS AREA ARE EXISTING TO REMAIN, UNLESS NOTED OTHERWISE.  |
| 2 EXISTING SUPPLY AIR DIFFUSER TO BE RELOCATED. MOVE DIFFUSER TO NEW LOCATION. REPLACE EXISTING FLEX DUCT OF REQUIRED TO REACH THE NEW LOCATION. CHECK ALL FLEX DUCT CONNECTIONS AND SECURE AT EACH GRILLE AND AT THE MAIN TAP TO ENSURE NO GAPS AT THE CONNECTIONS. |
| 3 EXISTING RETURN AIR GRILLE TO REMAIN IN SERVICE - NO WORK.   |
| 4 EXISTING SUPPLY AIR DIFFUSER TO REMAIN IN SERVICE - NO WORK.   |
| 5 EXISTING SPLIT SYSTEM AIR HANDLING UNIT TO REMAIN IN SERVICE - NO WORK.  |
| 6 EXISTING SPLIT SYSTEM AIR HANDLING UNIT TO BE RELOCATED - SEE RENOVATION PLAN.   |
| 7 NEW SUPPLY AIR DIFFUSER - CONNECT TO EXISTING RETAIL SUPPLY DUCT AS SHOWN WITH NEW FLEX DUCT AND RIGID DUCT. MAXIMUM LENGTH OF FLEX DUCT IS 5'-0".   |
| 8 NEW RETURN AIR DIFFUSER - CONNECT TO EXISTING RETAIL RETURN DUCT AS SHOWN WITH NEW FLEX DUCT AND RIGID DUCT. MAXIMUM LENGTH OF FLEX DUCT IS 5'-0".   |
| 9 NEW CEILING RECESSED AHU-1.  |
| 10 SENSOR TO BE LOCATED IN MAIN CLINIC ONLY. CONNECT TO EXISTING RETAIL SYSTEM.  |
| 11 CU-1 MOUNTED ON ROOF ABOVE WITH DISCONNECT SWITCH.  |

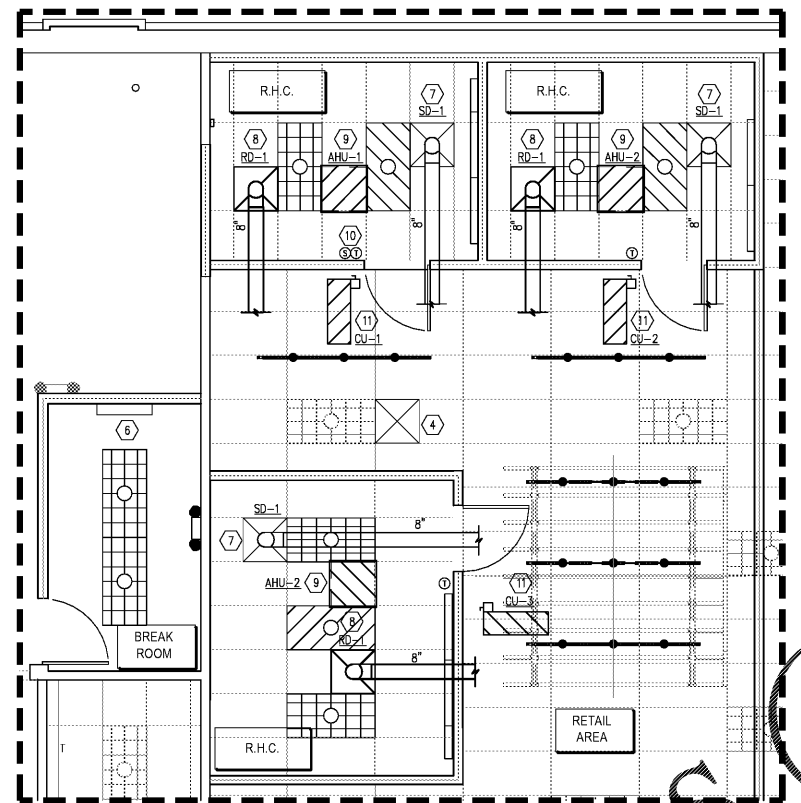

2 PARTIAL PLAN - HVAC R.H.C. RENOVATION  
M3 SCALE: 1/4"=1'-0"

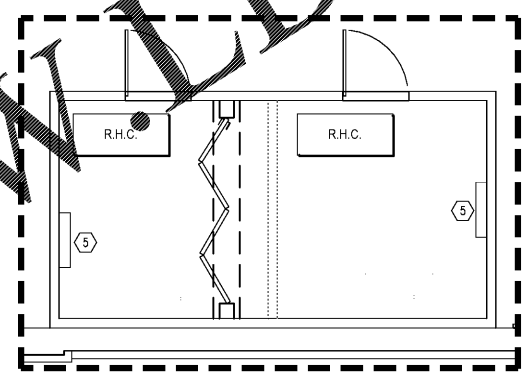

3 PARTIAL PLAN - HVAC RETAIL AREA RENOVATION  
M3 SCALE: 1/4"=1'-0"

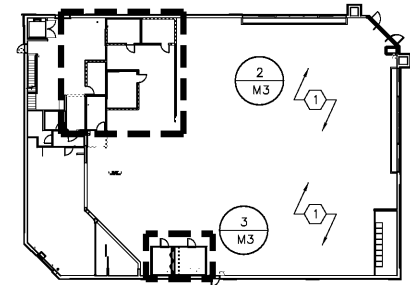

1 HVAC RENOVATION KEY PLAN  
M3 NTS

Order Plans @



STORE NUMBER: 4522  
800 EAST WEST CONNECTOR  
AUSTELL, GA  
PROJECT TYPE: Health Hub and Reset  
DEAL TYPE:  
CS PROJECT NUMBER: 134320

ARCHITECT OF RECORD

LITTLE  
ARCHITECTURAL CONSULTING

25 West College St., Suite 300, Durham, NC 27601  
T: 704.221.8100 F: 704.281.8700  
www.littleonline.com

This drawing and the design shown are the property of Little Diversified Architectural Consulting. The reproduction, copying or other use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.  
© Little 2019

CONSULTANT:

GEORGE W AUSTIN JR, PE  
212 N. McDowell St., Suite 204  
Charlotte, NC 28204  
(P) 704.334.7563 (F) 704.347.0093  
www.shurtreg.com  
SEG - 19-097

DEVELOPER:

SEAL:

7-22-2019

REVISIONS:


CVS PROJECT MANAGER: SB  
DRAWING BY: ZTM  
DATE: 07-22-2019  
JOB NUMBER: 121-12600-08  
TITLE:  
HVAC RENOVATION PLANS

SHEET NUMBER: M3  
COMMENTS: