
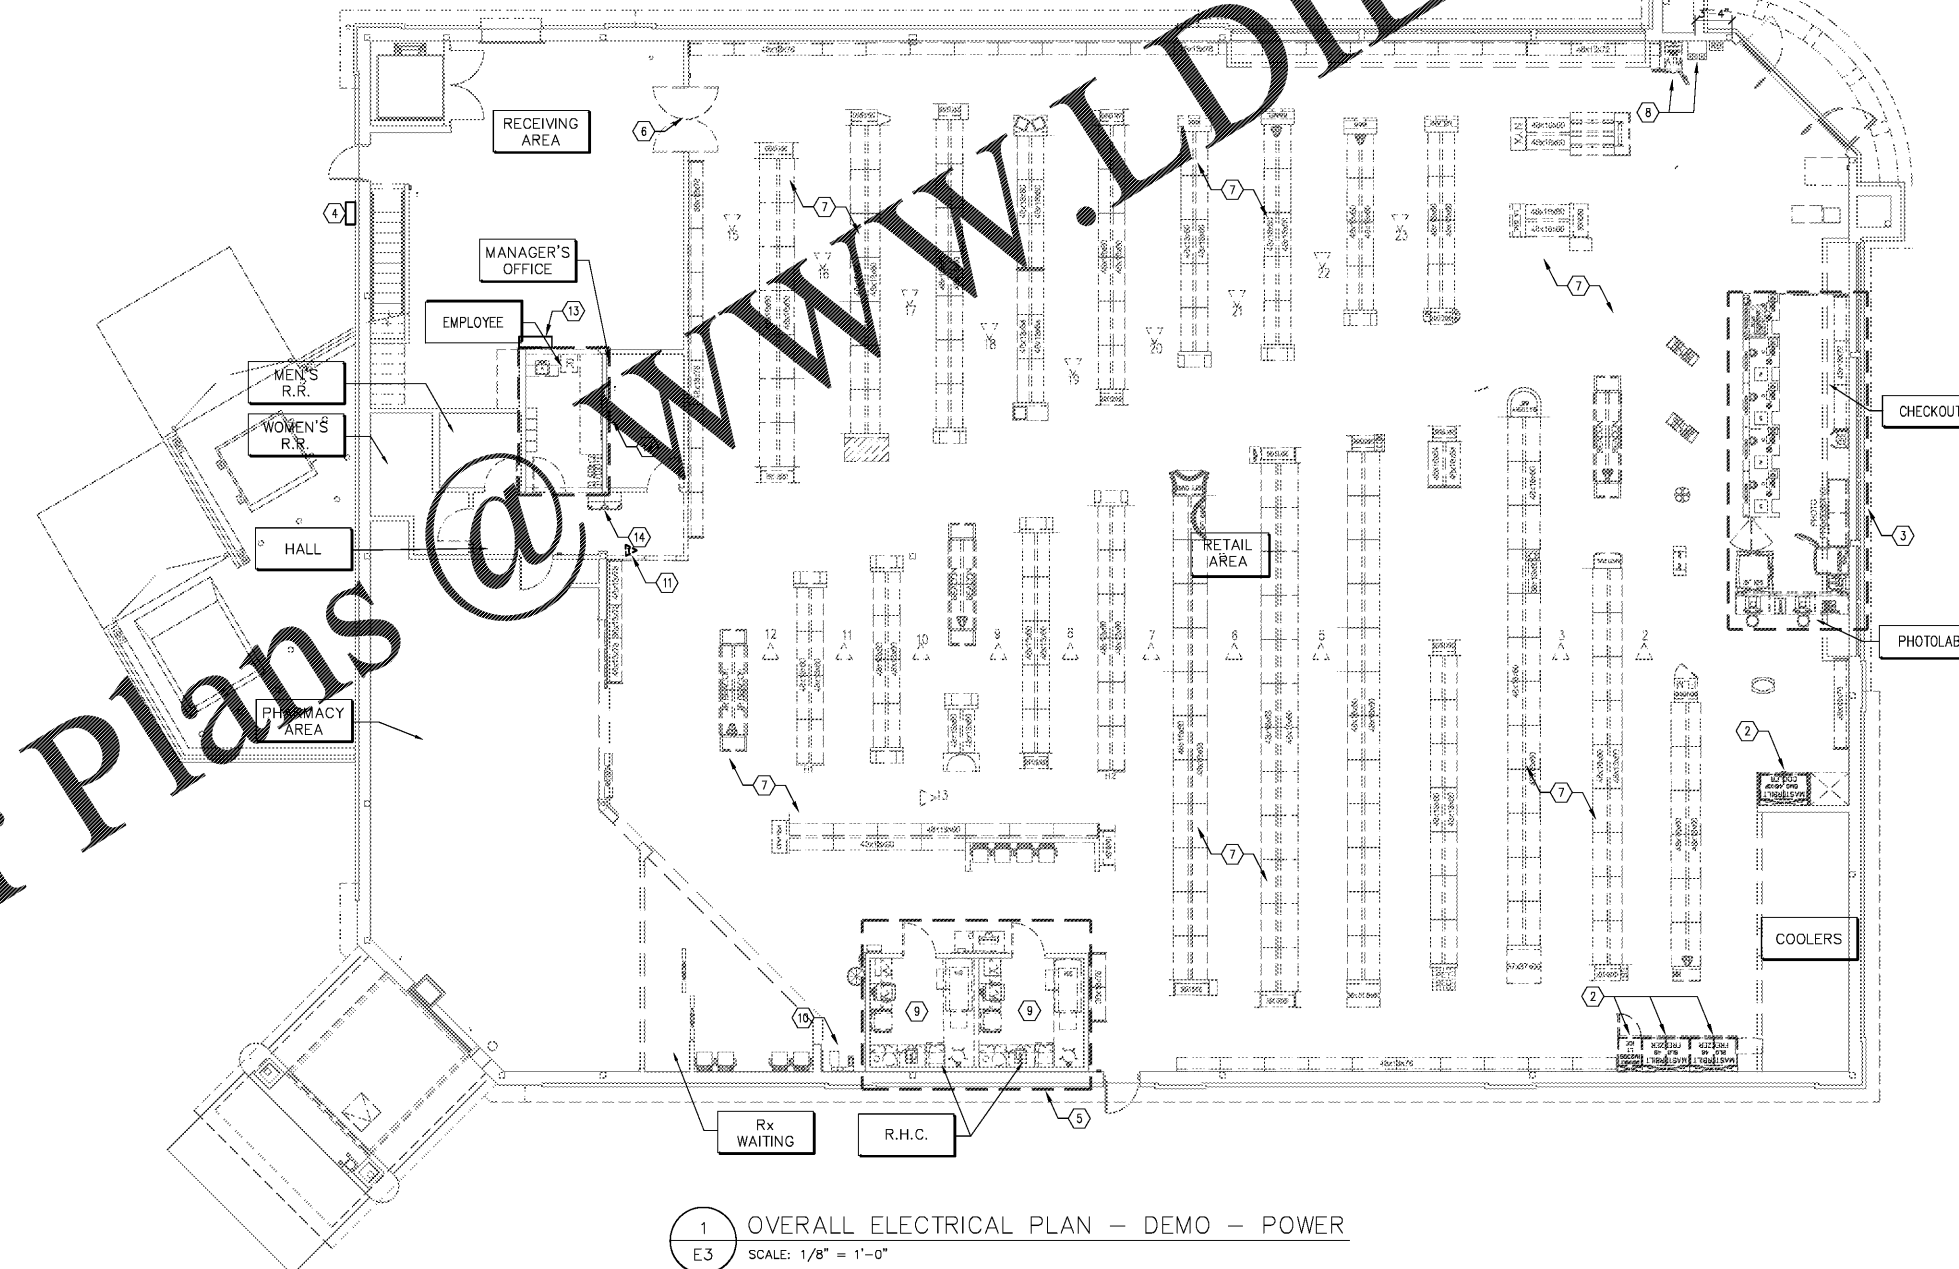


- KEYNOTES**
- 1 ALL ELECTRICAL EQUIPMENT IN THIS AREA IS EXISTING TO REMAIN, UNLESS NOTED OTHERWISE.
  - 2 EXISTING COOLERS AND FREEZERS TO BE RELOCATED TO NEW LOCATION. DISCONNECT POWER AT EXISTING LOCATION AND EXTEND CIRCUIT TO NEW LOCATION.
  - 3 EXISTING PHOTOLAB AND CHECKOUT EQUIPMENT/CASEWORK TO BE REMOVED. CONTRACTOR SHALL DISCONNECT EXISTING POWER AND TELECOMMUNICATIONS CIRCUITS/CABLING SERVING EXISTING CASEWORK/EQUIPMENT, AS NEEDED, TO ALLOW FOR REMOVAL OF CASEWORK/EQUIPMENT, AND RE-CONNECT TO NEW CASEWORK/EQUIPMENT ONCE IT HAS BEEN INSTALLED.
  - 4 EXISTING 800A MAIN DISCONNECT SWITCH.
  - 5 EXISTING CLINICS TO BE REPOSED. ALL EXISTING ELECTRICAL GEAR, DEVICES, ETC. SHALL BE DEMOLISHED. UNLESS OTHERWISE NOTED.
  - 6 EXISTING RECEIVING ACCESS TO BE RELOCATED TO NEW LOCATION. DISCONNECT EXISTING POWER AND COMMUNICATIONS CIRCUITS/CABLING SERVING EXISTING ACCESS ALARM EQUIPMENT. EXTEND TO NEW DOOR LOCATION AND RE-CONNECT EXISTING CIRCUITS TO NEW ACCESS ALARM EQUIPMENT.
  - 7 ALL MERCHANDISE FIXTURES TO BE DEMOLISHED. DISCONNECT EXISTING POWER (I.E. POWER POLES) AND TELECOMMUNICATIONS CIRCUITS/CABLING SERVING EXISTING MERCHANDISE FIXTURES/EQUIPMENT, AS NEEDED, TO ALLOW FOR REMOVAL OF CASEWORK/EQUIPMENT. NEW MERCHANDISE FIXTURES TO BE INSTALLED. RE-CONNECT EXISTING CIRCUITS TO NEW FIXTURES.
  - 8 EXISTING ATM AND FLM TO BE RELOCATED TO NEW LOCATION. DISCONNECT POWER AT EXISTING LOCATION AND EXTEND CIRCUIT TO NEW LOCATION.
  - 9 EXISTING HVAC MINI SPLIT IN EXISTING RHC TO REMAIN. COORDINATE WITH MC.
  - 10 EXISTING BLOOD PRESSURE MACHINE TO BE RELOCATED TO NEW LOCATION. IF NECESSARY, PROVIDE NEW DUPLEX RECEPTACLE AT NEW LOCATION AND EXTEND EXISTING CIRCUIT TO NEW LOCATION.
  - 11 EXISTING PHONE LOCATED HERE TO BE RELOCATED TO NEW LOCATION IN EMPLOYEE BREAK ROOM. DISCONNECT CABLING AND EXTEND/INSTALL AT NEW LOCATION AS DIRECTED BY OWNER.
  - 12 EXISTING EMPLOYEE LOUNGE TO BE RELOCATED. CONTRACTOR SHALL FIELD DOCUMENT EXISTING ELECTRICAL GEAR, DEVICES, ETC. LAYOUT IN ROOM. ELECTRICAL GEAR LAYOUT OF RELOCATED EMPLOYEE LOUNGE SHALL MATCH EXISTING EMPLOYEE LOUNGE. DISCONNECT POWER TO ALL GEAR, DEVICES, ETC. WITHIN ROOM, AND EXTEND CIRCUIT(S)/CABLING TO NEW GEAR, DEVICES, ETC. LOCATED IN RELOCATED ROOM. UNLESS OTHERWISE NOTED.
  - 13 EXISTING WALL MOUNTED HVAC UNIT TO BE RELOCATED. COORDINATE WITH MC.
  - 14 ELECTRIC WATER COOLER TO BE REPLACED/RELOCATED. DISCONNECT AND REMOVE EXISTING DUPLEX RECEPTACLE SERVING EXISTING COOLER. PROVIDE AND INSTALL NEW STANDARD DUPLEX RECEPTACLE AT NEW LOCATION AND EXTEND EXISTING 20-AMP, 120-VOLT, DEDICATED CIRCUIT TO NEW RECEPTACLE AND WIRE COMPLETELY. REPLACE EXISTING STANDARD CIRCUIT BREAKER IN PANELBOARD WITH NEW G.F.C.I. TYPE CIRCUIT BREAKER.

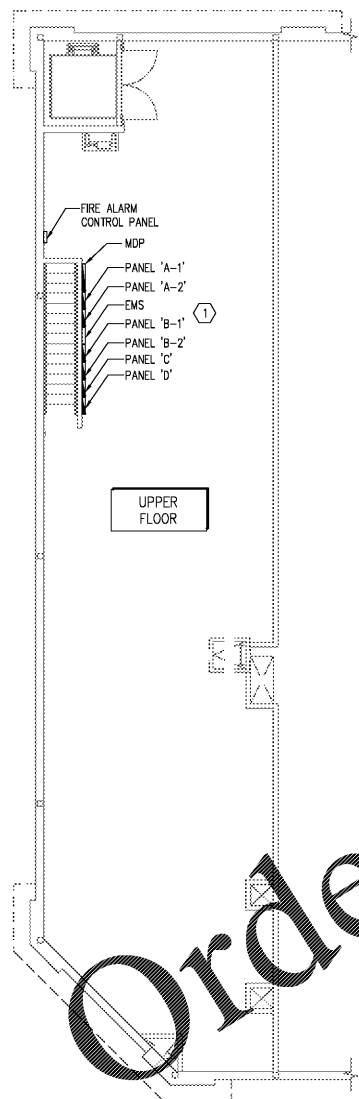

**STORE NUMBER:** 4522  
800 EAST WEST CONNECTOR  
AUSTELL, GA  
**PROJECT TYPE:** Health Hub and Reset  
**DEAL TYPE:**  
**CS PROJECT NUMBER:** 134320

**ARCHITECT OF RECORD**  
**LITTLE**  
ARCHITECTURAL CONSULTING  
222 N. DOWNTOWN BLVD, SUITE 205  
DUBLIN, GA 30128  
TEL: 770.422.8100 FAX: 770.422.8700  
www.littleonline.com  
This drawing and the design ideas are the property of Little Davenport Architectural Consulting. The reproduction, copying or other use of this drawing without their written consent is prohibited and any infringement will be subject to legal action.  
© Little 2019

**CONSULTANT:**  
**Timothy A. Payne, PE**  
222 N. DOWNTOWN BLVD, SUITE 205  
DUBLIN, GA 30128  
TEL: 770.422.8100 FAX: 770.422.8700  
taylor@tda-inc.com | 561-139-1028

**DEVELOPER:**  
**CVS pharmacy**

**SEAL:**  
GEORGIA REGISTERED PROFESSIONAL ENGINEER  
TIMOTHY A. PAYNE  
7-22-2019

**REVISIONS:**

CVS PROJECT MANAGER: SB  
DRAWING BY: WRC  
DATE: 07-22-2019  
JOB NUMBER: 121-12600-08  
TITLE: OVERALL ELECTRICAL PLAN - DEMO - POWER  
SHEET NUMBER: E3  
COMMENTS: