



GENERAL NOTES

1. ALL EQUIPMENT CONNECTIONS ON THIS DRAWING ARE BASED ON PROPOSED EQUIPMENT FOR USE ON THIS PROJECT. ALL FINAL CONNECTIONS SHALL BE AS DIRECTED BY THE KITCHEN EQUIPMENT SUPPLIERS FINAL SELECTIONS AND ROUGH-IN DRAWING. ELECTRICAL CONTRACTOR SHALL BE RESPONSIBLE FOR FINAL COORDINATION OF ALL EQUIPMENT ROUGH-IN LOCATIONS AND ELECTRICAL CONNECTIONS. ANY AND ALL DEVIATIONS SHALL BE ADDRESSED TO THE ARCHITECT IN WRITING PRIOR TO ANY ROUGH-IN.
2. ALL CONDUITS OR WIRING IN EXPOSED AREAS SHALL BE ROUTED AT 90 DEGREE ANGLES ONLY AND SHALL BE INSTALLED IN A NEAT AND ORDERLY FASHION.

KEY NOTES

1. DATA AND RECEPTACLE OUTLET MOUNTED HIGH ON WALL FOR CONNECTION TO TV. COORDINATE EXACT MOUNTING HEIGHT AND LOCATION WITH ARCHITECT PRIOR TO ROUGH-IN.
2. NOT ACTUAL EQUIPMENT LOCATION. EQUIPMENT LOCATED ON ROOF. COORDINATE EXACT LOCATION WITH KITCHEN EQUIPMENT SUPPLIER PRIOR TO ROUGH-IN.
3. PROVIDE ELECTRICAL RECEPTACLE AND DATA OUTLET FOR CONNECTION TO POS SYSTEM. COORDINATE EXACT MOUNTING HEIGHT AND LOCATION WITH OWNER/ARCHITECT PRIOR TO ROUGH-IN.
4. PROVIDE (1) RECEPTACLE/USB CONNECTION. DEVICE LOCATION MODEL #15832-X OR APPROVED EQUIVALENT. PROVIDE EXACT DEVICE AND COVERPLATE COLOR. ARCHITECT PRIOR TO ORDERING. COORDINATE EXACT DEVICE MOUNTING HEIGHT AND LOCATION WITH ARCHITECT PRIOR TO ROUGH-IN.
5. DEVICE(S) MOUNTED WITHIN MILLWORK. COORDINATE WITH MILLWORK SUPPLIER.
6. DATA AND RECEPTACLE OUTLET MOUNTED IN CEILING FOR CONNECTION TO TV. COORDINATE EXACT MOUNTING HEIGHT AND LOCATION WITH ARCHITECT PRIOR TO ROUGH-IN.
7. PROVIDE CONNECTION TO AIR CURTAIN PER MANUFACTURERS RECOMMENDATIONS.
8. NPT TRANSFORMER. REFER TO RISER DIAGRAM FOR FURTHER REQUIREMENTS.

ELECTRICAL ROUGH-IN NOTES


1. VERIFY ALL EQUIPMENT LOCATIONS AND MOUNTING HEIGHTS SHOWN WITH EQUIPMENT SUPPLIER AND OWNER PRIOR TO ROUGH-IN.
2. ALL 20A 1P RECEPTACLES IN SCHEDULE SHALL BE GFI PROTECTED.
3. VERIFY ALL LOADS AND CONNECTION FOR ACTUAL EQUIPMENT SUPPLIED PRIOR TO ROUGH-IN. VERIFY EXACT REQUIREMENTS WITH MANUFACTURER PRIOR TO ROUGH-IN.
4. COORDINATE EXACT LOCATION WITH EQUIPMENT SUPPLIER PRIOR TO ROUGH-IN.

ABBREVIATIONS

AFT	ABOVE FINISHED FLOOR
BTC	BRANCH TO CONNECT
CLG	CEILING
DFA	DOWN FROM ABOVE
FD	FLOOR DRAIN
FDD	FUNNEL FLOOR DRAIN
FLR.	FLUSH WITH FLOOR
FS	FLOOR SINK
VRF	VERIFY W/EQUIPMENT SUPPLIER

Consultant
WESTSIDE
5525 Interstate North Pkwy
Suite 200
Atlanta, GA 30328
404-965-1287 tel
404-601-9859 fax
www.westside-engineering.com

EDGAR'S ABOVE BROAD
699 BROAD ST.
AUGUSTA, GEORGIA 30901

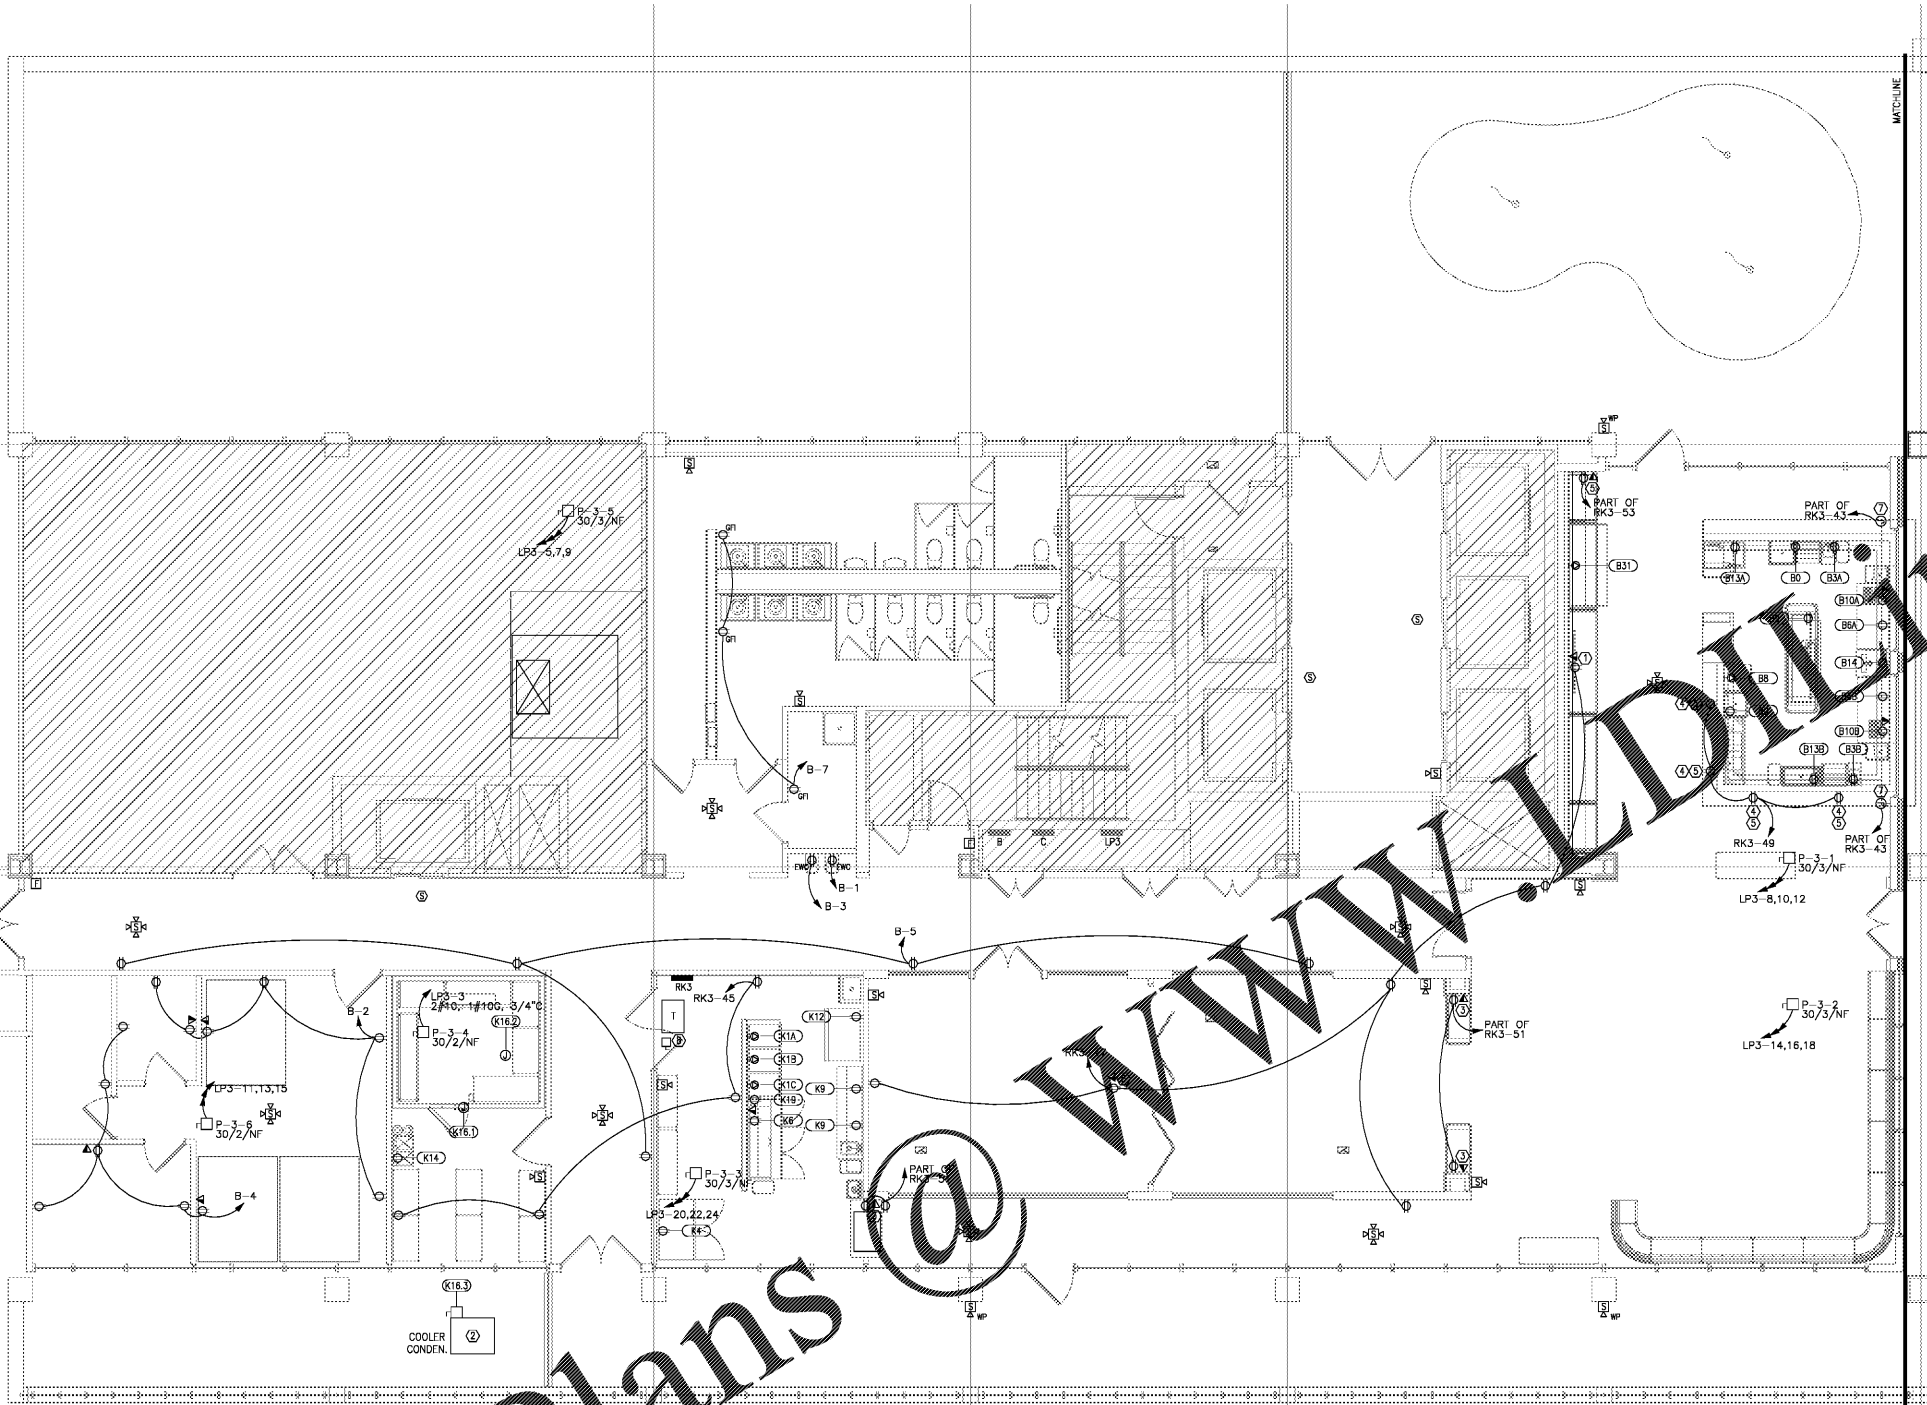

1 PARTIAL 3RD LEVEL - ELECTRICAL
E1.1 SCALE: 3/16" = 1'-0"

ELECTRICAL CONNECTION SCHEDULE

EQPT. NO.	EQUIPMENT	EQUIPMENT TYPE	CONNECTION	ELECTRICAL DATA				REMARKS
				VOLTS/PH	AMP	S.F.A.	MOUNTING HEIGHT	
B0	CONFERENCE RECEPTACLES		2W12, 1W12S, 3/4"	120	-	15.0	12.0	VERIFY CONNECTION TYPE
B0A	BLENCHER STATION	RK3-3	2W12, 1W12S, 3/4"	120	-	15.0	12.0	VERIFY CONNECTION TYPE
B0B	BLENCHER STATION	RK3-5	2W12, 1W12S, 3/4"	120	-	15.0	12.0	VERIFY CONNECTION TYPE
B0C	BANK EAT	RK3-7	2W12, 1W12S, 3/4"	120	-	5.2	18.0	VERIFY CONNECTION TYPE
B0D	BANK EAT	RK3-7	2W12, 1W12S, 3/4"	120	-	5.2	18.0	VERIFY CONNECTION TYPE
B0E	DC DISMOUNT	RK3-11,13,15	2W12, 1W12S, 3/4"	120	-	15.0	12.0	VERIFY CONNECTION TYPE
B0F	KEB COOLER	RK3-15	2W12, 1W12S, 3/4"	120	-	5.2	18.0	VERIFY CONNECTION TYPE
B10A	POS STATION	RK3-17	2W12, 1W12S, 3/4"	120	-	15.0	18.0	VERIFY CONNECTION TYPE
B10B	POS STATION	RK3-19	2W12, 1W12S, 3/4"	120	-	15.0	18.0	VERIFY CONNECTION TYPE
B10C	SODA GUN	RK3-21	2W12, 1W12S, 3/4"	120	-	5.0	18.0	VERIFY CONNECTION TYPE
B10D	SODA GUN	RK3-21	2W12, 1W12S, 3/4"	120	-	5.0	18.0	VERIFY CONNECTION TYPE
B14	COFFEE MACHINE	RK3-23	2W12, 1W12S, 3/4"	120	-	15.0	12.0	VERIFY CONNECTION TYPE
B20	REFRIGERATED MERCHANDISER	RK3-25,7	2W12, 1W12S, 3/4"	208/1	-	10.0	18.0	VERIFY CONNECTION TYPE

ELECTRICAL CONNECTION SCHEDULE

EQPT. NO.	EQUIPMENT	EQUIPMENT TYPE	CONNECTION	VOLTS/PH	AMP	S.F.A.	MOUNTING HEIGHT	REMARKS
K1A	OVEN	RK3-2A	2W12, 1W12S, 3/4"	208/1	-	24.0	48.0	VERIFY CONNECTION TYPE
K1B	OVEN	RK3-2B	2W12, 1W12S, 3/4"	208/1	-	24.0	48.0	VERIFY CONNECTION TYPE
K1C	OVEN	RK3-2C	2W12, 1W12S, 3/4"	208/1	-	24.0	48.0	VERIFY CONNECTION TYPE
K2	REFRIGERATOR	RK3-14	2W12, 1W12S, 3/4"	120	-	7.1	50.0	VERIFY CONNECTION TYPE
K3	REFRIGERATOR	RK3-16	2W12, 1W12S, 3/4"	120	-	5.0	50.0	VERIFY CONNECTION TYPE
K4	CONFERENCE RECEPTACLES	RK3-18	2W12, 1W12S, 3/4"	120	-	15.0	18.0	VERIFY CONNECTION TYPE
K10	ICE MACHINE	RK3-30	2W12, 1W12S, 3/4"	120	-	14.2	80.0	VERIFY CONNECTION TYPE
K14	BANK BOX	RK3-32	2W12, 1W12S, 3/4"	120	-	15.0	18.0	VERIFY CONNECTION TYPE
K15.1	WALK-IN ACCESSORIES	RK3-34	2W12, 1W12S, 3/4"	120	-	15.0	18.0	VERIFY CONNECTION TYPE
K15.2	WALK-IN EVAPORATOR	RK3-35,36	2W12, 1W12S, 3/4"	208/1	-	1.0	110.0	VERIFY CONNECTION TYPE
K15.3	WALK-IN CONDENSER	RK3-37	2W12, 1W12S, 3/4"	208/1	-	15.0	18.0	VERIFY CONNECTION TYPE
K16	POS PRINTER	RK3-38	2W12, 1W12S, 3/4"	120	-	15.0	18.0	VERIFY CONNECTION TYPE

Order Plans @ WWW.LDPLANS.COM

Project Number	1817	
Revisions		
Revision History		
Number	Date	Description
	08/30/19	ISSUED FOR CONSTRUCTION
Drawing Title	PARTIAL 3RD LEVEL - ELECTRICAL	
Drawing Status	ISSUED FOR CONSTRUCTION	
Drawing Number	E1.1	