



Consultant
W 5525 Interstate North Pkwy
Suite 200
Atlanta, GA 30328
404-965-1287 tel
404-601-9859 fax
westside@westside-engineering.com

**EDGAR'S ABOVE BROAD
699 BROAD ST.
AUGUSTA, GEORGIA 30901**


Project Number	1817	
Revisions		
Revision History		
Number	Date	Description
	08/30/19	ISSUED FOR CONSTRUCTION
Drawing Title	PARTIAL 3RD LEVEL - LIGHTING	
Drawing Status	ISSUED FOR CONSTRUCTION	
Drawing Number		

GENERAL NOTES:

1. PROVIDE DIMMER SWITCHES COMPATIBLE WITH LED LIGHT FIXTURE THEY ARE CONTROLLING. PROVIDE WIRING AS REQUIRED FROM DIMMER TO LIGHT FIXTURE. COORDINATE WITH FIXTURE MANUFACTURER.

KEYNOTES:

1. SWITCH BANK 'D'. PROVIDE SWITCHES AS FOLLOWS:
 Sd - (1) DIMMER SWITCH SERVING DINING/BAR PENDANTS
 Sp - (1) DIMMER SWITCH SERVING DECORATIVE PENDANTS
 Sc - (1) DIMMER SWITCH SERVING FLEXIBLE LUMINAIRE SYSTEM
 Sd - (1) DIMMER SWITCH SERVING FLEXIBLE LUMINAIRE SYSTEM
 Se - (1) DIMMER SWITCH SERVING DOWNLIGHTS
 Sf - (1) DIMMER SWITCH SERVING DECORATIVE PENDANTS
 Sg - (1) DIMMER SWITCH SERVING BAR TABLE LAMPS
2. PROVIDE (1) PHILIPS BOONE GID GENERATOR TRANSFER DEVICE AND CONNECT TO 120V EMERGENCY CIRCUIT MADE AVAILABLE DURING DEMOLITION.
3. PROVIDE LED STRIP (F15) AT EACH LEVEL OF SHELVING. REFER TO ARCHITECTURAL ELEVATIONS FOR LOCATIONS AND MOUNTING REQUIREMENTS.
4. CONNECT TO 120V EMERGENCY CIRCUIT MADE AVAILABLE DURING DEMOLITION.

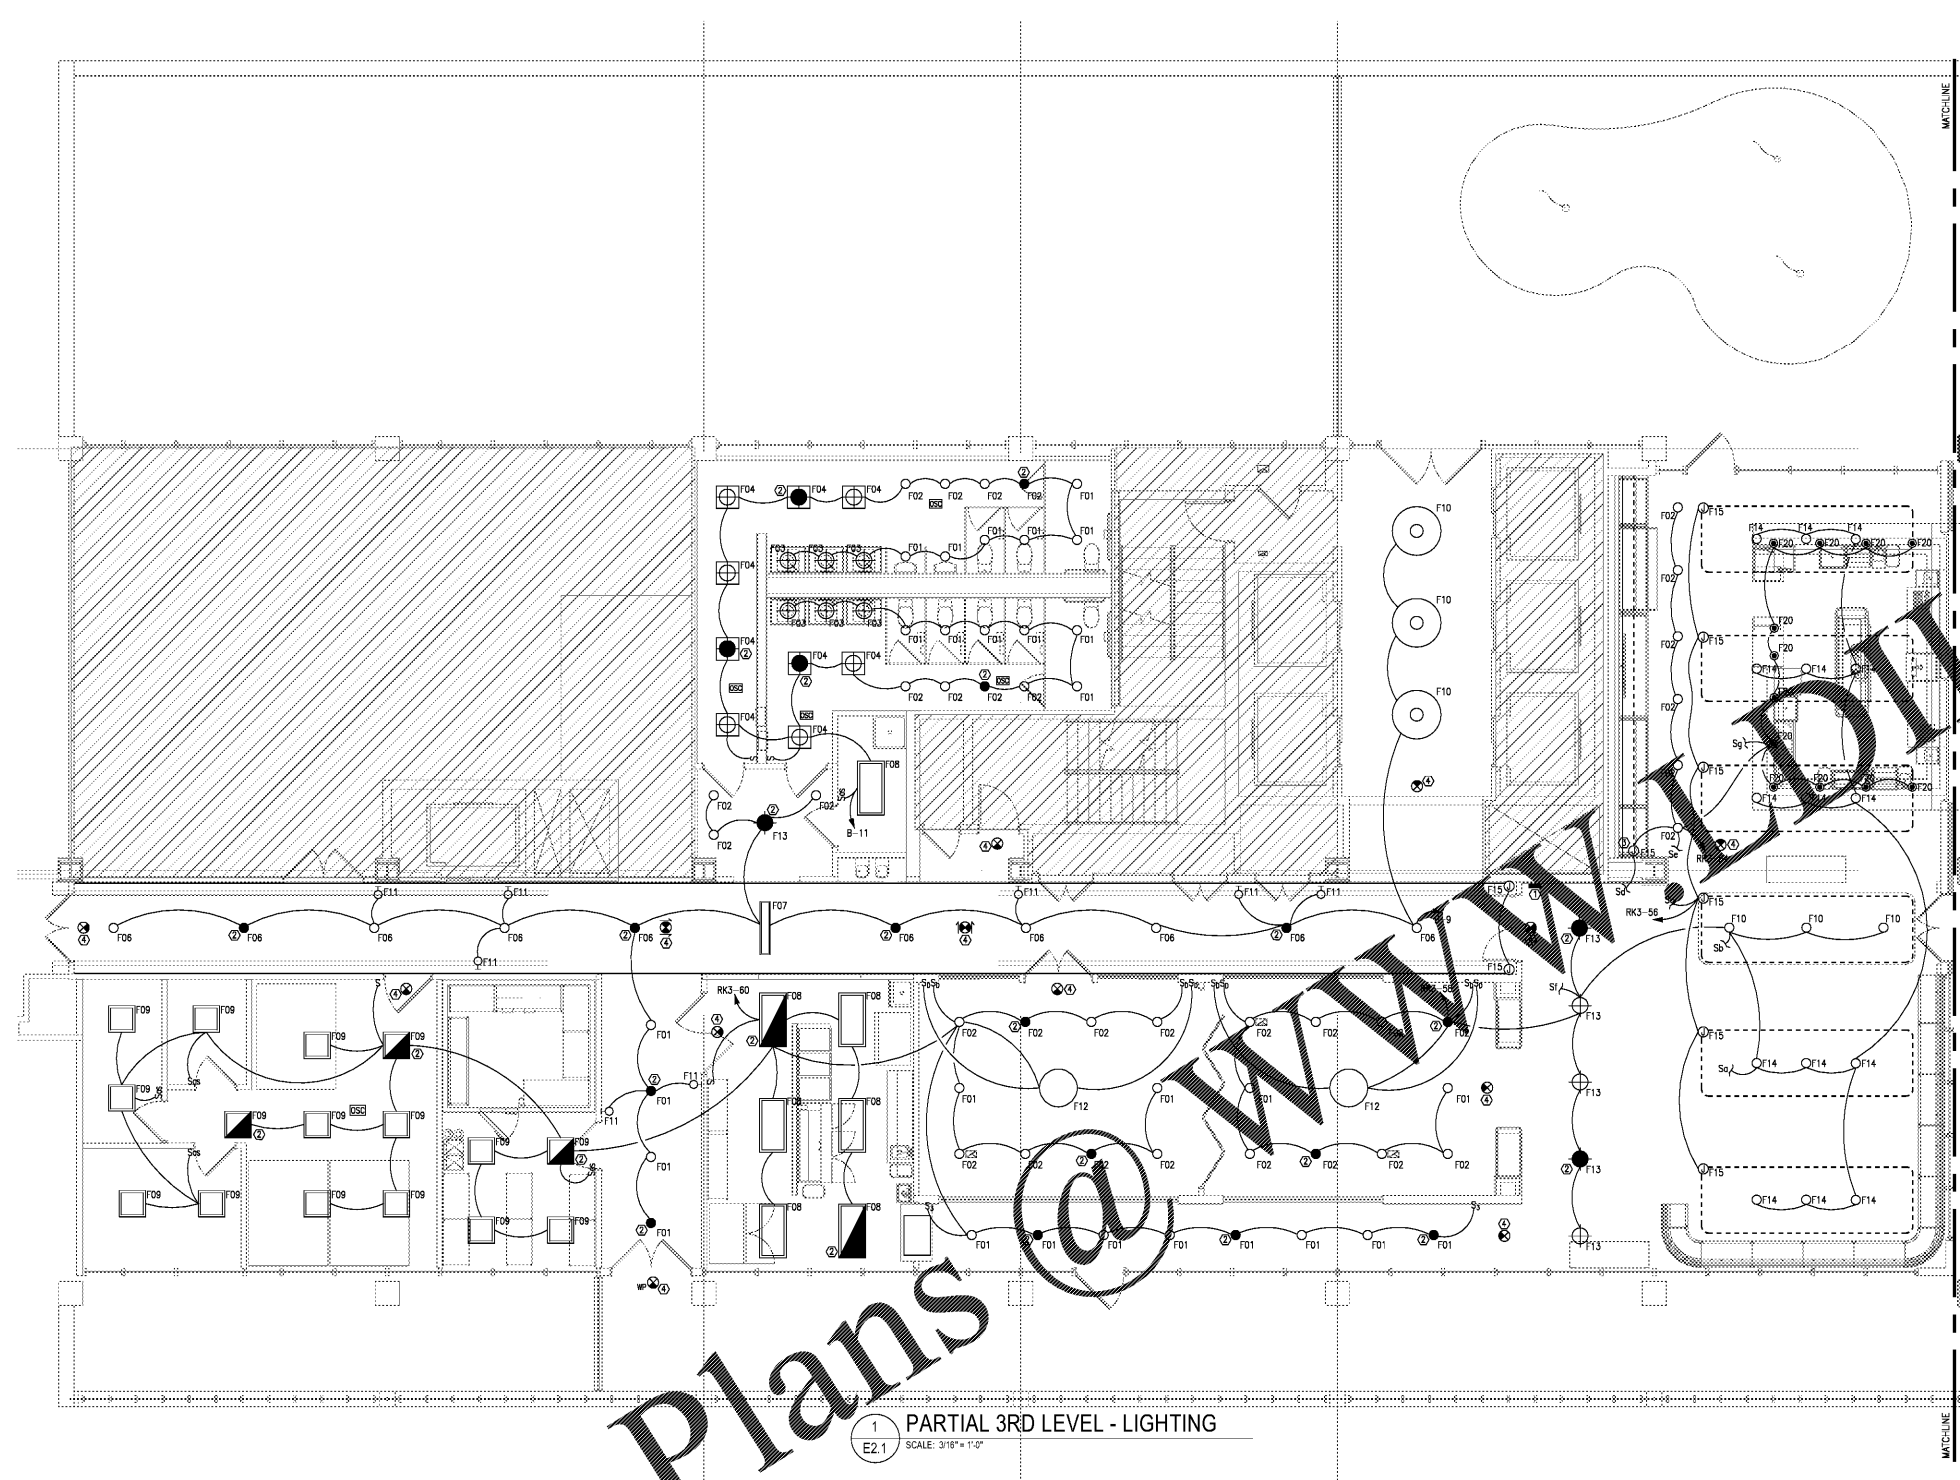

1 PARTIAL 3RD LEVEL - LIGHTING
E2.1 SCALE: 3/16" = 1'-0"

Order Plans @ www.westside.com