HOOD INFORMATION

HOOD NO.	MARK	MODEL	HOOD DIMENSIONS (IN.)			HOOD CONSTR.	COOKING LOAD / DUTY RATING	EXHAUST					SUPPLY		TOTAL WEIGHT LBS.	SECTION LOCATION
			LENGTH	WIDTH	HEIGHT			TOTAL CFM	COLLAR(S) WIDTH	LENGTH	DIA.	CFM	S.P.	MUA CFM	AC CFM	
1	M-4A AND M-4B - HOODS	XXEW-132-S	132	48	FRT 12 BACK 24	430 SS WHERE EXPOSED	HEAVY	2500	10	24		2500	0.539	2000	500	385	LEFT
2	M-4A AND M-4B - HOODS	XXEW-132-S	132	48	FRT 12 BACK 24	430 SS WHERE EXPOSED	HEAVY	2500	10	24		2500	0.539	2000	500	385	RIGHT

HOOD INFORMATION

HOOD NO.	MARK	LIGHTING DETAILS			GREASE FILTRATION DETAILS				UTILITY CABINET(S)				
		FIXTURE TYPE BULB / LAMP INFO	QTY	FOOT CANDLES	TYPE / MODEL MATERIAL	QTY	SIZE (IN.) L	H	LOCATION	FIRE SYSTEM TYPE	SIZE	CONTROLS MODEL	INTERFACE
1	M-4A AND M-4B - HOODS	INCANDESCENT (GLOBE) 100W A19 (BULBS NOT INCL.)	6	56.61	X-TRACTOR STAINLESS STEEL	7	16	20					
						1	20						
2	M-4A AND M-4B - HOODS	INCANDESCENT (GLOBE) 100W A19 (BULBS NOT INCL.)	6	56.61	X-TRACTOR STAINLESS STEEL	7	16	20					
						1	20						

SUPPLY PLENUM INFORMATION

HOOD NO.	MARK	POS.	TYPE	SIZE (IN.) L	W	H	INSULATED	DAMPER(S)	LED LIGHT(S) SUPPLIED	QTY	TOTAL CFM	COLLARS TYPE	MOUNTING	QTY	W	L	DIA.	CFM	S.P.	VEL.
1	M-4A AND M-4B - HOODS	FRONT	SPLIT ASP	132	14	10	NO	NO	NO		2000	MUA	FACTORY	3	10	20		667	0.15	480
				132	10	10	YES				500	AC	FACTORY	4			8	125	0	358
2	M-4A AND M-4B - HOODS	FRONT	SPLIT ASP	132	14	10	NO	NO	NO		2000	MUA	FACTORY	3	10	20		667	0.15	480
				132	10	10	YES				500	AC	FACTORY	4			8	125	0	358

HOOD OPTIONS

- UL 710 LISTED W/ OUT EXHAUST FIRE DAMPER - UL #R25625
- BACK INTEGRAL AIR SPACE - 3 IN WIDE
- 28 IN HIGH CEILING ENCLOSURES - FRONT LEFT RIGHT - FIELD INSTALLED
- FACTORY MOUNTED EXHAUST COLLAR(S)
- LEFT MINI END SKIRT - 18 IN HIGH 30.00 IN TOP WIDTH 4.0 IN BOTTOM WIDTH
- RIGHT MINI END SKIRT - 18 IN HIGH 30.00 IN TOP WIDTH 4.0 IN BOTTOM WIDTH
- HOOD FRONT IS TAPERED (FOR LOW CEILING APPLICATIONS)
- BACKSPLASH 128.00 IN HIGH 313.50 IN LONG
- PERFORMANCE ENHANCING LIP (PEL) TECHNOLOGY
- STANDING SEAM CONSTRUCTION FOR SUPERIOR STRENGTH

SPECIAL DESIGN REQUESTS

- SDR #K1600191-2 - ADDITIONAL GREASE CUP FACTORY INSTALLED ABOVE GRIDDLES, SECTION 2 OF HOOD, CENTE
- SDR #K1700743 - 18INCH TALL END MINI END SKIRT ON BOTH SIDES
- SDR #K1234567 - SHELF OVER FRYERS. ANSUL DROPS TO BE MOVED FOWARD
- SDR #K1234567-1 - RIGHT GRIDDLE DROP TO BE ON THE RIGHT HAND SIDE OF SHELF NOT IN THE MIDDLE

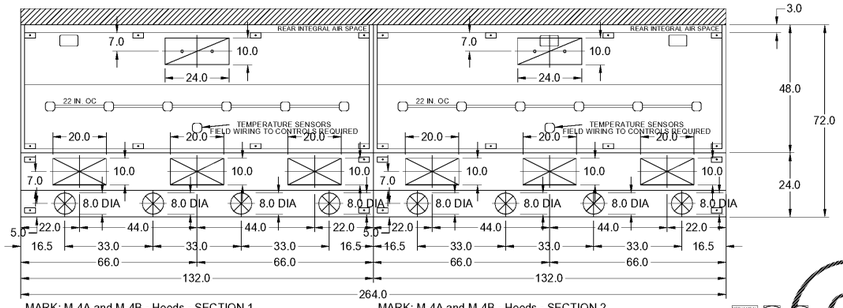

MARK: M-4A and M-4B - Hoods - SECTION 1
PLAN VIEW

MARK: M-4A and M-4B - Hoods - SECTION 2
PLAN VIEW

FIRE SYSTEM MARK: M-4C-ASS

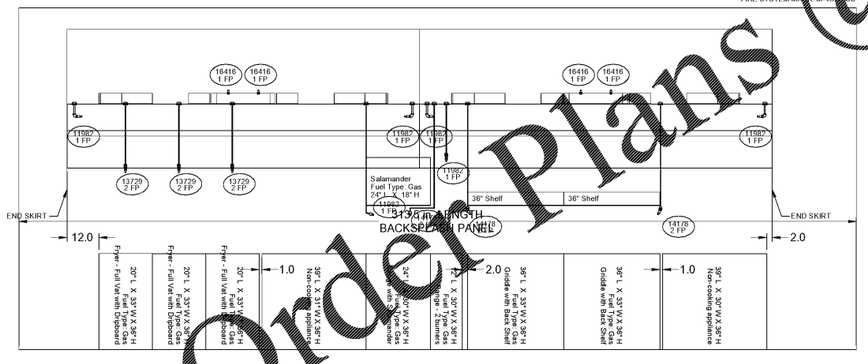

MARK: M-4A and M-4B - Hoods - SECTION 1
ELEVATION VIEW

MARK: M-4A and M-4B - Hoods - SECTION 2
ELEVATION VIEW

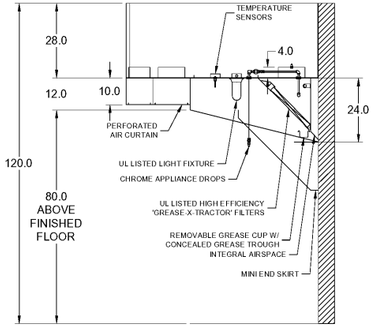

MARK: M-4A and M-4B - Hoods (LAST HOOD IN ROW)
SECTION VIEW

BACKSPLASH LAYOUT

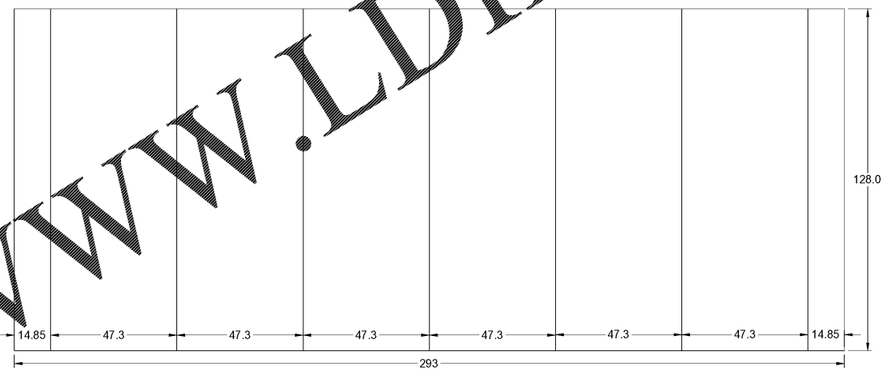

MINI-END SKIRT INSTALLATION DETAIL

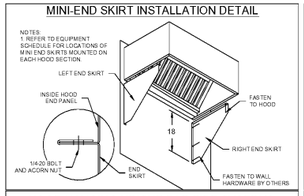

HOOD HANGING HEIGHT FOR FIRE SYSTEMS

VERIFICATION OF HOOD HANGING HEIGHT ABOVE FINISHED FLOOR (A.F.F.) IS REQUIRED FOR CORRECT PLACEMENT OF FIRE SYSTEM NOZZLES.

☐ RECOMMENDED HANGING HEIGHT = 80" FROM FINISHED FLOOR TO LOWER FRONT EDGE OF HOOD.

☐ OTHER HANGING HEIGHT = _____ " FROM FINISHED FLOOR TO LOWER EDGE OF HOOD.

FLAT BACKSPLASH PANEL INST. DETAIL



ENCLOSURE PANEL INSTALLATION DETAIL



SUPPLY PLENUM HANGER BRACKET DETAIL

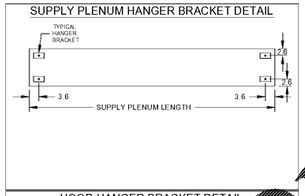

HOOD HANGER BRACKET DETAIL

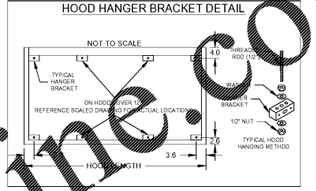

WWW.LDILine.com
Order Plans @ WWW

THESE DRAWINGS WERE OBTAINED FROM ACCUREX. VERIFY LATEST DRAWINGS PRIOR TO ORDERING EQMT

PROJECT 5/31/2019 BAD DADDYS MARIETTA GA

MARK M-4A AND M-4B - HOODS

ACCUREX KS NE WESTERN MO
BENJAMIN.OBRIEN@ACCUREX.COM
(816)888 9742

ACCUREX

Consultant:
ARWIN PRIEST P.E., P.Eng.
MECHANICAL * ENGINEER * ELECTRICAL
242 MOUNTAIN CLOUD CIRCLE
HIGHLANDS RANCH, CO 80126
(303) 898-2664 pe5744@gmail.com

5280 Engineering
www.DesignMEP.com
720-320-7744 roger@5280engineering.com

SEAL

DATE :

GOOD TIMES RESTAURANTS, INC.
141 Union Blvd, Suite 400
Lakewood, CO 80228
tel: (303) 384-1430

BAD DADDY'S BURGER BAR
"SANDY PLAINS"
3460 SANDY PLAINS RD
SUITE 110
MARIETTA, GA 30062

Issue Record:
06.07.2019 FOR PLAN REVIEW

Revisions:
1 08.01.2019 BAR FIXT. TO GREASE WST.
2 08.28.2019 QCR

Drawn:
DRAWN BY: F long

Checked:
CHECKED BY: R Blank

Project No.
PROJECT#: 2019-041

Contents:
ACCUREX HOOD DESIGN

H-1
of 5

Client: Ethos Architecture – John Sponseller 303-374-8898; 303-815-0161(cell); jsponseller@ethos-architecture.com