

FIRE SYSTEM INFORMATION							
MARK	MODEL	LOCATION	FLOW POINTS		SUPPLY LINE	DETECTION	MARK(S) PROTECTED BY FIRE SYSTEM
			HOODS	PCU			
M-4G - FSS	AMEREX KP WET CHEMICAL	REMOTE MOUNTED	22 UTILIZED		CONTINUOUS	FUSIBLE LINK	M-4A AND M-4B - HOODS SECTION 1 M-4A AND M-4B - HOODS SECTION 2


FIRE SYSTEM OPTIONS AND ACCESSORIES

FULL INSTALLATION (INCLUDES PRE-PIPED HOOD(S) WITH DETECTION AND FACTORY COORDINATED INSTALL)
 CHROME SLEEVES FOR FACTORY PROVIDED APPLIANCES DROPS - INCLUDED
 METAL BLOW-OFF CAPS - INCLUDED
 GAS VALVE - INCLUDED - MECHANICAL SHUTOFF VALVE, 2.00" (AMEREX) - PART# AMEREXMECHSHUTOFFVALVE200
 HOOD SUPPRESSION AGENT - INCLUDED - 7.5 GAL. - [(2) 3.75 TANK(S)]
 REMOTE PULL STATION - STANDARD - INSTALLATION AT SINGLE POINT OF EGRESS
 TANK ENCLOSURES (STAINLESS STEEL) FOR REMOTE MOUNTING - INCLUDED

SPECIAL DESIGN REQUESTS

SDR #K1234567 - LOCAL PERMITTING FEE

AMEREX KP (WET CHEMICAL) FIRE PROTECTION SYSTEM - MODEL FSSK

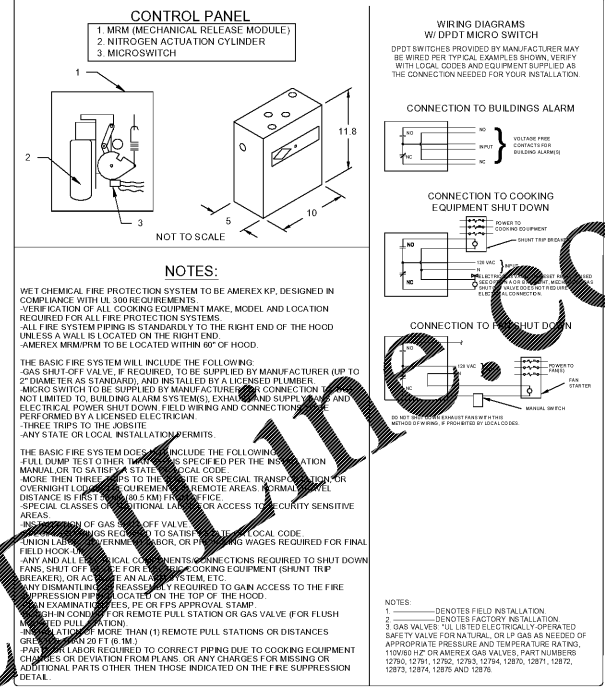

PROJECT: 5/31/2019
 ACCUREX KS NE WESTERN I/O
 BENJAMIN.OBRIEN@ACCUREX.COM
 (816) 888 9142
 BAD DADDY'S MARIETTA GA
 MARK: M-4G - FSS

Order Plans @ WWW.LIVEPLANING.COM

Consultant:
 ARWIN PRIEST P.E., P.Eng.
 MECHANICAL * ENGINEER * ELECTRICAL
 242 MOUNTAIN CLOUD CIRCLE
 HIGHLANDS RANCH, CO 80126
 (303) 898-2664 pc5744@gmail.com

5280 Engineering
 www.DesignMEP.com
 720-320-7744 rjg@5280engineering.com

SEAL

DATE :



GOOD TIMES RESTAURANTS, INC.
 141 Union Blvd, Suite 400
 Lakewood, CO 80228
 tel: (303) 384-1430

BAD DADDY'S BURGER BAR
 "SANDY PLAINS"
 3460 SANDY PLAINS RD
 SUITE 110
 MARIETTA, GA 30062

ACCUREX

Issue Record:
 06.07.2019 FOR PLAN REVIEW

Revisions:
 08.01.2019 BAR FIXT. TO GREASE WST
 08.28.2019 QCR
Drawn:
 DRAWN BY: F Long
Checked:
 CHFCCKFD BY: R Blank
Project No.
 PROJ.FCI#: 2019-041
Contractor:
 ACCUREX HOOD DESIGN

THESE DRAWINGS WERE OBTAINED FROM ACCUREX. VERIFY LATEST DRAWINGS PRIOR TO ORDERING EQMT